

CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 0514371

Insp Area: 3

Thos Bros: 318A2

Site Address: 3501 59TH ST SAC

Parcel No: 015-0151-003

Sub-Type: AOTHR

Housing (Y/N): N

CONTRACTOR
JOE VAN ARK
2731 ECHO WY
SAC CA 95821

OWNER
CITY OF SACRAMENTO
SACRAMENTO CA
58200

ARCHITECT

Nature of Work: ART IN PUBLIC PLACES - TAHOE TALLAC PARK - LITTLE LEAGUE STATUE

CONSTRUCTION LENDING AGENCY: I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class _____ License Number 338841 _____ Date _____ Contractor Signature _____

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. _____ B & PC for this reason: _____

Date 10-11-05 Owner Signature *[Signature]*

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and herby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 10-11-05 Applicant/Agent Signature *[Signature]*

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:


Carrier _____ Policy Number _____ Exp Date _____

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 10-11-05 Applicant Signature *[Signature]*

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

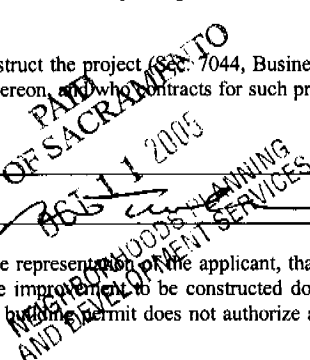


0514371 3501 59th St.



...the
...at the
...the
...of
...and specification
...held to permit or approve the
...of any City Ordinance or State Law.

APPROVED
City of Sacramento Plan Review
SITE

[Signature]
Signature
10/2/05
Date

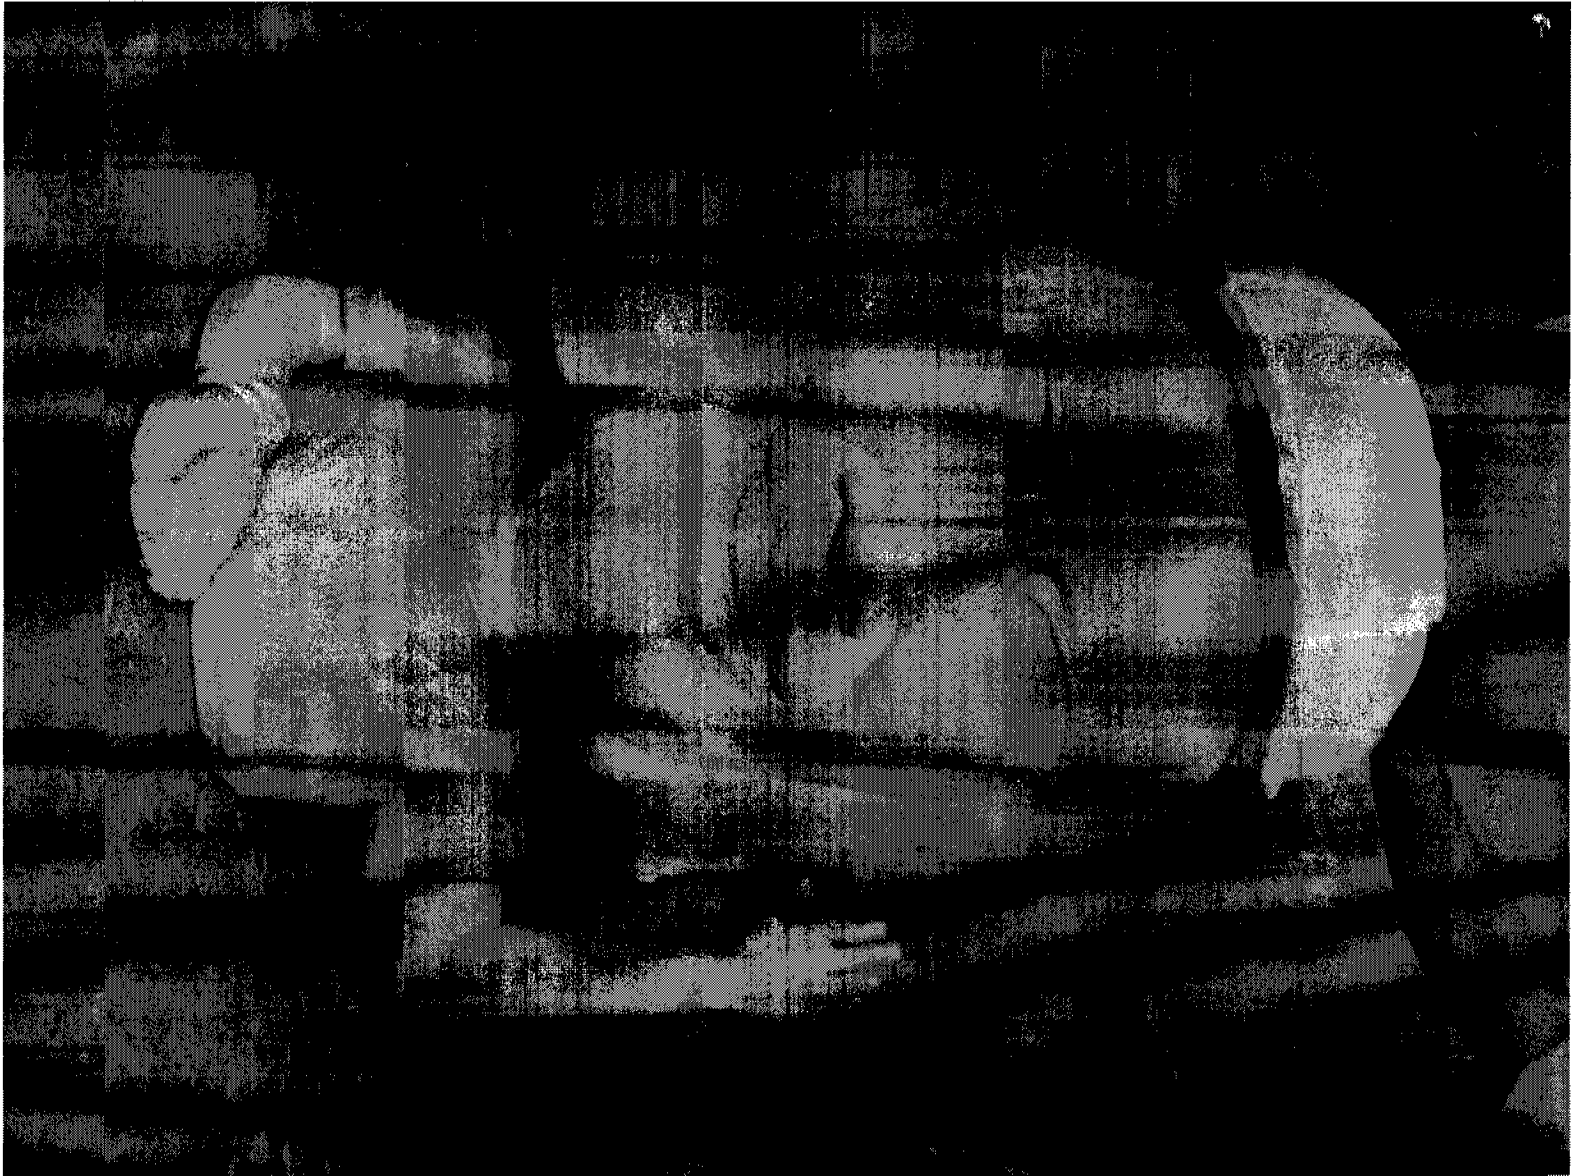

City of Sacramento

OCT 1 2005



NORTH PERMIT
CENTER

Job Copy

RECEIVED
SEP 1 8 2005
CITY OF SACRAMENTO
NORTH PERMIT
CENTER


APPROVED
City of Sacramento Plan Review
STRUCTURAL

[Signature]
Signature
9/27/05
Date

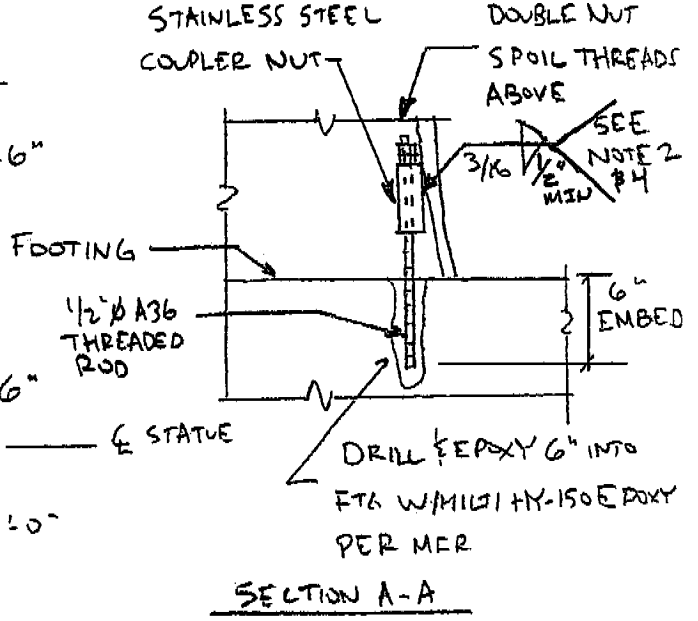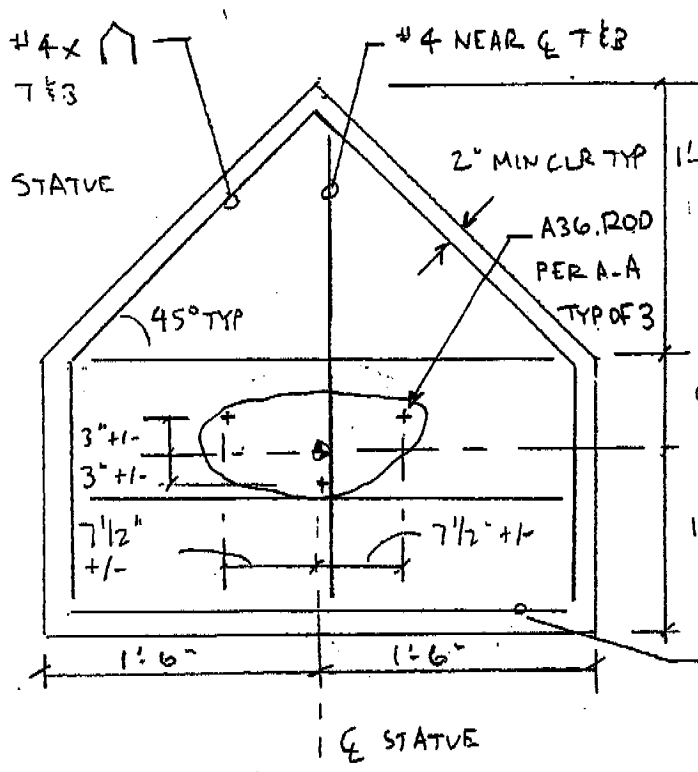

(3) #4 TEB (6 TOTAL), SPACED AS EVENLY AS POSSIBLE WITHIN RECTANGULAR PORTION OF FTG

PLAN

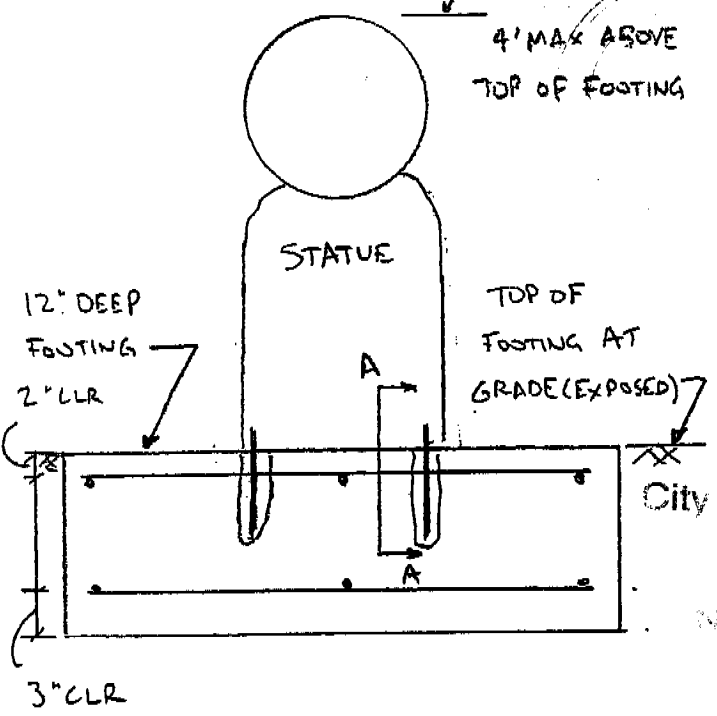


NOTES:

1. CONCRETE STRENGTH TO BE $f'_c = 2500$ psi MIN.
2. FILL IN WELD METAL AS REQUIRED TO ENSURE COUPLER-NUT & ROD ARE VERTICAL.
3. THIS FOOTING AND STATUE ARE TYPICAL OF 5 TOTAL.

4. USE SILICON BRONZE ELECTRODE BY HARRIS WELD CO.
 ISSUED
 City of Sacramento
 OCT 11 2005


NORTH PERMIT CENTER



1 STATUE SUPPORT DETAIL

APPROVED
 City of Sacramento Plan Review
STRUCTURAL

Signature: [Signature] Date: 9/28/05

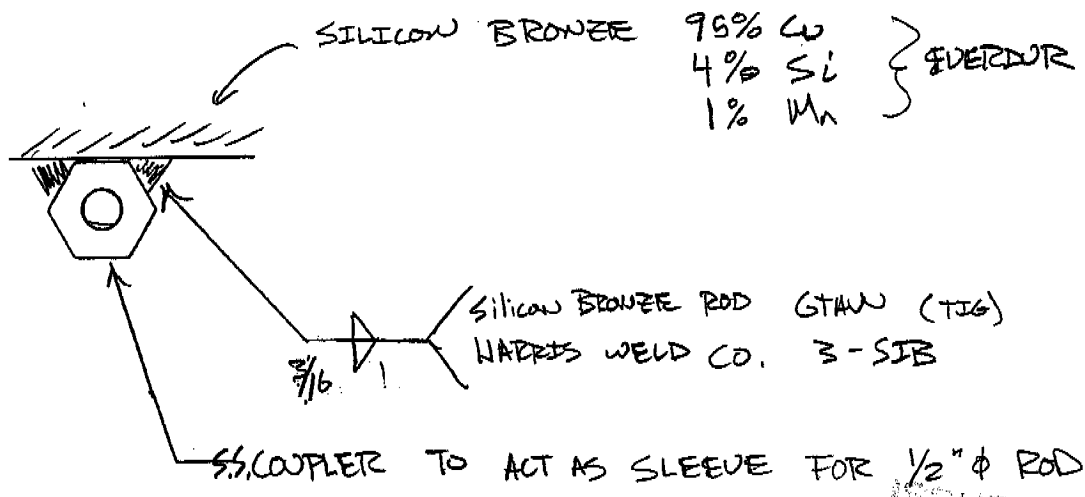


MAX T = 704# / ANCHOR × 1.4 = 986#

ISSUED
 City of Sacramento
 NORTH PERMIT CENTER

$\frac{492\#}{0.707(3/16)} = 3.7 \text{ KSI} \times \frac{1}{1" \text{ LENGTH}} = 124700 \text{ PSI (SILICON BRONZE)}$
 $\sigma_u = 55100 \text{ PSI (SILICON BRONZE)}$
 OK

PROVIDE MIN 1/2" LENGTH OF 3/16" FILLET EACH SIDE OF STAINLESS STEEL COUPLER USING SILICON BRONZE ELECTRODE (3-SIB HARRIS WELD CO.) AND THE GTAW (TIG) PROCESS. SILICON BRONZE ELECTRODE IS WELDABLE & COMPATIBLE w/ STAINLESS STEELS, COPPER & COPPER ALLOYS (SILICON BRONZES).

REVISE DRAWING DTL TO REFLECT:

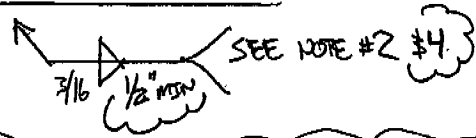

NOTE: #4 USE SILICON BRONZE ELECTRODE BY HARRIS WELD CO.

APPROVED
 City of Sacramento Plan Review
 STRUCTURAL
 Signature _____ Date 9/27/05



STRUCTURAL ENGINEERS INC.

Letter of Transmittal

To: Tony Natsoulas
5212 Meckel Way
Sacramento, CA 95841

Date: June 2, 2005
From: Gary Reynolds
Job No: 05014

CITY OF SACRAMENTO
NORTH PERMIT
CENTER
SEP 1 8 2005
RECEIVED

Re: Little League Statue Supports

- Attached, Under Separate Cover, Please Reply, Via Mail
Shop Drawings, Copy of Letter, RFC, Inspection Report, Prints
Change Order, RFI, Tracings, Calculations, Other

Table with 4 columns: Copies, Date, No., Description. Rows include: 2 copies dated 05/06/05, 1 copy; 2 copies dated 06/01/05, 8 copies. Descriptions: Statue Support Detail - Stamped & Signed, Calculations - Stamped & Signed.

These are transmitted as checked below:

- For Approval, No Exceptions Taken, As Requested, For Review and Comment
For Your Use, Make Corrections Noted, Resubmit, Return, Copies

Remarks:

Tony,

Please let us know if you need anything else. These are for submittal to the City of Sacramento. It has been a pleasure working with you.

Gary

158000
City of Sacramento
SEP 1 2005
NORTH PERMIT
CENTER

STATUE SUPPORTS - LATERAL LOADS

SEISMIC 2001 CBC


Treat as rigid non-building structure

No soils report $\therefore S_D$ profile

$C_a = 0.36 \quad I = 1.0$

$V = 0.7 C_a I W$
 $= 0.7 (0.36) (1.0) W$
 $= 0.252 W$
 $= 0.252 (300) = 76 \text{ k USD}$

$V_{ASD} = 76 / 1.4 = 54 \text{ k ASD}$

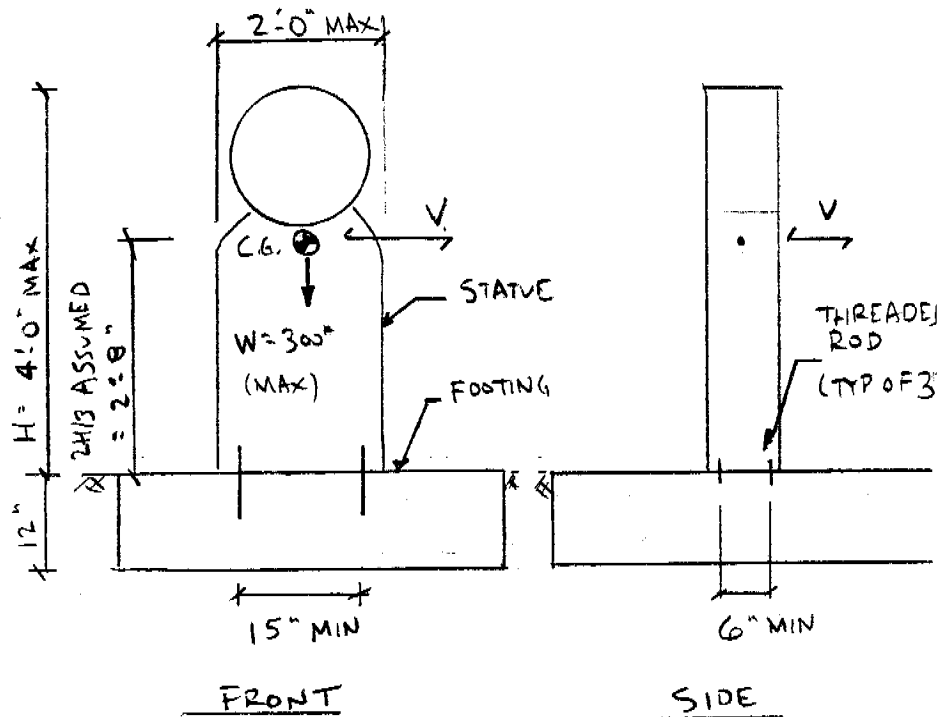

WIND 75mph Exp. C

$P = C_e C_q q_s Z$
 $= 1.06 (1.3) (14.5) (1.0) = 20 \text{ psf}$

Max wind load

$V = 20 \text{ psf} \times 4' \times 2' = 160 \text{ k} > 54 \text{ k}$

\therefore WIND CONTROLS

ISSUED
 City of Sacramento
 300 ...
 NORTH ...
 CENTER

...
 ...
 ...


STATUE SUPPORTS CONT'D

ANCHORAGE TO FOOTING

$OTM = 160(2.67) = 427 \text{ lb-ft}$

$RM(\text{min}) = \frac{2}{3}(300)(0.5) = 75 \text{ lb-ft}$

$T_{\text{net}} = \frac{427-75}{0.5} = 704 \text{#/anchor (max)}$



PLAN

Try $\frac{1}{2}$ " ϕ A36 rod w/HILTI HY-150 epoxy, drilled 6" into footing

Per attached ICBO report w/6" embedment, min edge distance = $\frac{9.5}{3} = 3.17"$

Use footing with min edge distance $\geq 6"$ use 0.6 reduction factor

Min spacing $> 6"$ (actual)

Min allowed = $0.25(1275) = 3.2"$ Use 0.7 reduction factor

$\therefore T_{\text{allowable}} = 4035 * (0.6)(0.7) = 1695 \text{#/anchor} > 704 \text{# actual/anchor}$

USE (3) $\frac{1}{2}$ " ϕ A36 RODS DRILLED
 6 $\frac{1}{2}$ " INTO CONCRETE W/HILTI HY-150 EPOXY

APPROVED
 City of Sacramento
 MAY 11 2005
 NORTH PLACENTIA
 CALIFORNIA

on permission
 Division.
 this plan and
 to permit or
 City Ordinance or

STATUE SUPPORTS CONT'D

FOOTING DESIGN


Top of footing exposed (at grade) per client request

$$q(\text{concrete}) - q(\text{soil}) = 150 \text{ pcf} - 110 \text{ pcf} = 40 \text{ pcf net ftg wt}$$

$$\therefore P = 300^{\#} + 40 V_{\text{ftg}} \quad \text{where } V_{\text{ftg}} = \text{ftg volume} = A_{\text{ftg}} \times 1' = A_{\text{ftg}}$$

$$\text{Soil Pressure} = \frac{300 + 40 A_{\text{ftg}}}{A_{\text{ftg}}} = \frac{300}{A_{\text{ftg}}} + 40 = 1000 \quad A_{\text{ftg}} = 3.2 \text{ ft}^2$$

Try "home plate" shape per client request

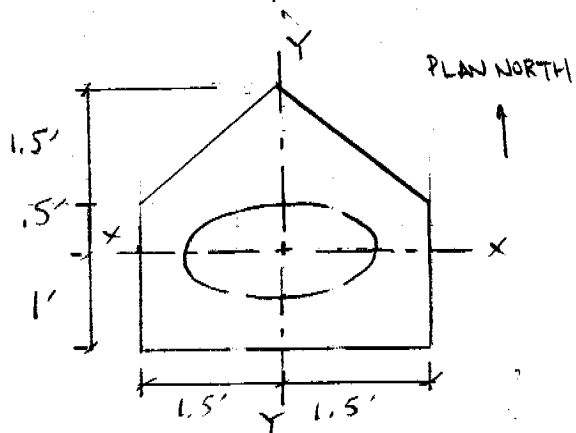

$$\text{Ftg Area} = 6.75 \text{ ft}^2$$

$$\text{Ftg wt} = 1013^{\#}$$

SOIL PRESSURE CHECKS

Applied loads: $P = 300^{\#}$ (Statue wt) $M = 1600 \times 2.67' = 0.43 \text{ K-ft}$ $V = 160^{\#}$

Check about Y-axis ignoring triangular part of footing i.e. use 3' x 1.5' rect. ftg

Per attached ENERCALC output, max soil pressure $q_{\text{max}} = 484 \text{ psf} < 1333 \text{ psf}$ OK

Check about X-axis moment away from triangular part of footing, again ignoring triangular part.

$$q_{\text{max}} = 977 \text{ psf} < 1333 \text{ psf}$$
 OK see ENERCALC output

Soil pressure for moment about X-axis toward triangular tip difficult to calculate, but $I_x = 3.46 \text{ ft}^4$ \bar{y} (from bottom) = 1.17' $S_{\text{top}} = 3.46 / (3 - 1.17) = 1.89 \text{ ft}^3$

$$\text{Approximate } \frac{P}{A} + \frac{M}{S_{\text{top}}} = \frac{1313}{6.75} + \frac{587}{1.89} = 505 \text{ psf} < \text{can allow } 2\frac{1}{2} \text{ times this}$$
 OK

\therefore SOIL PRESSURES OK

FOOTING - OVERTURNING

About Y-axis: $M_o = 587$ $M_R = (300 + 675)(1.5) = 1463$

$$\frac{M_R}{M_o} = 2.49 > 1.5 \text{ OK}$$

About X-axis: $M_o = 587$

Moment Away from Triangle: $M_R = 300(1) + 4.5(150)(1.75) + 2.25(150)(2.5) = 1650$

$$\frac{M_R}{M_o} = 2.81 \text{ OK}$$

Moment Towards Triangle: $M_R = 300(2) + 4.5(150)(2.25) + 2.25(150)(1) = 2456$

$$\frac{M_o}{M_R} = 4.18 \text{ OK}$$

City of Sacramento
 351
 NORTH
 must be
 the
 the

SLIDING Use 130psf allowable (min per code)

$V = 160^k$ $V_{all} = 130(6.75) = 878^k > 160^k \text{ OK}$

REINFORCING



$M_{max} = 977 \text{ ft-k}$ conservatively say uniform over 1.5', 3' wide

$\therefore M_u = 3(977)(1.5)^2/2 = 3.3 \text{ k-ft}$ $d = 8.5''$


$A_s \text{ reqd} = \frac{M_u}{4d} = \frac{3.3}{4(8.5)} = 0.097 \text{ in}^2$ say $1001 = \rho$

$A_s = .0018(36)(12) = 0.78 \text{ in}^2$ use 3 #4 ea way min T&B $A_s = 1.2 \text{ in}^2$

USE 3'x3'x12" "HOME PLATE"
W/13) 4 T&B EA WAY

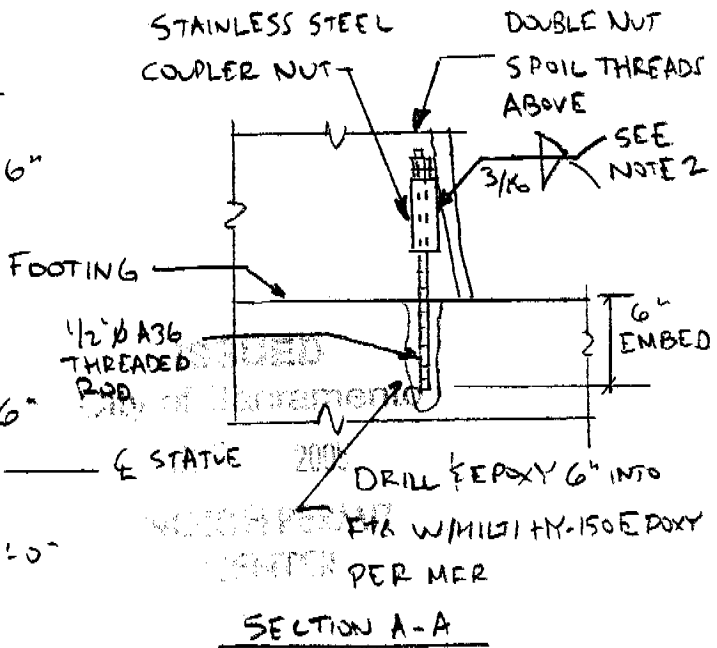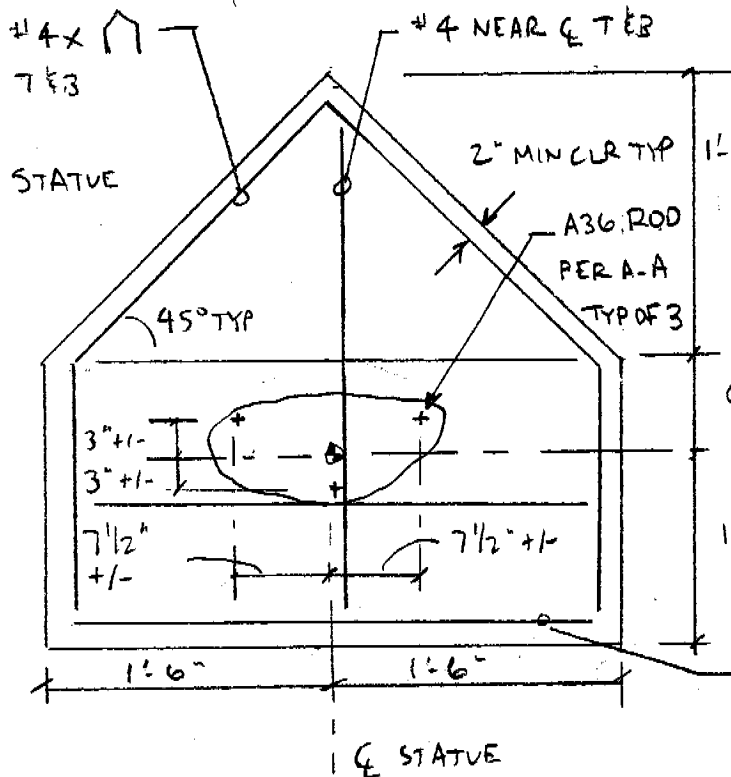

(3) #4 T&B (6 TOTAL), SPACED AS EVENLY AS POSSIBLE WITHIN RECTANGULAR PORTION OF FTG.

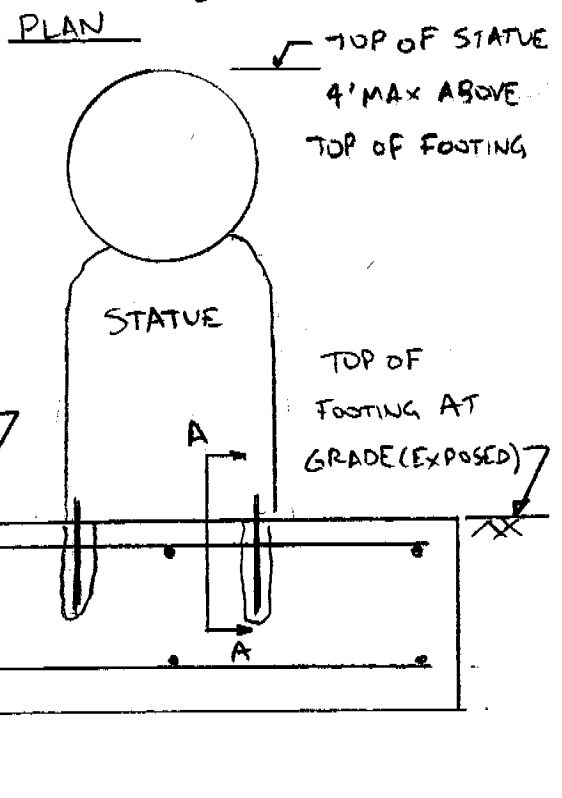

NOTES:

1. CONCRETE STRENGTH TO BE $f'_c = 2500 \text{ psi MIN.}$
2. FILL IN WELD METAL AS REQUIRED TO ENSURE COUPLER-NUT & ROD ARE VERTICAL.
3. THIS FOOTING AND STATUE ARE TYPICAL OF 5 TOTAL.

1 STATUE SUPPORT DETAIL
 1" = 1'-0"



[Handwritten Signature]



STRUCTURAL ENGINEERS INC.

CYS & Associates
1760 Creekside Drive Suite 280
Sacramento, CA 95833

Title : Little League Statue Supports
Dsgnr: GMR
Description :

Job # 05014
Date: 7:26AM, 1 JUN 05

Scope :

Rev: 580001
User: KW-0602490, Ver 5.8.0, 1-Dec-2003
(c)1983-2003 ENERCALC Engineering Software

General Footing Analysis & Design

Page 1
fig.ecw:Calculations

Description Statue Support Footing - Wind about Short Direction Axis (Y-Axis)

General Information

Code Ref: ACI 318-02, 1997 UBC, 2003 IBC, 2003 NFPA 5000

Allowable Soil Bearing	1,000.0 psf	Dimensions...	
Short Term Increase	1.330	Width along X-X Axis	1.500 ft
Seismic Zone	3	Length along Y-Y Axis	3.000 ft
Live & Short NOT Combined		Footing Thickness	12.00 in
fc	2,500.0 psi	Col Dim. Along X-X Axis	0.00 in
Fy	60,000.0 psi	Col Dim. Along Y-Y Axis	0.00 in
Concrete Weight	150.00 pcf	Base Pedestal Height	0.000 in
Overburden Weight	0.00 psf	Min Steel %	0.0014
		Rebar Center To Edge Distance	3.50 in

Loads

Applied Vertical Load...			
Dead Load	0.300 k	...ecc along X-X Axis	0.000 in
Live Load	k	...ecc along Y-Y Axis	0.000 in
Short Term Load	k		
Applied Moments...		Creates Rotation about Y-Y Axis (pressures @ left & right)	Creates Rotation about X-X Axis (pressures @ top & bot)
Dead Load	k-ft		k-ft
Live Load	k-ft		k-ft
Short Term	k-ft		0.430 k-ft
Applied Shears...		Creates Rotation about Y-Y Axis (pressures @ left & right)	Creates Rotation about X-X Axis (pressures @ top & bot)
Dead Load	k		0.160 k
Live Load	k		k
Short Term	k		k

Summary

Caution: Y(short)ecc>Widht

1.50ft x 3.00ft Footing, 12.0in Thick, w/ Column Support 0.00 x 0.00in x 0.0in high

	<u>DL+LL</u>	<u>DL+LL+ST</u>		<u>Actual</u>	<u>Allowable</u>
Max Soil Pressure	287.8	484.2 psf	Max Mu	0.391 k-ft per ft	
Allowable	1,000.0	1,330.0 psf	Required Steel Area		0.259 in2 per ft
"X" Ecc. of Resultant	0.000 in	0.000 in	Shear Stresses....	<u>Vu</u>	<u>Vn * Phi</u>
"Y" Ecc. of Resultant	1.969 in	7.262 in	1-Way	2.881	85.000 psi
X-X Min. Stability Ratio	2.480	1.500 :1	2-Way	1.326	170.000 psi
Y-Y Min. Stability Ratio	No Overturning				

Footing Design

Shear Forces	<u>ACI C-1</u>	<u>ACI C-2</u>	<u>ACI C-3</u>	<u>Vn * Phi</u>	
Two-Way Shear	1.30 psi	1.33 psi	0.85 psi	170.00 psi	
One-Way Shears...					
Vu @ Left	0.02 psi	0.02 psi	0.01 psi	85.00 psi	
Vu @ Right	0.02 psi	0.02 psi	0.01 psi	85.00 psi	
Vu @ Top	1.29 psi	2.88 psi	1.85 psi	85.00 psi	
Vu @ Bottom	0.13 psi	-1.38 psi	-0.89 psi	85.00 psi	
Moments	<u>ACI C-1</u>	<u>ACI C-2</u>	<u>ACI C-3</u>	<u>Ru / Phi</u>	<u>As Req'd</u>
Mu @ Left	0.03 k-ft	0.03 k-ft	0.02 k-ft	0.4 psi	0.26 in2 per ft
Mu @ Right	0.03 k-ft	0.03 k-ft	0.02 k-ft	0.4 psi	0.26 in2 per ft
Mu @ Top	0.18 k-ft	0.39 k-ft	0.25 k-ft	6.0 psi	0.26 in2 per ft
Mu @ Bottom	0.03 k-ft	-0.17 k-ft	-0.11 k-ft	2.6 psi	-0.26 in2 per ft



STRUCTURAL ENGINEERS INC.

CYS & Associates
1760 Creekside Drive Suite 280
Sacramento, CA 95833

Title : Little League Statue Supports
Dsgnr: GMR
Description :

Job # 05014
Date: 7:26AM, 1 JUN 05

6

Scope :

Rev: 580001
User: KW-0602490, Ver 5.8.0, 1-Dec-2003
(c)1983-2003 ENERCALC Engineering Software

General Footing Analysis & Design

Page 2
fig.ecw:Calculations

Description Statue Support Footing - Wind about Short Direction Axis (Y-Axis)

Soil Pressure Summary

Service Load Soil Pressures	Left	Right	Top	Bottom
DL + LL	216.67	216.67	287.78	145.56 psf
DL + LL + ST	216.67	216.67	484.24	0.00 psf
Factored Load Soil Pressures				
ACI Eq. C-1	303.33	303.33	402.89	203.78 psf
ACI Eq. C-2	303.33	303.33	677.94	0.00 psf
ACI Eq. C-3	195.00	195.00	435.82	0.00 psf

ACI Factors (per ACI 318-02, applied internally to entered loads)

ACI C-1 & C-2 DL	1.400	ACI C-2 Group Factor	0.750	Add'l "1.4" Factor for Seismic	1.400
ACI C-1 & C-2 LL	1.700	ACI C-3 Dead Load Factor	0.900	Add'l "0.9" Factor for Seismic	0.900
ACI C-1 & C-2 ST	1.700	ACI C-3 Short Term Factor	1.300		
....seismic = ST * :	1.100	Used in ACI C-2 & C-3			

ISSUED
City of Sacramento
JUN 1 2005
NORTH PERMIT
CENTER

Specification
to approve the
for State Law.



STRUCTURAL ENGINEERS INC.

CYS & Associates
1760 Creekside Drive Suite 280
Sacramento, CA 95833

Title : Little League Statue Supports
Dsgnr: GMR
Description :

Job # 05014
Date: 7:54AM, 1 JUN 05

Scope :

Rev: 580001
User: KW-0602490, Ver 5.8.0, 1-Dec-2003
(c)1983-2003 ENERCALC Engineering Software

General Footing Analysis & Design

Page 1
fig.ecw:Calculations

Description Statue Support Footing- Wind about Long Direction Axis (X-axis) away from triangular part of footing

General Information Code Ref: ACI 318-02, 1997 UBC, 2003 IBC, 2003 NFPA 5000

Allowable Soil Bearing	1,000.0 psf	Dimensions...	
Short Term Increase	1.330	Width along X-X Axis	3.000 ft
Seismic Zone	3	Length along Y-Y Axis	1.500 ft
Live & Short NOT Combined		Footing Thickness	12.00 in
fc	3,000.0 psi	Col Dim. Along X-X Axis	12.00 in
Fy	60,000.0 psi	Col Dim. Along Y-Y Axis	24.00 in
Concrete Weight	150.00 pcf	Base Pedestal Height	0.000 in
Overburden Weight	0.00 psf	Min Steel %	0.0014
		Rebar Center To Edge Distance	3.50 in

Loads

Applied Vertical Load...			
Dead Load	0.300 k	...ecc along X-X Axis	0.000 in
Live Load	k	...ecc along Y-Y Axis	3.000 in
Short Term Load	k		
Applied Moments...		<u>Creates Rotation about Y-Y Axis</u> (pressures @ left & right)	<u>Creates Rotation about X-X Axis</u> (pressures @ top & bot)
Dead Load	k-ft		k-ft
Live Load	k-ft		k-ft
Short Term	k-ft		-0.430 k-ft
Applied Shears...		<u>Creates Rotation about Y-Y Axis</u> (pressures @ left & right)	<u>Creates Rotation about X-X Axis</u> (pressures @ top & bot)
Dead Load	k		k
Live Load	k		k
Short Term	k		-0.160 k

SEE HAND
CALL PG. 4

Summary

Warning: OTM Ratio < 1.5

3.00ft x 1.50ft Footing, 12.0in Thick, w/ Column Support 12.00 x 24.00in x 0.0in high

	DL+LL	DL+LL+ST	Actual	Allowable
Max Soil Pressure	283.3	976.9 psf	0.047 k-ft per ft	
Allowable	1,000.0	1,330.0 psf		0.259 in2 per ft
"X" Ecc. of Resultant	0.000 in	0.000 in		
"Y" Ecc. of Resultant	0.923 in	6.338 in		
X-X Min. Stability Ratio	1.367	1.500 :1		
Y-Y Min. Stability Ratio	No Overturning			
Max Mu				
Required Steel Area				
Shear Stresses....			<u>Vu</u>	<u>Vn * Phi</u>
1-Way			0.249	93.113 psi
2-Way			0.692	186.226 psi

Footing Design

Shear Forces	ACI C-1	ACI C-2	ACI C-3	Vn * Phi	
Two-Way Shear	0.20 psi	0.69 psi	0.45 psi	186.23 psi	
One-Way Shears...					
Vu @ Left	0.25 psi	0.25 psi	0.16 psi	93.11 psi	
Vu @ Right	0.25 psi	0.25 psi	0.16 psi	93.11 psi	
Vu @ Top	0.00 psi	0.00 psi	0.00 psi	93.11 psi	
Vu @ Bottom	0.00 psi	0.00 psi	0.00 psi	93.11 psi	
Moments	ACI C-1	ACI C-2	ACI C-3	Ru / Phi	As Req'd
Mu @ Left	0.05 k-ft	0.05 k-ft	0.03 k-ft	0.7 psi	0.26 in2 per ft
Mu @ Right	0.05 k-ft	0.05 k-ft	0.03 k-ft	0.7 psi	0.26 in2 per ft
Mu @ Top	0.00 k-ft	0.00 k-ft	0.00 k-ft	0.0 psi	0.02 in2 per ft
Mu @ Bottom	0.00 k-ft	0.00 k-ft	0.00 k-ft	0.0 psi	0.02 in2 per ft



CITY OF SACRAMENTO

www.cityofsacramento.org
Help Line: 1-916-808-5656 OR 1-866-EZ-PERMIT
Inspection: 1-916-808-7622

Downtown Permit Center
1231 I Street, Suite 200
Sacramento, CA 95814

North Permit Center
2101 Arena Blvd., Suite 200
Sacramento, CA 95834

OWNER BUILDER VERIFICATION

1. Check one below - I or my immediate family (parent, spouse, or child) will perform:

- A - [] all the work authorized by this permit.
B - [] a portion of the work.
C - [X] none of the work.

If B or C is checked, complete 2 or 3 below.

2. A State licensed contractor (*) will be hired to do:

- [X] all of the authorized work. [] a portion of the authorized work.

Name JOE VON ARX Phone 487 4436
Address 2731 ECHO WAY SACRAMENTO 95821
Type of Work PUBLIC ART INSTALLATION

Name Phone
Address
Type of Work

Name Phone
Address
Type of Work

Name Phone
Address
Type of Work

3. [] I will utilize unlicensed person(s) other than my immediate family to perform all or portions of the authorized work. A Certificate of Workers Compensation must be on file at this office.

I declare under penalty of perjury that the above is true and correct. I have read and understand the owner-builder information on the reverse side of this form.

Signed: Property Owner ANN MOZZOLA (Printed name) APP SPECIALIST (Signature)
Date 10-11-05 Case No. Permit No. 0514371
Job Address 3501 59TH ST SACRAMENTO

Note: * Information regarding unknown contractors or change in subcontractors shall be submitted to the Building Inspection field office.