

CITY OF SACRAMENTO
1231 I Street, Sacramento, CA 95814

Permit No: 9907675
Insp Area: 2

Site Address: 1406 ROBERTSON WY SAC
Parcel No: 012-0212-018

Sub-Type: RES
Housing (Y/N): N

CONTRACTOR
ZIMMERMAN ROOFING
3560 RAMONA AV
SACRAMENTO CA 95826

OWNER
FONG SUSAN H
1406 ROBERTSON WY
SACRAMENTO CA 95818

ARCHITECT

Nature of Work: TEAR OFF & REROOF W/ PIONEER TILE

CONSTRUCTION LENDING AGENCY: I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C9 License Number 557959 Date 7-16-99 Contractor Signature Billy Coy

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00):

____ I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

____ I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

____ I am exempt under Sec. _____ B & PC for this reason: _____

Date _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 7-16-99 Applicant/Agent Signature Billy Coy

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

____ I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier STATE COMP INS FUND Policy Number 713-98-2021 Exp Date 10/01/1999

____ (This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 7-16-99 Applicant Signature Billy Coy

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.



DEPARTMENT OF
PLANNING AND DEVELOPMENT

CITY OF SACRAMENTO
CALIFORNIA

1231 I STREET
ROOM 200
SACRAMENTO, CA
95814-2998

Susan Fong
1406 Robertson Way
Sacramento, CA 95818

Permit Service
916-264-7619
FAX 916-264-7016

TILE ROOF WORKSHEET

This worksheet must be filled out whenever any type of tile roof is applied for.

If the answer to question #5 is yes, a written engineering report from a registered engineer must be provided with each application.

1. BRAND AND MODEL OF TILE Pioneer Hacienda tile
2. TILE WEIGHT PER SQUARE 730
3. WEIGHT OF ROOF SYSTEM PER SQUARE 760
4. TOTAL WEIGHT OF ROOF SYSTEM 760
5. DOES TOTAL WEIGHT OF ROOF SYSTEM EXCEED 750# PER SQUARE? YES NO
6. ROOF SLOPE: 4/12 + 8/12

PLEASE PROVIDE A SEPARATE WORKSHEET FOR EACH APPLICATION INVOLVING A TILE ROOF


FONG

Paul Zacher – Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.3960

July 1, 1999

Zimmerman Roofing
3560 Ramona Avenue
Sacramento, CA 95826
TEL: 916.454.3667
FAX: 916.455.3784
TEL (Jeff): 916.392.1971
FAX (Jeff): 916.392.6853
FAX (Framer) : 916.383.5308

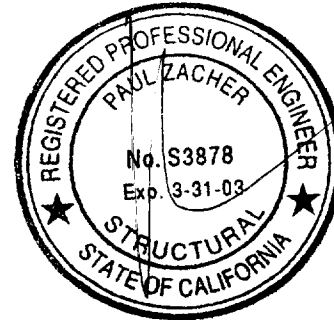

Attn.: Mr. Jeff Tucker,

re: Job 99152: FONG

Subject: Structural Investigation Report of the Roof for the Residence located at 1406 Robertson Way, Sacramento, CA 95818.

As requested by Mr. Jeff Tucker, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site July 1, 1999. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report is based on the 1994 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence.
Year Built: Estimated 1950's vintage.
Occupancy: Residential.
No of Stories: One.
Dimensions: Approximately 1500 square feet with a first story plate height of 8 feet.

CONSTRUCTION:

Roof:
The roof covering will consist of Pioneer Light Weight Concrete Tile over 1/2" solid sheathing. The living area is conventionally framed with 2x6 rafters spaced at 24" on center with 2x6 purlins supported at no more than 8'-0" on center by 2x4 struts bearing on walls below. The garage area is framed with 2x4 rafters spaced at 24" on center and 2x4 cross ties spaced at 4'-0" on center.

CONCLUSIONS:

Roof:
The living and garage areas lack sufficient structural capacity for the applied live and dead loads.

*1/6 Repairs req'd per this
engineering report
matt P. 7/13/99*

FONG

Paul Zacher – Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.3960

RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.

Living Area:

- 1. Provide additional 2x4 struts from the existing purlins to the bearing walls below. The maximum spacing between the new and existing struts shall not exceed 4'-0" on center and the minimum slope of the struts shall not be less than 45 degrees from the horizontal. See detail 1.

Garage:

- 2. Scab a 2x4 rafter to the existing 2x4 rafters with 16d's @ 12" on center where the span is greater than 7'-3". See detail 2.


It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls which are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects which are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,



Paul Zacher, P.E., S.E.
file

Description RAFTERS AND BEAMS

Timber Member Information

Calculations are designed to 1997 NDS and 1997 UBC Requirements

		rafter 2x4	rafter w/ scab 2-2x4	porch 4x8
Timber Section				
Beam Width	in	1.500	3.000	3.500
Beam Depth	in	3.500	3.500	7.250
Le: Unbraced Length	ft	2.00	2.00	0.00
Timber Grade		Douglas Fir - Larch	Douglas Fir - Larch	Douglas Fir - Larch
Fb - Basic Allow	psi	875.0	875.0	875.0
Fv - Basic Allow	psi	95.0	95.0	95.0
Elastic Modulus	ksi	1,600.0	1,600.0	1,600.0
Load Duration Factor		1.250	1.250	1.250
Member Type		Sawn	Sawn	Sawn
Repetitive Status		Repetitive	Repetitive	No

Center Span Data

		7.25	9.25	14.00
Span	ft			
Dead Load	#/ft	30.80	30.80	62.00
Live Load	#/ft	32.00	32.00	64.00

Results Ratio = 0.8679 0.6994 0.9205


Mmax @ Center	in-k	4.95	8.06	37.04
@ X =	ft	3.62	4.62	7.00
fb: Actual	psi	1,616.8	1,315.9	1,208.2
Fb: Allowable	psi	1,862.8	1,881.6	1,312.5
		Bending OK	Bending OK	Bending OK
fv: Actual	psi	59.8	39.2	48.0
Fv: Allowable	psi	118.8	118.8	118.8
		Shear OK	Shear OK	Shear OK

Reactions

@ Left End	DL	lbs	111.65	142.45	434.00
	LL	lbs	116.00	148.00	448.00
	Max. DL+LL	lbs	227.65	290.45	882.00
@ Right End	DL	lbs	111.65	142.45	434.00
	LL	lbs	116.00	148.00	448.00
	Max. DL+LL	lbs	227.65	290.45	882.00

Deflections

Center DL Defl	in	-0.223	-0.296	-0.301
L/Defl Ratio		389.7	375.2	557.5
Center LL Defl	in	-0.232	-0.307	-0.311
L/Defl Ratio		375.0	361.2	540.1
Center Total Defl	in	-0.455	-0.603	-0.612
Location	ft	3.625	4.625	7.000
L/Defl Ratio		191.1	184.0	274.3

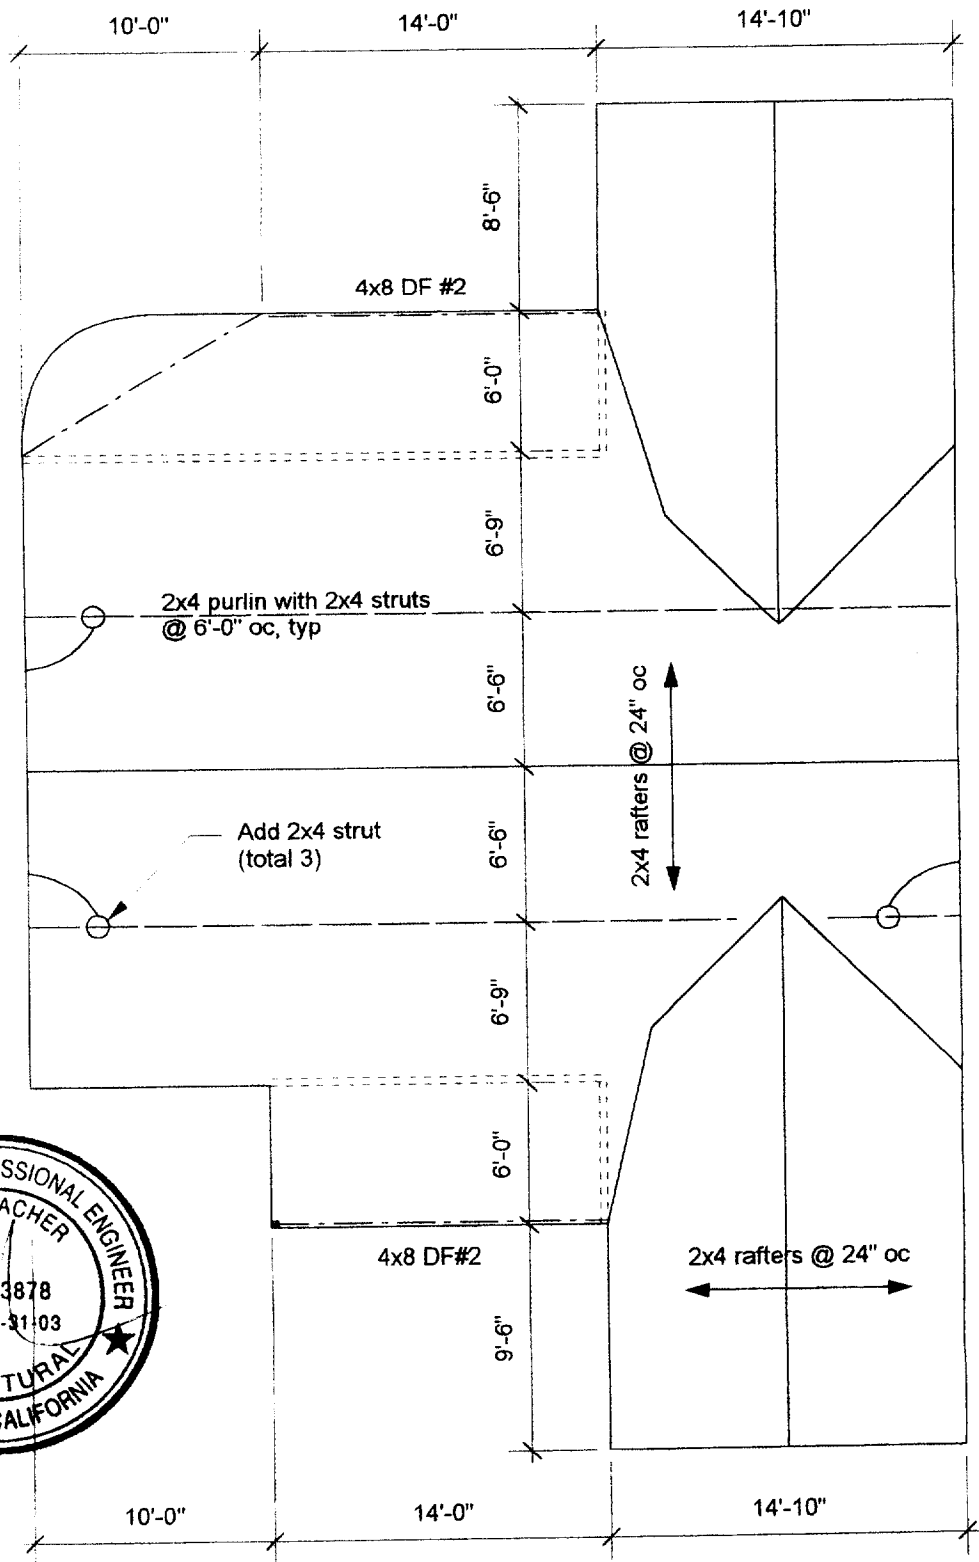

Notes:



1. This is a reroof project. The new roofing material shall be a Pioneer Light Weight Concrete Tile.
2. All rafters are 2x4 DF#2 and hips and valleys are 2x6 DF#2 unless otherwise noted.
3. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2326.12 "Roof and Ceiling Framing" unless otherwise shown.

1

ROOF PLAN - FONG

Not to Scale

5

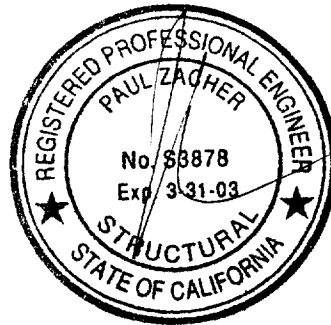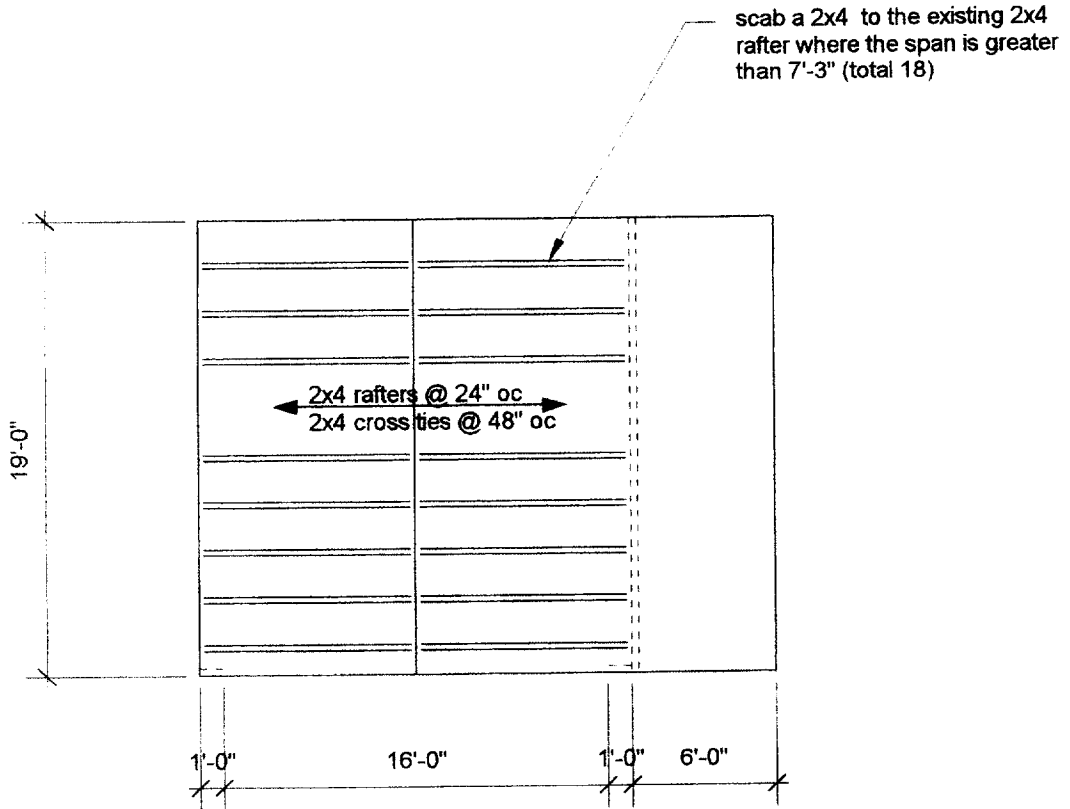

Notes:

1. This is a reroof project. The new roofing material shall be a Pioneer Light Weight Concrete Tile.
2. All rafters are 2x4 DF#2 and hips and valleys are 2x6 DF#2 unless otherwise noted.
3. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2326.12 "Roof and Ceiling Framing" unless otherwise shown.

2

GARAGE ROOF PLAN - FONG

Not to Scale

6



5

Not to Scale



ROOF PLAN - FONG

- Notes:
1. This is a reroof project. The new roofing material shall be a Pioneer Light Weight Concrete Tile.
 2. All rafters are 2x4 DF#2 and hips and valleys are 2x6 DF#2 unless otherwise noted.
 3. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2326.12 "Roof and Ceiling Framing" unless otherwise shown.

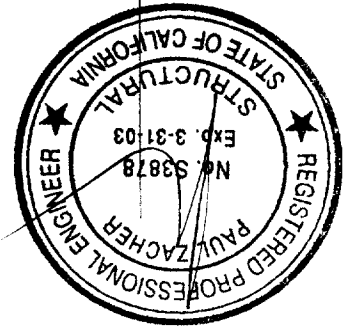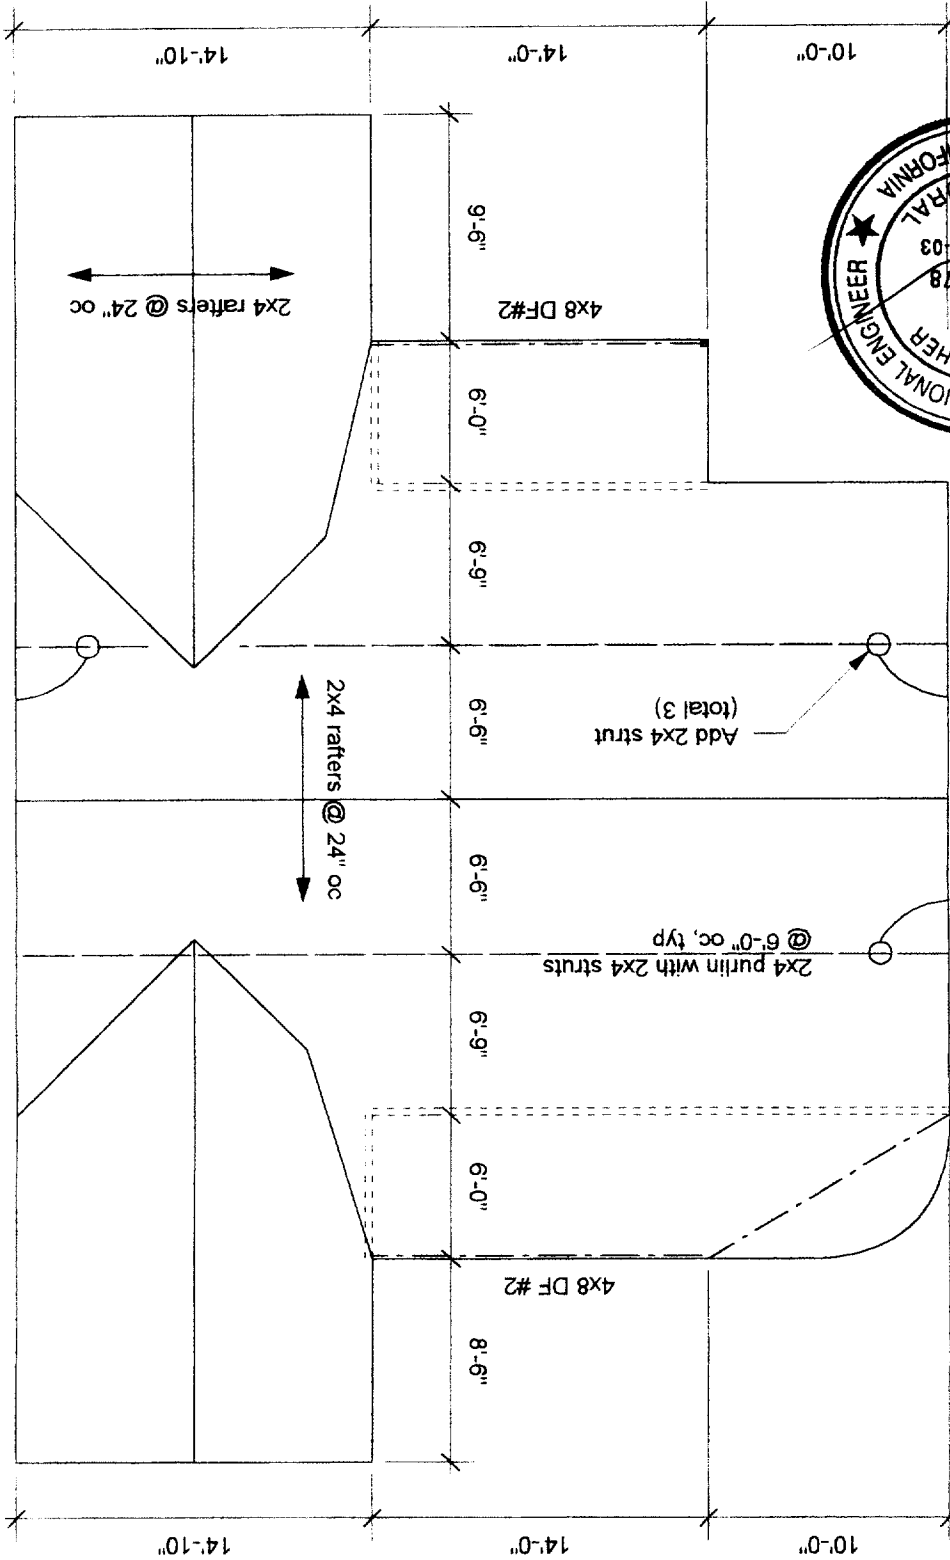

NOTHING TO BE OPEN FOR THE SEPARATE AND SEPARATE

Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

FONG

TEL: 916.961.3960
FAX: 916.961.3960

July 1, 1999

Zimmerman Roofing
3560 Ramona Avenue
Sacramento, CA 95826
TEL: 916.454.3667
FAX: 916.455.3784
TEL (Jeff): 916.392.1971
FAX (Jeff): 916.392.6853
FAX (Framer): 916.383.5308

Attn: Mr. Jeff Tucker,
re: Job 99152: FONG

Subject: Structural Investigation Report of the Roof for the Residence located at 1406 Robertson Way, Sacramento, CA 95818.

As requested by Mr. Jeff Tucker, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site July 1, 1999. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report is based on the 1994 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence.
Year Built: Estimated 1950's vintage.
Occupancy: Residential.
No. of Stories: One.
Dimensions: Approximately 1500 square feet with a first story plate height of 8 feet.

CONSTRUCTION:

Roof: The roof covering will consist of Pioneer Light Weight Concrete Tile over 1/2" solid sheathing. The living area is conventionally framed with 2x6 rafters spaced at 24" on center with 2x6 purlins supported at no more than 8'-0" on center by 2x4 struts bearing on walls below. The garage area is framed with 2x4 rafters spaced at 24" on center and 2x4 cross ties spaced at 4'-0" on center.

CONCLUSIONS:

Roof: The living and garage areas lack sufficient structural capacity for the applied live and dead loads.

*Repairs req'd per this
1/6 engineering report
dated 7/13/99*



FONG


Paul Zacher – Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.3960


RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.

Living Area:

- 
1. Provide additional 2x4 struts from the existing purlins to the bearing walls below. The maximum spacing between the new and existing struts shall not exceed 4'-0" on center and the minimum slope of the struts shall not be less than 45 degrees from the horizontal. See detail 1.

Garage:

- 
2. Scab a 2x4 rafter to the existing 2x4 rafters with 16d's @ 12" on center where the span is greater than 7'-3". See detail 2.


It shall be noted that small hairline cracking may occur at exterior stucco and interior gyboard finished walls which are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects which are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,



Paul Zacher, P.E., S.E.
file

DESIGN LOADING:

Roof Pitch	12	in 12
Pitch Adjustment Factor	1.41	

LOCATION: ROOF

<u>MATERIAL</u>	<u>WEIGHT</u>	
Pioneer Light Weight Tile	7.00	psf
Roofing felt	0.30	psf
1x4 skip sht'g	1.09	psf
1/2" OSB/ plywood	1.50	psf
2x6 rafters @ 24" oc	<u>1.00</u>	psf
	Load	10.9 psf
	Roof Pitch Adjustment	<u>4.51</u> psf
	Total Load	15.4 psf

Description RAFTERS AND BEAMS

Timber Member Information

Calculations are designed to 1997 NDS and 1997 UBC Requirements

		rafter	rafter w/ scab	porch
Timber Section		2x4	2-2x4	4x8
Beam Width	in	1.500	3.000	3.500
Beam Depth	in	3.500	3.500	7.250
Le: Unbraced Length	ft	2.00	2.00	0.00
Timber Grade		Douglas Fir - Larch	Douglas Fir - Larch	Douglas Fir - Larch
Fb - Basic Allow	psi	875.0	875.0	875.0
Fv - Basic Allow	psi	95.0	95.0	95.0
Elastic Modulus	ksi	1,600.0	1,600.0	1,600.0
Load Duration Factor		1.250	1.250	1.250
Member Type		Sawn	Sawn	Sawn
Repetitive Status		Repetitive	Repetitive	No

Center Span Data

		rafter	rafter w/ scab	porch
Span	ft	7.25	9.25	14.00
Dead Load	#/ft	30.80	30.80	62.00
Live Load	#/ft	32.00	32.00	64.00

Results

	Ratio =	rafter	rafter w/ scab	porch
Mmax @ Center		4.95	8.06	37.04
@ X =		3.62	4.62	7.00
fb . Actual	psi	1,616.8	1,315.9	1,208.2
Fb . Allowable	psi	1,862.8	1,881.6	1,312.5
		Bending OK	Bending OK	Bending OK
fv . Actual	psi	59.8	39.2	48.0
Fv . Allowable	psi	118.8	118.8	118.8
		Shear OK	Shear OK	Shear OK

Reactions

@ Left End	DL	lbs	111.65	142.45	434.00
	LL	lbs	116.00	148.00	448.00
	Max. DL+LL	lbs	227.65	290.45	882.00
@ Right End	DL	lbs	111.65	142.45	434.00
	LL	lbs	116.00	148.00	448.00
	Max. DL+LL	lbs	227.65	290.45	882.00

Deflections

Center DL Defl	in	-0.223	-0.296	-0.301
L/Defl Ratio		389.7	375.2	557.5
Center LL Defl	in	-0.232	-0.307	-0.311
L/Defl Ratio		375.0	361.2	540.1
Center Total Defl	in	-0.455	-0.603	-0.612
Location	ft	3.625	4.625	7.000
L/Defl Ratio		191.1	184.0	274.3