

CITY OF SACRAMENTO
1231 I Street, Sacramento, CA 95814

Permit No: 0010348
Insp Area: 2

Site Address: 7338 RIVER PLACE WY SAC
Parcel No: 031-0470-013

Sub-Type: RES
Housing (Y/N): N

CONTRACTOR
ZIMMERMAN ROOFING
3675 R S I
SACRAMENTO CA 95816

OWNER
ORDIZ BENNY E/WILMA YEE
7338 RIVER PLACE WY
SACRAMENTO CA 95831

ARCHITECT

Nature of Work: REROOF / TILE

CONSTRUCTION LENDING AGENCY : I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C-39 License Number 557559 Date 9/5/00 Contractor Signature Billy Coy

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors license Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

____ I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code. The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

____ I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code. The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law.)

____ I am exempt under Sec. _____ B & PC for this reason: _____

Date _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the above mentioned property for inspection purposes.

Date 9/5/00 Applicant/Agent Signature Billy Coy

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

____ I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:


Carrier STATE COMP INS FUND Policy Number 713-99-2021 Exp Date 10/01/2000

____ This section need not be completed if the permit is for \$100 or less. I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 9/5/00 Applicant Signature Billy Coy

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.



The set of plans and specifications must be...

DEPARTMENT OF PLANNING AND DEVELOPMENT

CITY OF SACRAMENTO CALIFORNIA

1231 I STREET ROOM 200 SACRAMENTO, CA 95814-1971

Benny Ordiz 7338 River Place Wj Sacto., CA. 95831

Permit Services 916-264-7017 FAX 916-264-7040

TILE ROOF WORKSHEET

This worksheet must be filled out whenever any type of tile roof is applied for.

If the answer to question #5 is yes, a written engineering report from a registered engineer must be provided with each application.

BRAND AND MODEL OF TILE Maier Lite weight

TILE WEIGHT PER SQUARE 730 lbs

HEIGHT OF ROOF SYSTEM PER SQUARE 180 lbs

TOTAL WEIGHT OF ROOF SYSTEM 910 lbs

DOES TOTAL WEIGHT OF ROOF SYSTEM EXCEED 750# PER SQUARE? YES NO

ROOF SLOPE 4/12

PLEASE PROVIDE A SEPARATE WORKSHEET FOR EACH APPLICATION INVOLVING A TILE ROOF

All attached engin. report


Ordiz

Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

August 30, 2000

Zimmerman Roofing
3675 R Street
Sacramento, CA 95816
TEL: 916.454.3667
FAX: 916.455.3784

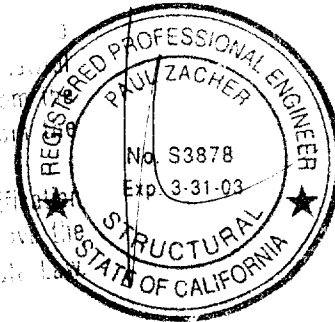

Attn: Mr. Jeff Tucker,

re Job 2000_282: ORDIZ

Subject: Structural Investigation Report of the Roof for the Residence located at 7338 River Place Way, Sacramento, CA 95831.

As requested by Mr. Jeff Tucker, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site August 30, 2000. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report are based on the 1997 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence
Year Built: Estimated 1980's vintage.
Occupancy: Residential
No. of Stories: Two.
Dimensions: Approximately 3000 square feet with a first story plate height of 8 feet.

ISSUED

SEP 05 2000

Sacramento Building Division

CONSTRUCTION:

Roof:
The roof covering will consist of a Light Weight Concrete Tile over 1/2" solid sheathing. The living area is conventionally framed with 2x6 rafters spaced at 16" on center with 2x6 purlins supported at no more than 6'-0" on center by 2x4 struts bearing on walls below except for the vaulted ceiling areas. The vaulted ceiling is constructed of 2x6 rafters spaced at 16" on center supported mid-span by a 4x beam. The garage area is framed with 2x6 rafters spaced at 16" on center.

CONCLUSIONS:

Roof:
The living and garage areas have sufficient structural capacity for the applied live and dead loads.

Ordiz

Paul Zacher – Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

RECOMMENDATIONS:

None.

It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls that are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects that are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,



Paul Zacher, P.E., S.E.
file

DESIGN LOADING:

Roof Pitch	6	in 12
Pitch Adjustment Factor	1.12	

LOCATION: ROOF

<u>MATERIAL</u>		<u>WEIGHT</u>	
Light Weight Tile	7.00	psf	
Roofing felt	0.30	psf	
1x4 skip sht'g	1.09	psf	
1/2" OSB/ plywood	1.50	psf	
2x6 rafters @ 16" oc	<u>1.51</u>	psf	
	Load	11.4	psf
	Roof Pitch Adjustment	<u>1.35</u>	psf
	Total Load	12.7	psf

LOCATION: VAULT

<u>MATERIAL</u>		<u>WEIGHT</u>	
Light Weight Tile	7.00	psf	
Roofing felt	0.30	psf	
1/2" OSB/ plywood	1.50	psf	
1x4 skip sht'g	1.09	psf	
2x6 rafters @ 16" oc	1.51	psf	
Batt/blown insul	0.50	psf	
1/2" Gypboard	<u>2.50</u>	psf	
	Load	14.4	psf
	Roof Pitch Adjustment	<u>1.70</u>	psf
	Total Load	16.1	psf

P K Zacher S E.

4701 Lakeside Way
Fair Oaks, CA 95628
TEL: (916) 961-3960
FAX: (916) 961-6552

Job #: 00382


Date: 8/30/90

LOADING

BASE

22' 5" D.F. 4' 16.9 PF
22' 0" D.F. 21.3


2x6 #2



WALL

22' 10" D.F. 4' 21.5 PF
22' 16" D.F. 21.3


2x6 #2



RA

22' 0" D.F. 4' 34 D.F.
22' 0" D.F. 34


4x12 #2



RA

22' 10" D.F. 6' 47 PF
22' 0" D.F. 90

4x12 #1



Paul Zacher - Structural Engineers
 4701 Lakeside Way
 Fair Oaks
 TEL: (916) 961-3960
 FAX: (916) 961-6552

Title :
 Dsgnr:
 Description :
 Scope :

Job #
 Date: 4:38PM, 30 AUG 00

Rev: 010304
 User: RW 0602344, Ver 5.1.3.10 Jun 1999 Win97
 (c) 1983-99 ENERCALC

Timber Beam & Joist

c:\enercalc\test.ecw\Calculations

Description RAFTERS AND BEAMS

Timber Member Information Calculations are designed to 1997 NDS and 1997 UBC Requirements

	rafter	vault	B1	B2
Timber Section	2x6	2x6	4x12	4x12
Beam Width	in: 1.500	1.500	3.500	3.500
Beam Depth	in: 5.500	5.500	11.250	11.250
Le: Unbraced Length	ft: 0.00	0.00	0.00	0.00
Timber Grade	Douglas Fir - Larch	Douglas Fir - Larch	Douglas Fir - Larch	Douglas Fir - Larch
Fb - Basic Allow	psi: 875.0	875.0	875.0	1,000.0
Fv - Basic Allow	psi: 95.0	95.0	95.0	95.0
Elastic Modulus	ksi: 1,600.0	1,600.0	1,600.0	1,700.0
Load Duration Factor	1.250	1.250	1.250	1.250
Member Type	Sawn	Sawn	Sawn	Sawn
Repetitive Status	Repetitive	No	No	No

Center Span Data

		rafter	vault	B1	B2
Span	ft	13.50	11.92	16.00	13.50
Dead Load	#/ft	16.90	21.50	64.00	97.00
Live Load	#/ft	21.30	21.30	64.00	96.00

Results Ratio =


		rafter	vault	B1	B2
Mmax @ Center	in-k	10.44	9.12	49.15	52.76
@ X =	ft	6.75	5.96	8.00	6.75
f _b Actual	psi	1,380.9	1,206.2	665.8	714.7
F _b Allowable	psi	1,635.2	1,421.9	1,203.1	1,375.0
		Bending OK	Bending OK	Bending OK	Bending OK
f _v Actual	psi	43.9	43.0	34.6	42.9
F _v Allowable	psi	118.8	118.8	118.8	118.8
		Shear OK	Shear OK	Shear OK	Shear OK

Reactions

		rafter	vault	B1	B2
@ Left End	DL	lbs: 114.07	128.14	512.00	654.75
	LL	lbs: 143.77	126.95	512.00	648.00
	Max. DL+LL	lbs: 257.85	255.09	1,024.00	1,302.75
@ Right End	DL	lbs: 114.07	128.14	512.00	654.75
	LL	lbs: 143.77	126.95	512.00	648.00
	Max. DL+LL	lbs: 257.85	255.09	1,024.00	1,302.75

Deflections Ratio OK Deflection OK Deflection OK Deflection OK

		rafter	vault	B1	B2
Center DL Defl	in	-0.380	-0.293	-0.142	-0.103
L/Defl Ratio		426.8	487.4	1,351.9	1,577.7
Center LL Defl	in	-0.478	-0.291	-0.142	-0.102
L/Defl Ratio		338.6	491.9	1,351.9	1,594.2
Center Total Defl	in	-0.858	-0.584	-0.284	-0.204
Location	ft	6.750	5.960	8.000	6.750
L/Defl Ratio		188.8	244.8	675.9	792.9

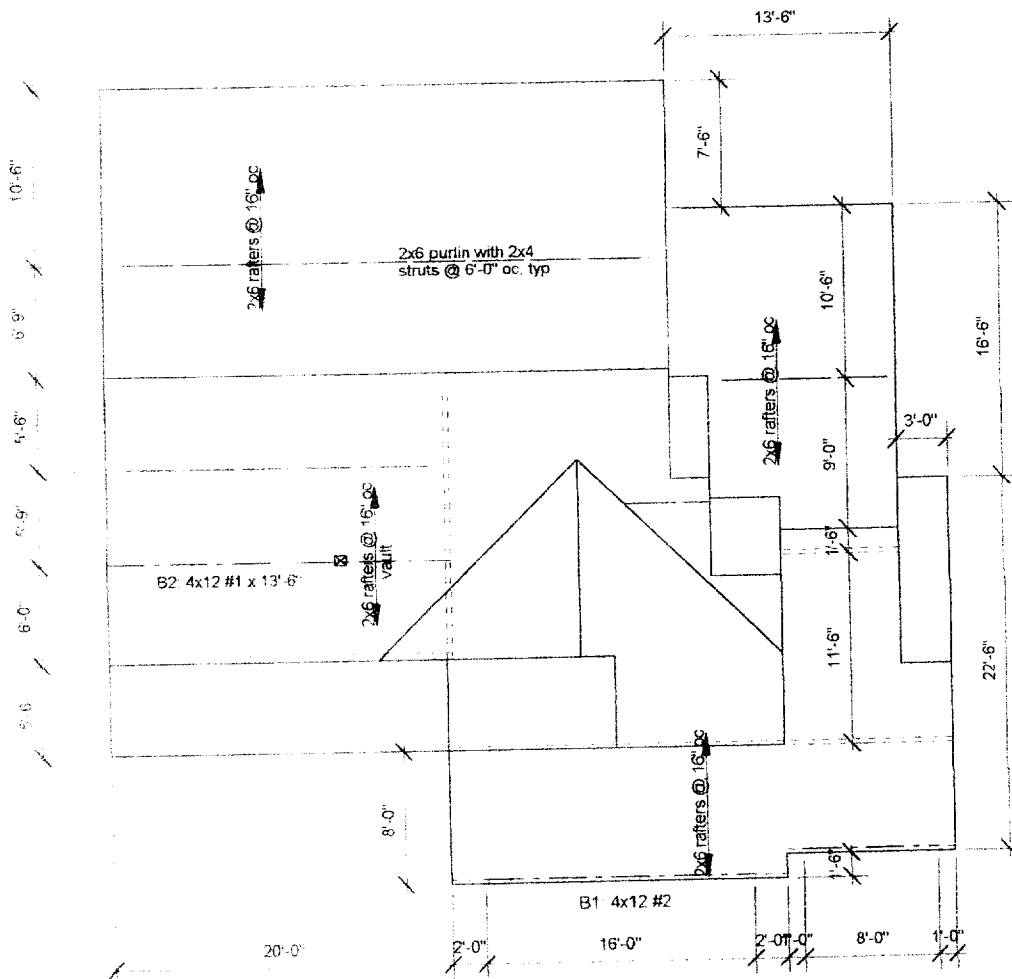

Notes:

- 1 This is a reroof project. The new roofing material shall be a Light Weight Concrete Tile. The tile shall weigh less than or equal to 7.0 psf.
- 2 All rafters are 2x6 DF#2 and hips and valleys are 2x8 DF#2 unless otherwise noted.
- 3 All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2320.12 "Roof and Ceiling Framing" unless otherwise shown.
- 4 All structural wood members that were observed appear to be in sound condition and without structural defect.

1

ROOF PLAN - ORDIZ

Not to Scale