

CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 0110714

Insp Area: 2

Thos Bros: 337A1

Site Address: 6955 GALLERY WY SAC

Parcel No: 029-0383-004

Sub-Type: RES

Housing (Y/N): N

CONTRACTOR

KRUTSON ROOFING
1520 MAIN AV
95838

OWNER

STELL
6955 GALLERY WY
SACRAMENTO CA 95831

ARCHITECT

Nature of Work: 30 SQ T/O REROOF W LT WEIGHT TILE

CONSTRUCTION LENDING AGENCY : I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C37 License Number 664205 Date 8-21-01 Contractor Signature 

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)


I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. _____ B & PC for this reason: _____

Date _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on ~~its representation of the applicant~~ **PLANNING** that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 8-21-01 Applicant/Agent Signature 

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier VILLANOVA INC Policy Number WC41241759 Exp Date 01/01/2002

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 8-21-01 Applicant Signature 

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

6955 GALLERY WAY

0110714R

METAL COUNTERBATTEN ROOF SYSTEM

SCALE: N.T.S.

This set of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the same without written permission from the Building Inspection Division.

The approval of this plan and specification shall not be held to permit or approve the violation of any City Ordinance or State Law.


CITY OF SACRAMENTO
PERMIT ASSISTANCE

AUG 21 2001

Julian 8/21/01

RECEIVED
0110714R

THERMO ROOF SHEATHING
SHALL BE LAPPED MIN. 2" VERT.
3" HORIZ. 18" HIPS & 24" VALLEYS

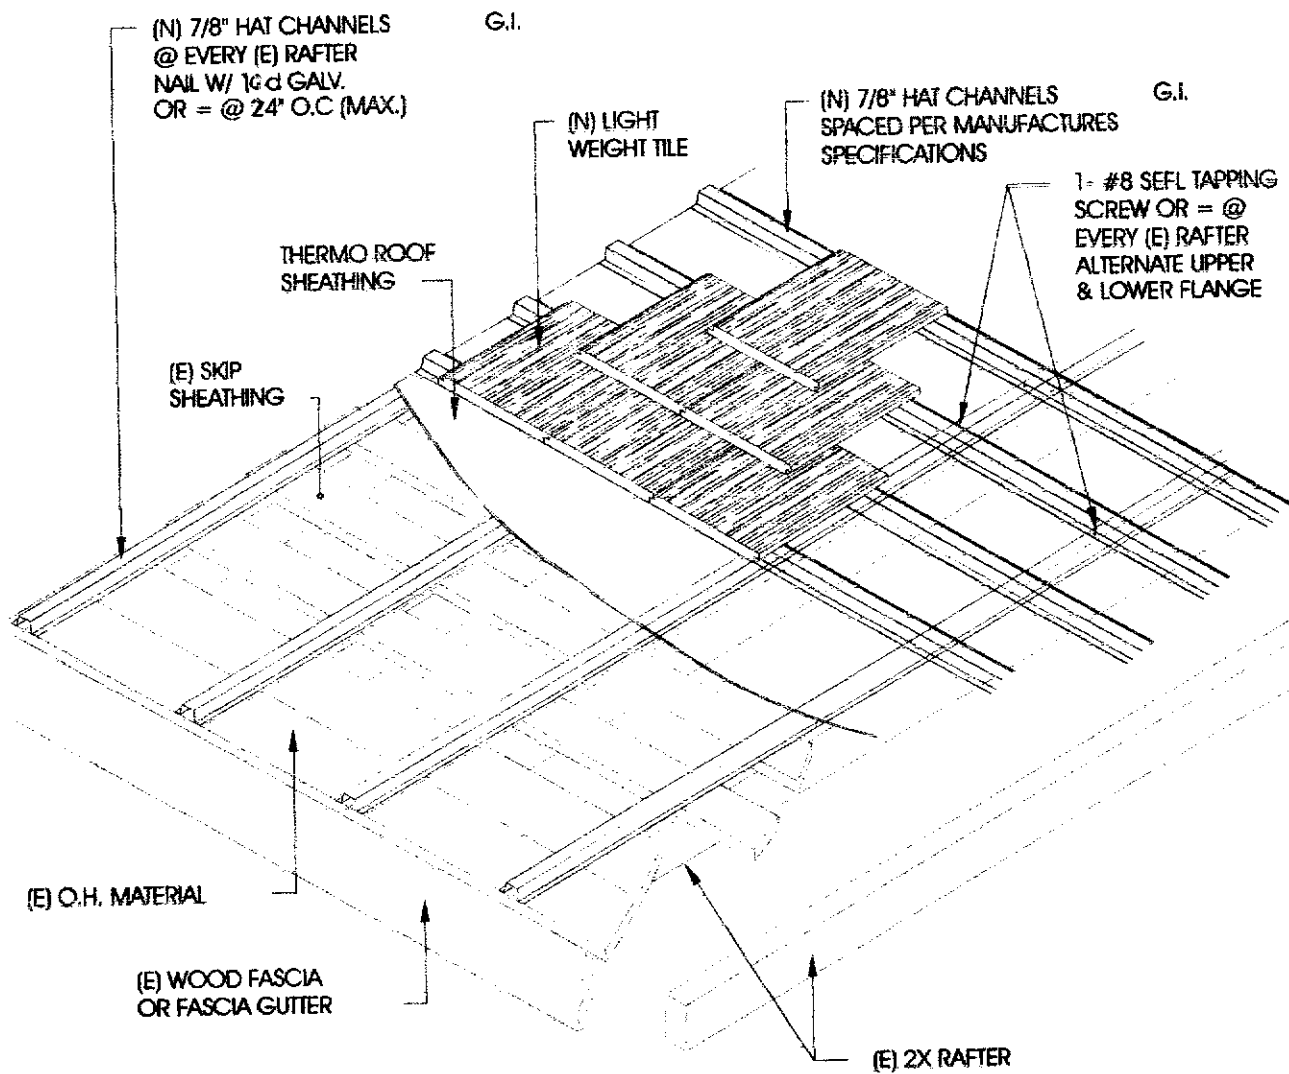

CERTIFIED INSTALLER
KNUTSON ROOFING

ANDERSON ENGINEERING CONSULTANTS

225 Vista Ridge Dr.
Meadow Vista, CA 95722
Phone: (530) 878-4770

Knutson Roofing
1520 Main Avenue
Sacramento, CA. 95838

July 17, 2001

Subject: Lightweight Tile Re-roof
6955 Gallery Way
Sacramento, CA. 95831

CITY OF SACRAMENTO
PERMIT ASSISTANCE

AUG 21 2001

RECEIVED

0110714R

Dear David,

Pursuant to your request, Anderson Engineering Consultants has reviewed the roof framing of the structure at the above address for structural adequacy. The house is single story, approximately 20 years old, and is conventionally framed. The roof is comprised of the following:

- Single 2x6 rafters at 24" o.c. with an 11'-0" maximum span.
- 2x8 purlins with 2x6 struts at 6' o.c. brace the rafters.
- 2x8 hip and valley boards.

The manufacturer has developed a span table to determine the maximum span of the rafter. The table was prepared by a licensed Engineer and is based on the current Uniform Building Code. The span table indicates the following for the given condition:

- Single 2x6 rafters at 24" o.c. - 12'-1"

The roof has a pitch of 5:12 and appears to be in sound condition. 2x8 purlins support the rafters at approximately mid-span and are braced adequately to bearing members. The hip and valley boards are 2x8 and braced adequately to bearing members. The total dead load on the rafters including roofing material does not exceed 9 psf.

It is our opinion that using your proposed re-roof system consisting of the following will not compromise the structural integrity of the roof system:

- 7/8" - 22 gage hat channel fastened to the rafters with 10d-galvanized nails (or equal) at 24" o.c.
- "Thermo-ply" underlayment fastened to the hat channel with #8 self-tapping screws (or equal).
- 7/8" - 22 gage steel hat channel battens over the "Thermo-ply" underlayment fastened with #8 self tapping screws (or equal) at every rafter.
- Lightweight Eaglelite concrete tile weighing less than 7.0 psf.

The determination of the roof's structural integrity is based on observation and known mechanical properties of wood.

After re-roofing minor cracking of the ceiling and interior and exterior walls may occur. In addition, a small amount of deflection in the rafters may be observed. These conditions are cosmetic only and do not affect the structural integrity of the roof framing.

Should you have any questions, please do not hesitate to contact us.

Sincerely,



Carl Anderson, P.E.



RE-ROOF PERMIT INFORMATION

CONTRACTOR: _____
CONTACT: _____
ADDRESS: _____
CITY, STATE, ZIP: _____
PHONE: _____

Date: _____
5-STAR SERVICE NO.: _____
CUSTOMER: _____
ADDRESS: _____
CITY, STATE, ZIP: _____
PHONE: _____

DESIGN CRITERIA: (1997 U.B.C.)

LIVE LOAD: 20 psf Pitch less than 4:12
16 psf Pitch 4:12 and greater

DEAD LOAD: 7.0 psf New EAGLELITE Tile
1.5 psf New 1/2" CDX Plywood
1.4 psf Miscellaneous & Felt
9.9 psf Total Dead Load w/o Clg.
2.5 psf 1/2" Gyp. Brd.
12.4 psf Total Dead Load w/ Clg.
Existing DL: 1.6 to 4.3 psf Framing and Sheathing*
*Depending on Rafter Size

LUMBER PROPERTIES:

$E_b =$ Allowable Bending Stress =
Includes 25% = 1885 psi 2x4
increase for 1635 psi 2x6
Roof Loading 1510 psi 2x8
1385 psi 2x10
 $E =$ Modulus of Elasticity = 1.6×10^6 psi



CALCULATIONS:

The maximum allowable span of a member shall be determined by the lowest value of two methods of calculation: Maximum allowable bending stress and maximum allowable deflection (L/180 w/out clg.; L/240 w/ clg.).

$$L_{bending} = \sqrt{\frac{8 \cdot S \cdot F_b}{(DL + LL) \cdot SP \cdot 12}}$$

$$L_{\Delta} = \left[\frac{384 \cdot E \cdot I}{(180) \cdot 5 \cdot (0.5 \cdot DL + LL) \cdot SP \cdot 144} \right]^{1/3}$$

(No Ceiling)

$$L_{\Delta} = \left[\frac{384 \cdot E \cdot I}{5 \cdot (240) \cdot (0.5 \cdot DL + LL) \cdot SP \cdot 144} \right]^{1/3}$$

(With Ceiling)

Rafter overhangs at eaves shall be determined by the lowest value based on member stress or deflection:

$$L_{b.o.} = \sqrt{\frac{2 \cdot F_b \cdot S}{(DL + LL) \cdot SP \cdot 12}}$$

$$L_{\Delta o.} = \left[\frac{8 \cdot E \cdot I}{180 \cdot (0.5 \cdot DL + LL) \cdot SP \cdot 144} \right]^{1/3}$$

WHERE: F_b is Maximum Allowable Bending Stress (psi)
 S is Section Modulus of Lumber (in³)
 LL is Live Load (psf)
 DL is Dead Load (psf)


E is Modulus of Elasticity (psi)
 I is Moment of Inertia (in⁴)
 SP is Rafter Spacing (ft)
 L is Span (ft)


TABULATED VALUES, MAXIMUM ALLOWABLE RAFTER SPANS:

Rafter Size	Rafter Spacing	Pitch < 4:12 (No Clg.)		Pitch > 4:12 (No Clg.)		Pitch > 4:12 (w/ Clg.)		Over Hangs at Eaves
		Single	Double	Single	Double	Single	Double	
2x4 $I = 5.36 \text{ in}^4$ $S = 3.06 \text{ in}^3$	12" 16" 24"	9'-10" 9'-0" 7'-9"	12'-4" 11'-3" 9'-10"	10'-5" 9'-6" 8'-4"	13'-0" 11'-11" 10'-5"	9'-4" 8'-6" 7'-5"	11'-7" 10'-7" 9'-4"	4'-7" 4'-2" 3'-8"
2x6 $I = 20.8 \text{ in}^4$ $S = 7.56 \text{ in}^3$	12" 16" 24"	15'-5" 13'-9" 11'-4"	19'-3" 17'-7" 15'-5"	16'-4" 14'-8" 12'-1"	20'-2" 18'-6" 16'-4"	14'-7" 13'-2" 11'-7"	18'-1" 16'-7" 14'-7"	7'-3" 6'-7" 5'-8"
2x8 $I = 47.6 \text{ in}^4$ $S = 13.14 \text{ in}^3$	12" 16" 24"	19'-10" 17'-4" 14'-3"	25'-2" 23'-1" 19'-10"	21'-1" 18'-6" 15'-3"	26'-6" 24'-4" 21'-1"	19'-1" 17'-5" 14'-7"	23'-8" 21'-8" 19'-1"	9'-6" 8'-8" 7'-1"
2x10 $I = 98.9 \text{ in}^4$ $S = 21.4 \text{ in}^3$	12" 16" 24"	23'-11" 21'-0" 17'-4"	31'-11" 28'-8" 23'-11"	25'-6" 22'-8" 18'-6"	33'-6" 30'-4" 25'-6"	24'-3" 21'-6" 17'-9"	29'-11" 27'-6" 24'-3"	11'-11" 10'-6" 8'-8"

ENGINEER'S COMMENTS:

Existing roofing material must be removed. The maximum span values are for vertical gravity loading only. All framing shall comply with the Uniform Building Code. Cosmetic cracking of walls and ceiling can occur during and after re-roofing. Furthermore, visible deflection of the roof can occur, especially for rafters approaching maximum allowable spans. Cracking and deflections do not affect the structural integrity of the roof framing. This form is provided as a convenience to homeowners and contractors. Eagle Roofing Products Company and the Architect or Engineer assume no responsibility for the accuracy of the information supplied by others.

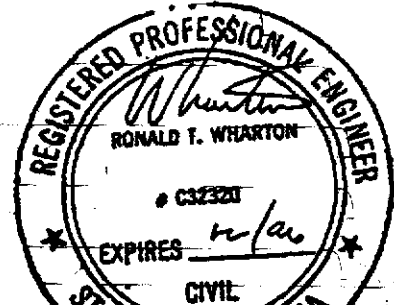

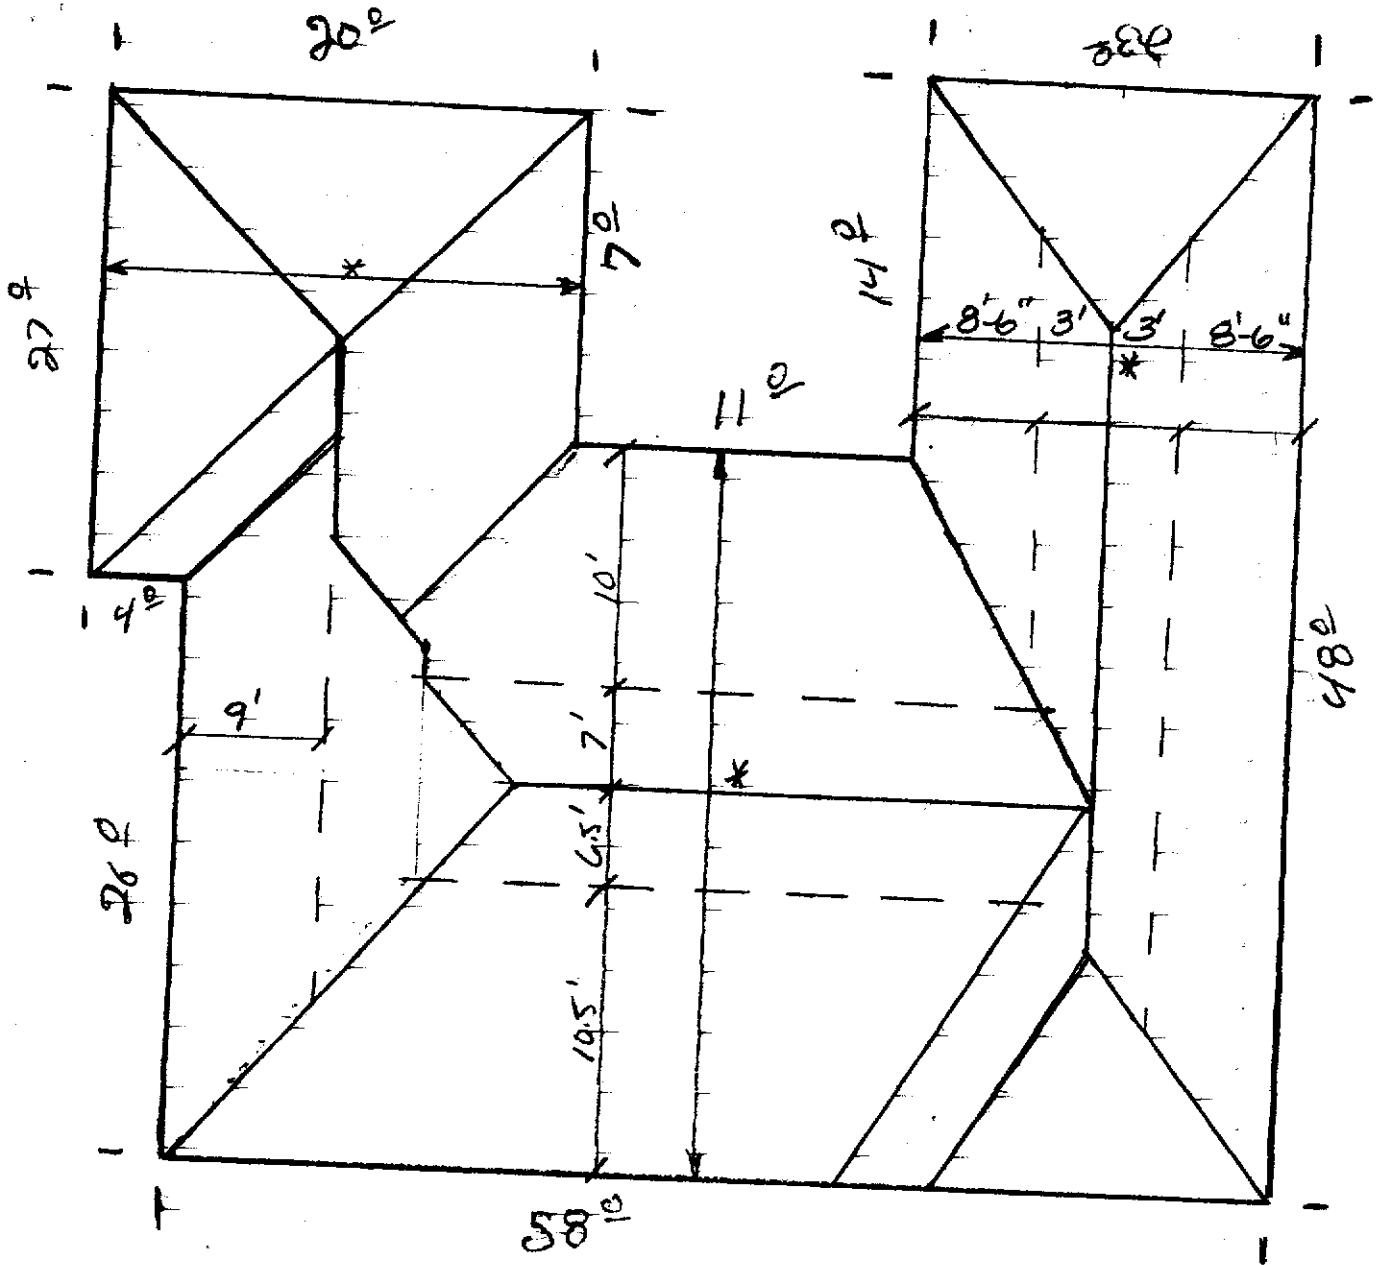

6955

Gallery

* 2x6 Rafters on 24" Centers

--- 2x8 Purlings

