

CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 0112876

Insp Area: 2

Thos Bros: 317B5

Site Address: 1254 42ND AV SAC

Parcel No: 024-0251-005

Sub-Type: RES

Housing (Y/N): N

CONTRACTOR

WEATHERTITE ROOFING
4661 SUMMERCREEK
SHINGLE SPRINGS, CA 95682

OWNER

LAW KENNETH J/MAY
1254 42ND AV
SACRAMENTO CA 95822

ARCHITECT

Nature of Work: REROOF, TEAR-OFF, INSTALL 35 SQ LIGHT WEIGHT TILE.

CONSTRUCTION LENDING AGENCY : I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name Lender's Address

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C-39 License Number 420375 Date 10/5/01 Contractor Signature Carolyn Peer

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. B & PC for this reason:

Date Owner Signature

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 10/5/01 Applicant/Agent Signature Carolyn Peer

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier STATE FUND Policy Number 1271896-01 Exp Date 10/01/2002

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 10/5/01 Applicant Signature Carolyn Peer

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

ISSUED

0112876

Law

OCT 05 2001

TEL: 916.961.3960
FAX: 916.961.6552

Sacramento Building Division

R

Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628


August 13, 2001

Weather-Tite Roofing Company
P.O. Box 6068
Folsom, CA 95673
TEL: (916) 635-9810; M (916) 958-5870
FAX: (916) 635-9810



In order of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations to the same without written permission from the Building Inspection Division.

The approval of this permit shall NOT be held to prevent a violation of any City Ordinance or State law.

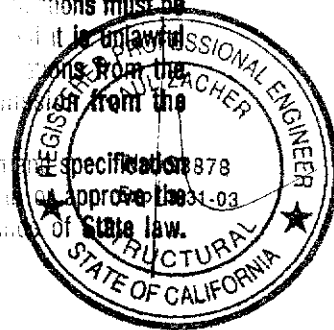

Attn.: Mr. Larry Peer,

re: Job 2001_235: LAW

Subject: Structural Investigation Report of the Roof for the Residence located at 1254 42nd Avenue, Sacramento, CA 95822.

As requested by Mr. Larry Peer, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site August 13, 2001. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report are based on the 1997 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

- Type of Facility: Residence.
- Year Built: Estimated 1960's vintage.
- Occupancy: Residential.
- No. of Stories: One.
- Dimensions: Approximately 2000 square feet with a first story plate height of 8 feet.

CONSTRUCTION:

Roof:
The roof covering will consist of a Light Weight Concrete Tile over 1/2" solid sheathing. The living area is conventionally framed with 2x6 rafters spaced at 24" on center with 2x6 purlins supported at no more than 6'-0" on center by 2x4 struts bearing on walls below. The garage area is framed with 2x6 rafters spaced at 24" on center and 2x6 cross ties spaced at 4'-0" on center.

CONCLUSIONS:

Roof:
The living and garage areas currently lack sufficient structural capacity for the applied live and dead loads. See "Recommendations" for location and repair to bring the living and garage areas up to the required capacity.

PERMISSION TO REPRODUCE THIS REPORT IS GRANTED BY THE CITY OF SACRAMENTO BUILDING DIVISION

Law



Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.

Living Area:

1. Scab a 1 3/4" x 11 1/4" x 16'-0" long LVL to the existing 2x6 purlin which spans 15'-0". Attach it with 16d's @ 3" on center. Support the LVL to the bearing walls below with 2x4 struts. See details 1 and 2.
2. Scab a 1 3/4" x 9 1/4" x 13'-0" long LVL to the existing 2x6 purlin which spans 13'-0". Attach it with 16d's @ 3" on center. Support the LVL to the bearing walls below with 2x4 struts. See details 1 and 2.

Garage:

3. Scab a 2x6 rafter to the existing 2x6 rafters with 16d's @ 12" on center where the span is greater than 12'-0". See detail 1.

It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls that are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects that are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,

Paul Zacher, P.E., S.E.
file

DESIGN LOADING:

Roof Pitch	4	in 12
Pitch Adjustment Factor	1.05	

LOCATION: ROOF

<u>MATERIAL</u>	<u>WEIGHT</u>	
Light Weight Tile	7.00	psf
Roofing felt	0.30	psf
1x4 skip sht'g	1.09	psf
1/2" OSB/ plywood	1.50	psf
2x6 rafters @ 24" oc	<u>1.00</u>	psf
	Load	10.9 psf
Roof Pitch Adjustment	<u>0.59</u>	psf
Total Load	11.5	psf

Job #: 01-235


Date: 8/15/01

LOADING

RAFTER

$Op = 11.5 \text{ psf} \times 2' = 23 \text{ plf}$ $2 \times U^{\#} 2$


$Lp = 16.0 \text{ '}$ $\therefore = 32 \text{ '}$



RAFTER

$Op = 11.5 \text{ psf} \times 2' = 23 \text{ plf}$ $2 \times U^{\#} 2$


$Lp = 16.0 \text{ '}$ $\therefore = 32 \text{ '}$



B)

$Op = 11.5 \text{ psf} \times 9' = 104 \text{ plf}$ $4 \times U^{\#} 2$


$Lp = 16.0 \text{ '}$ $\therefore = 144 \text{ '}$



BZ

$Op = 11.5 \text{ psf} \times 4' = 46 \text{ plf}$ $4 \times U^{\#} 1$


$Lp = 16.0 \text{ '}$ $\therefore = 64 \text{ '}$



DUPLEX

$Op = 11.5 \text{ psf} \times 8' = 95 \text{ plf}$ $1\frac{3}{4} \times 11\frac{1}{4} \text{ LVL}$


$Lp = 16.0 \text{ '}$ $\therefore = 132 \text{ '}$



DUPLEX

$Op = 11.5 \text{ psf} \times 8' = 95 \text{ plf}$ $1\frac{3}{4} \times 9\frac{1}{4} \text{ LVL}$

$Lp = 16.0 \text{ '}$ $\therefore = 132 \text{ '}$



Paul Zacher - Structural Engineers
 4701 Lakeside Way
 Fair Oaks
 TEL: (916) 961-3960
 FAX: (916) 961-6552

Title :
 Dsgnr:
 Description :

Job #
 Date: 1:22PM, 13 AUG 01

Scope :

Rev: 510304
 User: KW-0602844, Ver 5.1.3, 22-Jun-1999, Win32
 (c) 1983-99 ENERCALC

Timber Beam & Joist

c:\enercalc\test.ecw\Calculations

Description RAFTERS AND BEAMS

Timber Member Information

Calculations are designed to 1997 NDS and 1997 UBC Requirements

Timber Section		rafter	rafter	B1	B2	purlin	purlin
Beam Width	in	2x6	2-2x6	4x14	4x6	LVL:1.750x	LVL:1.750x
Beam Depth	in	1.500	3.000	3.500	3.500	1.750	1.750
Le: Unbraced Length	ft	5.500	5.500	13.250	5.500	11.250	9.250
Timber Grade		0.00	2.00	6.00	0.00	0.00	0.00
Fb - Basic Allow	psi	Douglas Fir - Larch	Douglas Fir - Larch	Douglas Fir - Larch	Douglas Fir - Larch	Truss Joist - MacMillan	Truss Joist - MacMillan
Fv - Basic Allow	psi	875.0	875.0	875.0	1,000.0	2,600.0	2,600.0
Elastic Modulus	ksi	95.0	95.0	95.0	95.0	285.0	285.0
Load Duration Factor		1,600.0	1,600.0	1,600.0	1,700.0	1,900.0	1,900.0
Member Type		1.250	1.250	1.250	1.250	1.250	1.250
Repetitive Status		Sawn	Sawn	Sawn	Sawn	Manuf/Pine	Manuf/Pine
		Repetitive	Repetitive	No	No	No	No

Center Span Data

Span	ft	12.00	15.25	16.00	11.00	16.00	13.00
Dead Load	#/ft	23.00	23.00	104.00	46.00	95.00	95.00
Live Load	#/ft	32.00	32.00	144.00	64.00	132.00	132.00

Results

Ratio = 0.9607 0.7787 0.8641 0.6963 0.7266 0.7095

Mmax @ Center	in-k	11.88	19.19	95.23	19.96	87.17	57.54
@ X =	ft	6.00	7.62	8.00	5.50	8.00	6.50
Fb : Actual	psi	1,570.9	1,268.5	929.9	1,131.4	2,361.4	2,305.9
Fb : Allowable	psi	1,635.2	1,629.0	1,076.2	1,625.0	3,250.0	3,250.0
		Bending OK	Bending OK	Bending OK	Bending OK	Bending OK	Bending OK
Fv : Actual	psi	55.7	36.0	55.4	43.4	122.9	121.4
Fv : Allowable	psi	118.8	118.8	118.8	118.8	356.3	356.3
		Shear OK	Shear OK	Shear OK	Shear OK	Shear OK	Shear OK


Reactions

@ Left End DL	lbs	138.00	175.37	832.00	253.00	760.00	617.50
LL	lbs	192.00	244.00	1,152.00	352.00	1,056.00	858.00
Max. DL+LL	lbs	330.00	419.37	1,984.00	605.00	1,816.00	1,475.50
@ Right End DL	lbs	138.00	175.37	832.00	253.00	760.00	617.50
LL	lbs	192.00	244.00	1,152.00	352.00	1,056.00	858.00
Max. DL+LL	lbs	330.00	419.37	1,984.00	605.00	1,816.00	1,475.50

Deflections

Ratio OK Deflection OK Deflection OK Deflection OK Deflection OK Deflection OK

Center DL Defl	in	-0.322	-0.421	-0.141	-0.184	-0.355	-0.278
L/Defl Ratio		446.5	435.1	1,359.2	718.6	540.7	560.4
Center LL Defl	in	-0.449	-0.585	-0.196	-0.256	-0.493	-0.387
L/Defl Ratio		320.9	312.8	981.6	516.5	389.2	403.3
Center Total Defl	in	-0.771	-1.006	-0.337	-0.439	-0.848	-0.665
Location	ft	6.000	7.625	8.000	5.500	8.000	6.500
L/Defl Ratio		186.7	182.0	570.0	300.5	226.3	234.5

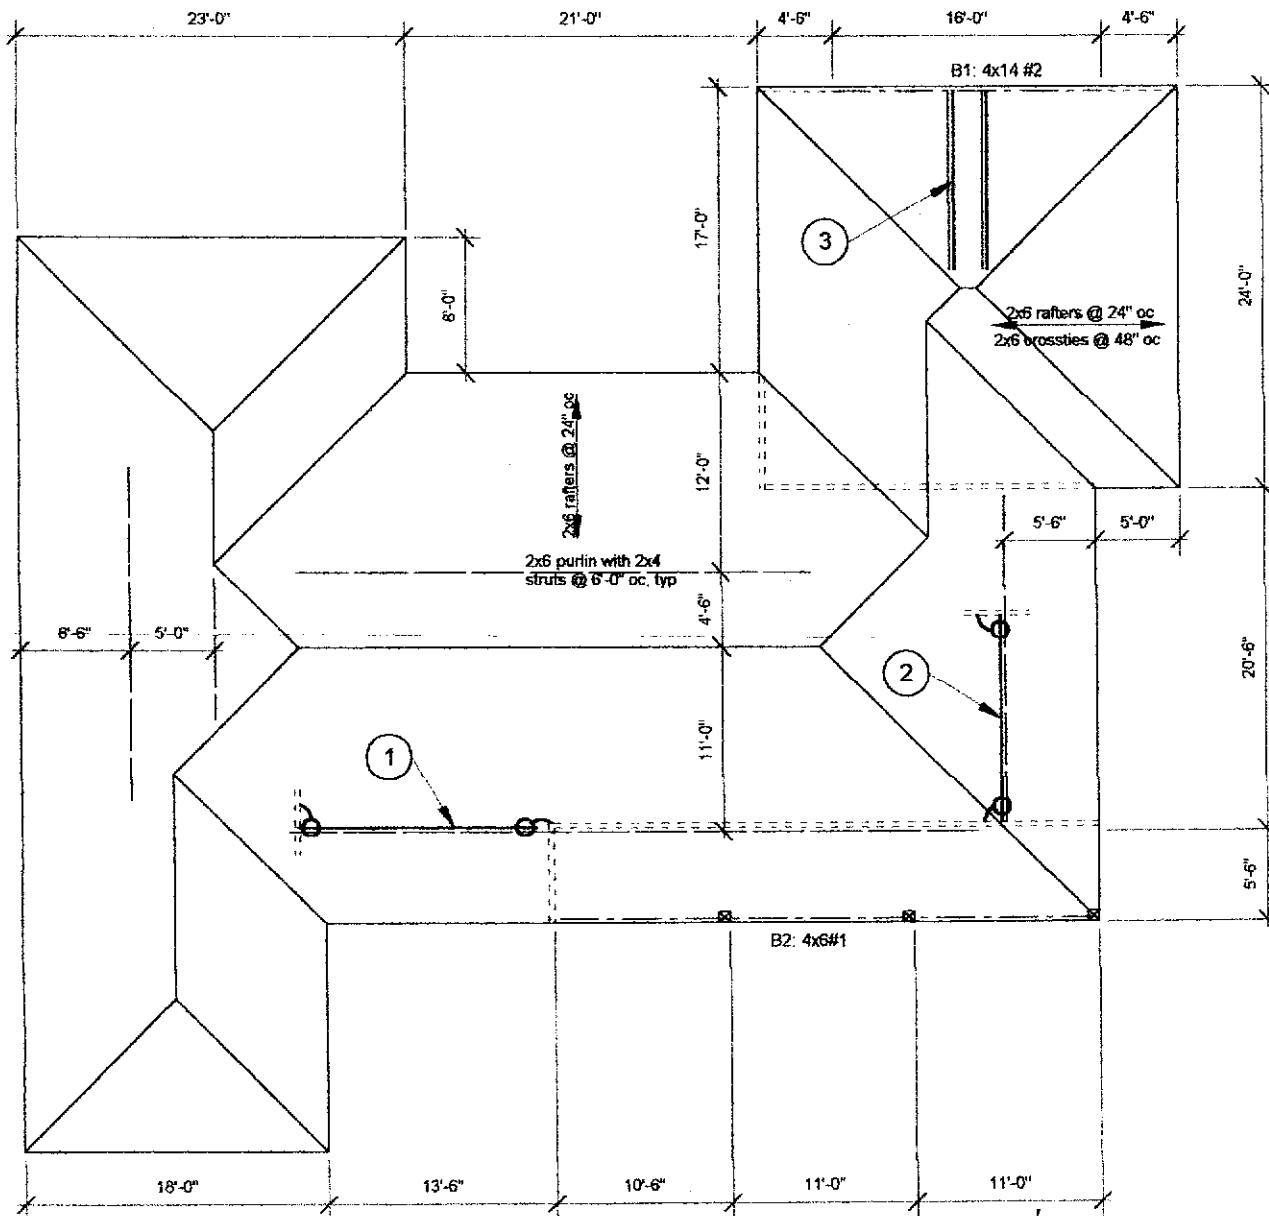

FRAMING NOTES:

1. Scab a 1 3/4" X 11 1/4" x 16'-0" long LVL to the existing 2x6 purlin. See detail 2.
2. Scab a 1 3/4" X 9 1/4" x 13'-0" long LVL to the existing 2x6 purlin. See detail 2.
3. Scab a 2x6 to existing 2x6 rafters where the span is greater than 12'-0" (total 2).

Notes:



- A. This is a reroof project. The new roofing material shall be a Light Weight Concrete Tile. The tile shall weigh less than or equal to 7.0 psf.
- B. All rafters are 2x6 DF#2 and hips and valleys are 2x8 DF#2 unless otherwise noted.
- C. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2320.1 "Roof and Ceiling Framing" unless otherwise shown.
- D. All structural wood members that were observed appear to be in sound condition and without structural defect.



ROOF PLAN - LAW

Not to Scale

G

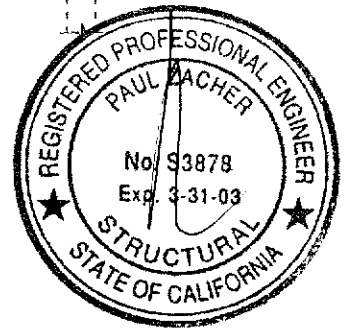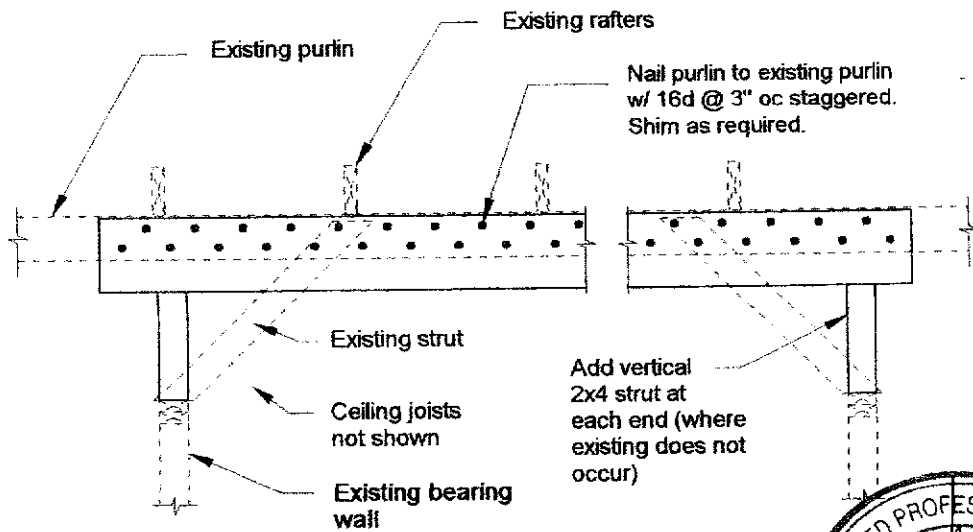

2

PURLIN DETAIL

scale: 1/2" = 1'-0"