

CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 0400572

Insp Area: 2
Thos Bros: 336 J2

Site Address: 23 WINDSTONE CT SAC
Parcel No: 031-0750-033

Sub-Type: RES
Housing (Y/N): N

CONTRACTOR
MONARCH ROOFING INC
8250 ALPINE AV #H
SACRAMENTO, CA 95831

OWNER
CHU REBECCA Y
23 WINDSTONE CT
SACRAMENTO CA 95831

ARCHITECT

Nature of Work: TEAR OFF 1 LAYER WOOD SHAKE, INSTALL METAL BATTEN SYSTEM & THERMO SHEATING, REROOF W/EAGLE LITE TILE 27 SQ

CONSTRUCTION LENDING AGENCY: I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C-39 License Number 806787 Date JAN 14, 2004 Contractor Signature PAUL FUSHER

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. _____ B & PC for this reason: _____

Date _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date JAN 14, 2004 Applicant/Agent Signature PAUL FUSHER

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury that I am of the following declarations:
I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier VIRGINIA SURETY COMPANY, INC Policy Number 005-00016796 Exp Date 01/01/2005

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date JAN 14, 04 Applicant Signature PAUL FUSHER

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

Chu


Paul Zacher - Structural Engineers, Inc
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

January 7, 2004

Monarch Roofing
8262 Alpine Avenue, Suite A
Sacramento, CA 95826
TEL: (916) 978-3182
FAX: (916) 452-5140

Attn.: Mr. Neal Weber,
re: Job 2004002: CHU



Subject: Structural Investigation Report of the Roof for the Residence located at 23 Windstone Court,
Sacramento, CA 95831.

As requested by Mr. Neal Weber, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site January 6, 2004. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report are based on the 1997 Uniform Building Code with 2001 CBC Title 24 Amendments.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility:	Residence.
Year Built:	Estimated 1980's vintage.
Occupancy:	Residential.
No. of Stories:	One.
Dimensions:	Approximately 3000 square feet.


CONSTRUCTION:

Roof:
The roof covering will consist of a Light Weight Concrete Tile over a batten system. The roof structure is framed with pre-engineered wood trusses spaced at 24" on center.

CONCLUSIONS:

Roof:
The roof structure currently lacks sufficient structural capacity for the applied live and dead loads. See "Recommendations" for location and repair to bring the roof structure up to the required capacity.

This set of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the same without written permission from the Building Inspection Division.
The approval of this plan and specification SHALL NOT be held to permit or approve the violation of any City Ordinance or State Law.



1/23

RECEIVED
CITY OF SACRAMENTO
PLANNING & DEVELOPMENT DEPARTMENT
JAN 13 2004



Paul Zacher - Structural Engineers, Inc
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.

Roof Structure:

1. Scab a 1 3/4" x 11 1/4" LVL to the existing header. See details 1 and 2.

It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls that are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects that are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,

Paul Zacher, P.E., S.E.
file

DESIGN LOADING:

Roof Pitch	6	in 12
Pitch Adjustment Factor	1.12	

The dead and live load on truss top chord is placed along the length of the top chord. Therefore, the live load is as follows:

Live Load on top chord	14.3	psf
------------------------	------	-----

LOCATION: TOP CHORD BATTEN SYSTEM

<u>MATERIAL</u>	<u>WEIGHT</u>	
Light Weight Tile	7.30	psf
Roofing felt	0.30	psf
Batten system	0.50	psf
1x4 skip sht'g	1.09	psf
2x4 truss @ 24" oc	<u>0.64</u>	psf
Total Load	9.8	psf

LOCATION: BOTTOM CHORD BATTEN SYSTEM

<u>MATERIAL</u>	<u>WEIGHT</u>	
Batt/blown insul	0.50	psf
2x4 truss @ 24" oc	1.28	psf
1/2" Gypboard	<u>2.50</u>	psf
Load	4.3	psf

LOADING:


B1

Dr = $14.1 \text{ psf} \times 11'-0" = 155 \text{ plf}$

Lr = $16.0 \text{ psf} \times 11'-0" = 176 \text{ plf}$

4 x 12 #2 + 1-3/4" x 11-1/4" LVL

155 / 176




B2

Dr = $14.1 \text{ psf} \times 17'-0" = 240 \text{ plf}$

Lr = $16.0 \text{ psf} \times 17'-0" = 272 \text{ plf}$

4 x 12 #2 + 1-3/4" x 11-1/4" LVL

240 / 272



Paul Zacher - Structural Engr's
 4701 Lakeside Way
 Fair Oaks, CA 95628
 TEL: (916) 961-3960
 FAX: (916) 961-6552

Title :
 Dsgnr:
 Description :
 Scope :

Job #
 Date: 7:19PM, 7 JAN 04

Rev: 580100
 User: KW-0802844, Ver 5.6.1, 25-Oct-2002
 (c) 1983-2002 ENERCALC Engineering Software

Timber Beam & Joist

c:\documents and settings\paul zacher\desktop

Description RAFTERS AND BEAMS

Timber Member Information Calculations are designed to 1997 NDS and 1997 UBC Requirements

		B1	B2
		4x12#2 + 1	4x12#2 + 1
Timber Section			
Beam Width	in	5.250	5.250
Beam Depth	in	11.250	11.250
Le: Unbraced Length	ft	0.00	0.00
Timber Grade		ustom. DF#2 + LVL	ustom. DF#2 + LVL
Fb - Basic Allow	psi	1,450.0	1,450.0
Fv - Basic Allow	psi	158.0	158.0
Elastic Modulus	ksi	1,666.7	1,666.7
Member Duration Factor		1.250	1.250
Member Type		Manuf/Pine	Manuf/Pine
Repetitive Status		No	No

Center Span Data

		B1	B2
Span	ft	16.00	12.00
Dead Load	#/ft	155.00	240.00
Live Load	#/ft	176.00	272.00

Results Ratio = 0.6332 0.5510


		B1	B2
Mmax @ Center	in-k	127.10	110.59
@ X =	ft	8.00	6.00
fb : Actual	psi	1,147.7	998.6
Fb : Allowable	psi	1,812.5	1,812.5
		Bending OK	Bending OK
f _v : Actual	psi	59.7	66.2
F _v : Allowable	psi	197.5	197.5
		Shear OK	Shear OK

Reactions

		B1	B2
@ Left End	DL	1,240.00	1,440.00
	LL	1,408.00	1,632.00
	Max. DL+LL	2,648.00	3,072.00
@ Right End	DL	1,240.00	1,440.00
	LL	1,408.00	1,632.00
	Max. DL+LL	2,648.00	3,072.00

Deflections Ratio OK Deflection OK

		B1	B2
Center DL Defl	in	-0.220	-0.108
L/Defl Ratio		872.2	1,335.2
Center LL Defl	in	-0.250	-0.122
L/Defl Ratio		768.1	1,178.1
Center Total Defl	in	-0.470	-0.230
Location	ft	8.000	6.000
L/Defl Ratio		408.4	625.9

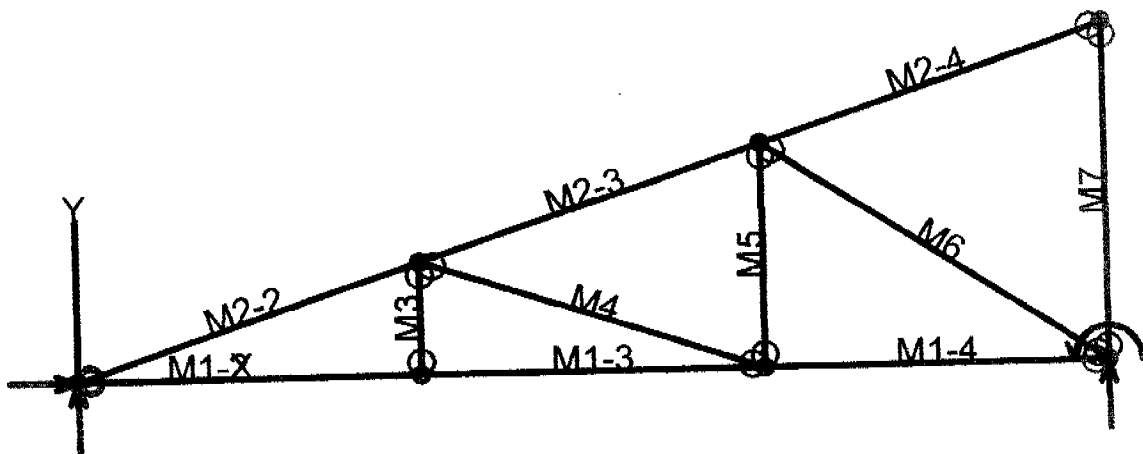

Truss 1

VisualAnalysis 4.00 Report

Company: Paul Zacher - Structural Engineers Engineer: Paul Zacher

File: C:\Documents and Settings\Paul Zacher\Desktop\Chu04_002\Truss 1.vap

Nodes

Node	X ft	Y ft	Fix DX	Fix DY	Fix RZ
N1	0.00	0.00	Yes	Yes	No
N2	21.00	0.00	No	"	Yes
N3	21.00	7.00	"	No	No
N4	7.00	0.00	"	"	"
N5	14.00	0.00	"	"	"
N6	7.00	2.33	"	"	"
N7	14.00	4.67	"	"	"

Member Elements

Member	Section	Material	Length ft
M1-2	SS2x4	Wood	7.00
M1-3	"	"	7.00
M1-4	"	"	7.00
M2-2	"	"	7.38
M2-3	"	"	7.38
M2-4	"	"	7.38
M3	"	"	2.33
M4	"	"	7.38
M5	"	"	4.67
M6	"	"	8.41
M7	"	"	7.00

Section Properties

Category	Section	Ax in ²	Iz in ⁴	Sz(+y) in ³	Sz(-y) in ³
Wood Sha	SS2x4	5.25	5.36	3.06	3.06

Material Properties

Material	Strength psi	Elasticity psi	Poisson	Density lb/ft ³
Wood	-NA-	1700000.00	0.36	40.47

Load Combination Summary

Equation Case: UBC97 12.8a

Combination: 1D+1Lr

Contributing Cases & Source

Dead Load (Dead loads)

Roof Live Load (Roof Live loads)

Nodal Reactions

Node	Load Case	FX lb	FY lb	MZ lb-ft
N1	UBC97 12.8a	0.00	615.30	-NA-
N2	"	-NA-	615.30	0.00

Member Results

Member	Fx lb	Vy lb	Mz lb-ft	Dx in	Dy in
M1-2	1334.32	-32.82	-19.07	0.01	-0.10
"	1334.32	-12.76	34.09	0.01	-0.10
"	1334.32	7.31	40.45	0.00	-0.07
"	1334.32	27.38	0.00	0.00	0.00
M1-3	1334.32	-33.55	-43.22	0.03	-0.07
"	1334.32	-13.48	11.63	0.02	-0.09
"	1334.32	6.58	19.68	0.02	-0.10
"	1334.32	26.65	-19.07	0.01	-0.10
M1-4	677.52	-23.93	0.00	0.03	0.00
"	677.52	-3.86	32.40	0.03	-0.05
"	677.52	16.21	17.99	0.03	-0.06
"	677.52	36.27	-43.22	0.03	-0.07
M2-2	-1451.7	135.80	0.00	0.00	0.00
"	-1414.8	25.12	197.80	-0.00	-0.21
"	-1377.9	-85.56	123.48	-0.01	-0.21
"	-1341.0	-196.23	-222.95	-0.01	-0.10
M2-3	-768.42	162.74	-222.95	-0.01	-0.10
"	-731.52	52.06	41.10	-0.02	-0.11
"	-694.63	-58.62	33.04	-0.02	-0.09
"	-657.74	169.30	-247.13	-0.02	-0.06
M2-4	-66.50	199.51	-247.13	-0.02	-0.06
"	-29.61	88.83	107.36	-0.02	-0.17
"	7.28	-21.85	189.74	-0.02	-0.18
"	44.18	-132.53	0.00	-0.02	0.01
M3	59.47	0.00	0.00	0.10	0.01
"	59.47	0.00	0.00	0.10	0.02
"	59.47	0.00	0.00	0.10	0.02
"	59.47	0.00	0.00	0.10	0.02
M4	-692.33	0.00	0.00	0.04	-0.06
"	-692.33	0.00	0.00	0.05	-0.09
"	-692.33	0.00	0.00	0.05	-0.08
"	-692.33	0.00	0.00	0.05	-0.07
M5	288.76	0.00	0.00	-0.07	-0.03
"	288.76	0.00	0.00	-0.07	-0.02
"	288.76	0.00	0.00	-0.07	-0.01
"	288.76	0.00	0.00	-0.06	0.00
M6	-814.28	0.00	0.00	0.03	-0.03
"	-814.28	0.00	0.00	0.03	-0.01
"	-814.28	0.00	0.00	0.03	0.02
"	-814.28	0.00	0.00	0.04	-0.05
M7	-139.70	0.00	0.00	0.00	-0.03
"	-139.70	0.00	0.00	-0.00	-0.01
"	-139.70	0.00	0.00	-0.00	0.00
"	-139.70	0.00	0.00	-0.00	0.02

BENDING & COMP: TRUSS 1 - MEMBER 2-2

Design based on 1997 UBC 2321 Division V and ANSI/TPI 1-1995

Grading:


2x or 4x

Doug-fir larch: No. 2

Assumptions:

Solid sheathing on top chord of truss. Therefore,
 continuous lateral support is provided along compression face
 Maximum center-center spacing = 24"

Width, b	1.5 inches
Depth, d	3.5 inches
Length	7.38 feet
Max Axial Comp, C	1341 lbs
Max Reaction, R	196 lbs
Max Moment, M	222 ft-lbs
Max LL Deflection	0.05 inches
Max TL Deflection	0.10 inches
LL Defl Criteria = L/	240
TL Defl Criteria = L/	180
Duration factor, Cd	1.25
Repetitive Factor, Cr	1.15
Size Factor, Cf bending	1.5 1.5 for 2x4, 1.3 for 2x6
Size Factor, Cf comp	1.15 1.15 for 2x4, 1.1 for 2x6
Buckling Factor, CT =	1.20
fc =	255 psi
Fce =	958 psi
Fc* =	2084 psi
F'c =	844 psi
fb =	870 psi
F'b = Fb* =	2156 psi
Shear D/C ratio	0.47 < 1.0, Member OK
Interaction equation:	
(fc/F'c) ² +	
fb / (F'b(1-fc/Fce)) =	0.64 < 1.0, Member OK
Live Load defl ratio	0.14 < 1.0, Member OK
Total Load defl ratio	0.20 < 1.0, Member OK

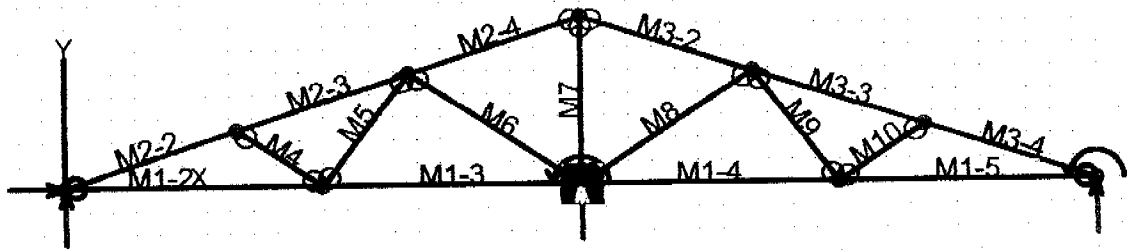

Truss 2

VisualAnalysis 4.00 Report

Company: Paul Zacher - Structural Engineers Engineer: Paul Zacher

File: C:\Documents and Settings\Paul Zacher\Desktop\Chu04_002\Truss 2.vap

Nodes

Node	X ft	Y ft	Fix	DX	Fix	DY	Fix	RZ
N1	0.00	0.00	Yes		Yes			No
N2	44.00	0.00	No		"			Yes
N3	22.00	7.33	"		No			No
N4	11.00	0.00	"		"			"
N5	22.00	0.00	"		Yes			Yes
N6	33.00	0.00	"		No			No
N7	7.33	2.44	"		"			"
N8	14.67	4.89	"		"			"
N9	29.33	4.89	"		"			"
N10	36.67	2.44	"		"			"

Member Elements

Member	Section	Material	Length ft
M1-2	SS2x4	Wood	11.00
M1-3	"	"	11.00
M1-4	"	"	11.00
M1-5	"	"	11.00
M2-2	"	"	7.73
M2-3	"	"	7.73
M2-4	"	"	7.73
M3-2	"	"	7.73
M3-3	"	"	7.73
M3-4	"	"	7.73
M4	"	"	4.41
M5	"	"	6.11
M6	"	"	8.81
M7	"	"	7.33
M8	"	"	8.81
M9	"	"	6.11
M10	"	"	4.41

Section Properties

Category	Section	Ax in ²	Iz in ⁴	Sz (+y) in ³	Sz (-y) in ³
Wood Sha	SS2x4	5.25	5.36	3.06	3.06

Material Properties

Material	Strength psi	Elasticity psi	Poisson	Density lb/ft ³
Wood	-NA-	1700000.00	0.36	40.47

Load Combination Summary

Equation Case: UBC97 12.8a

Combination: 1D+1Lr

Contributing Cases & Source

Dead Load (Dead loads)

Roof Live Load (Roof Live loads)

Nodal Reactions

Node	Load Case	FX lb	FY lb	MZ lb-ft
N1	UBC97 12.8a	0.00	358.29	-NA-
N2	"	-NA-	358.29	0.00
N5	"	-NA-	1861.81	0.00

Member Results

Member	Fx lb	Vy lb	Mz lb-ft	Dx in	Dy in
M1-2	518.56	-56.86	-105.12	0.01	-0.03
"	518.56	-25.32	45.50	0.01	-0.14
"	518.56	6.21	80.54	0.00	-0.16
"	518.56	37.74	0.00	0.00	0.00
M1-3	-162.62	-45.20	-81.98	0.01	0.00
"	-162.62	-13.66	25.89	0.01	-0.05
"	-162.62	17.87	18.17	0.01	-0.05
"	-162.62	49.40	-105.12	0.01	-0.03
M1-4	-162.62	-49.40	-105.12	0.00	-0.03
"	-162.62	-17.87	18.17	0.00	-0.05
"	-162.62	13.66	25.89	0.00	-0.05
"	-162.62	45.20	-81.98	0.01	0.00
M1-5	518.56	-37.74	0.00	0.01	0.00
"	518.56	-6.21	80.54	0.01	-0.16
"	518.56	25.32	45.50	0.01	-0.14
"	518.56	56.86	-105.12	0.00	-0.03
M2-2	-593.30	140.20	0.00	0.00	0.00
"	-554.66	24.24	211.73	-0.00	-0.21
"	-516.03	-91.71	124.81	-0.00	-0.19
"	-477.39	-207.67	-260.76	-0.01	-0.04
M2-3	-181.45	172.56	-260.76	-0.01	-0.04
"	-142.81	56.61	34.36	-0.01	-0.04
"	-104.18	-59.35	30.83	-0.01	-0.04
"	-65.54	-175.30	-271.35	-0.01	-0.02
M2-4	824.32	209.04	-271.35	-0.01	-0.02
"	862.95	93.08	117.75	-0.00	-0.17
"	901.58	-22.87	208.20	-0.00	-0.21
"	940.22	-138.83	0.00	0.00	-0.01
M3-2	824.32	-209.04	-271.35	0.02	-0.02
"	862.95	-93.08	117.75	0.01	-0.17
"	901.58	22.87	208.20	0.01	-0.20
"	940.22	138.83	0.00	0.01	-0.01
M3-3	-181.45	-172.56	-260.76	0.02	-0.04
"	-142.81	-56.61	34.36	0.02	-0.04
"	-104.18	59.35	30.83	0.02	-0.03
"	-65.54	175.30	-271.35	0.02	-0.02
M3-4	-593.30	-140.20	0.00	0.01	0.00
"	-554.66	-24.24	211.73	0.01	-0.21
"	-516.03	91.71	124.81	0.01	-0.19
"	-477.39	207.67	-260.76	0.02	-0.04
M4	-481.83	0.00	0.00	0.03	-0.03

12

Member	Fx lb	Vy lb	Mz lb-ft	Dx in	Dy in
"	-481.83	0.00	0.00	0.03	-0.03
"	-481.83	0.00	0.00	0.03	-0.03
"	-481.83	0.00	0.00	0.03	-0.02
M5	466.89	0.00	0.00	-0.02	-0.03
"	466.89	0.00	0.00	-0.02	-0.02
"	466.89	0.00	0.00	-0.02	-0.02
"	466.89	0.00	0.00	-0.02	-0.02
M6	-823.76	0.00	0.00	0.00	0.00
"	-823.76	0.00	0.00	0.01	-0.02
"	-823.76	0.00	0.00	0.01	-0.01
"	-823.76	0.00	0.00	0.01	-0.00
M7	-857.82	0.00	0.00	-0.01	-0.01
"	-857.82	0.00	0.00	-0.01	-0.01
"	-857.82	0.00	0.00	-0.00	-0.01
"	-857.82	0.00	0.00	0.00	-0.01
M8	-823.76	0.00	0.00	-0.01	-0.03
"	-823.76	0.00	0.00	-0.00	-0.02
"	-823.76	0.00	0.00	0.00	-0.01
"	-823.76	0.00	0.00	0.00	-0.00
M9	466.89	0.00	0.00	0.03	-0.02
"	466.89	0.00	0.00	0.03	-0.01
"	466.89	0.00	0.00	0.03	-0.01
"	466.89	0.00	0.00	0.03	-0.01
M10	-481.83	0.00	0.00	-0.02	-0.03
"	-481.83	0.00	0.00	-0.02	-0.03
"	-481.83	0.00	0.00	-0.02	-0.03
"	-481.83	0.00	0.00	-0.02	-0.03

BENDING & COMP: TRUSS 2 - MEMBER 2-2

Design based on 1997 UBC 2321 Division V and ANSI/TPI 1-1995

Grading:


2x or 4x

Doug-fir larch: No. 2

Assumptions:

Solid sheathing on top chord of truss. Therefore,
 continuous lateral support is provided along compression face
 Maximum center-center spacing = 24"

Width, b	1.5 inches
Depth, d	3.5 inches
Length	7.73 feet
Max Axial Comp, C	477 lbs
Max Reaction, R	207 lbs
Max Moment, M	260 ft-lbs
Max LL Deflection	0.02 inches
Max TL Deflection	0.04 inches
LL Defl Criteria = L/	240
TL Defl Criteria = L/	180
Duration factor, Cd	1.25
Repetitive Factor, Cr	1.15
Size Factor, Cf bending	1.5 1.5 for 2x4, 1.3 for 2x6
Size Factor, Cf comp	1.15 1.15 for 2x4, 1.1 for 2x6
Buckling Factor, CT =	1.21
fc =	91 psi
Fce=	881 psi
Fc*=	2084 psi
F'c=	786 psi
fb=	1019 psi
F'b=Fb*=	2156 psi
Shear D/C ratio	0.50 < 1.0, Member OK
Interaction equation:	
(fc/F'c)^2 +	
fb/ (F'b(1-fc/Fce)) =	0.54 < 1.0, Member OK
Live Load defl ratio	0.05 < 1.0, Member OK
Total Load defl ratio	0.08 < 1.0, Member OK

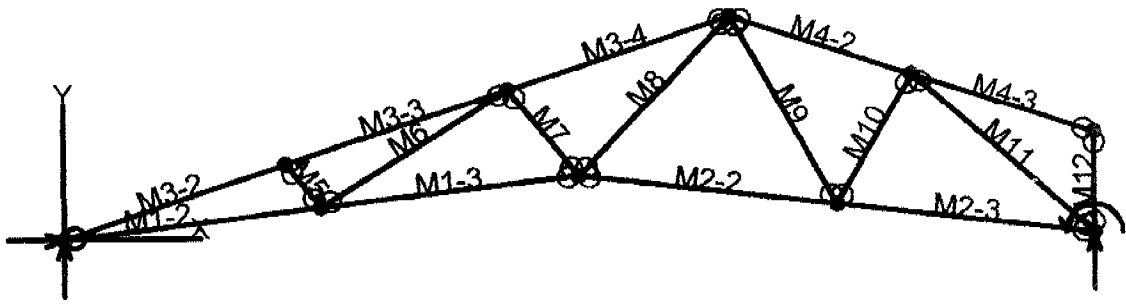

Truss 3

VisualAnalysis 4.00 Report

Company: Paul Zacher - Structural Engineers Engineer: Paul Zacher

File: C:\Documents and Settings\Paul Zacher\Desktop\Chu04_002\Truss 3.vap

Nodes

Node	X ft	Y ft	Fix DX	Fix DY	Fix RZ
N1	0.00	0.00	Yes	Yes	No
N2	22.00	7.33	No	No	"
N3	34.00	3.33	"	"	"
N4	17.00	2.00	"	"	"
N5	34.00	0.00	"	Yes	Yes
N6	8.50	1.00	"	No	No
N7	25.50	1.00	"	"	"
N8	28.00	5.33	"	"	"
N9	7.33	2.44	"	"	"
N10	14.67	4.89	"	"	"

Member Elements

Member	Section	Material	Length ft
M1-2	SS2x4	Wood	8.56
M1-3	"	"	8.56
M2-2	"	"	8.56
M2-3	"	"	8.56
M3-2	SS2x6	"	7.73
M3-3	"	"	7.73
M3-4	"	"	7.73
M4-2	SS2x4	"	6.32
M4-3	"	"	6.32
M5	SS2x6	"	1.86
M6	"	"	7.29
M7	"	"	3.71
M8	"	"	7.31
M9	"	"	7.23
M10	"	"	5.00
M11	"	"	8.03
M12	"	"	3.33

Section Properties

Category	Section	Ax in ²	Iz in ⁴	Sz(+y) in ³	Sz(-y) in ³
Wood Sha	SS2x4	5.25	5.36	3.06	3.06
"	SS2x6	8.25	20.80	7.56	7.56

Material Properties

Material	Strength psi	Elasticity psi	Poisson	Density lb/ft ³
Wood	-NA-	1700000.00	0.36	40.47

Material	Strength	Elasticity	Poisson	Density
	psi	psi		lb/ft ³

Load Combination Summary

Equation Case: UBC97 12.8a

Combination: 1D+1Lr

Contributing Cases & Source

Dead Load (Dead loads)

Roof Live Load (Roof Live loads)

Nodal Reactions

Node	Load Case	FX lb	FY lb	MZ lb-ft
N1	UBC97 12.8a	0.00	996.20	-NA-
N5	"	-NA-	996.20	0.00

Member Results

Member	Fx lb	Vy lb	Mz lb-ft	Dx in	Dy in
M1-2	3661.16	33.44	0.00	0.00	0.00
"	3664.00	9.24	60.85	0.01	-0.23
"	3666.85	-14.96	52.68	0.03	-0.37
"	3669.70	-39.16	-24.49	0.04	-0.45
M1-3	2707.54	39.16	-24.49	0.04	-0.45
"	2710.38	14.96	52.68	0.05	-0.51
"	2713.23	-9.24	60.85	0.06	-0.50
"	2716.08	-33.44	0.00	0.07	-0.40
M2-2	1305.15	-44.68	-71.76	0.18	-0.20
"	1307.99	-20.48	21.17	0.17	-0.30
"	1310.84	3.71	45.09	0.17	-0.37
"	1313.69	27.91	0.00	0.16	-0.37
M2-3	1112.59	-27.91	0.00	0.19	0.02
"	1115.44	-3.71	45.09	0.19	-0.10
"	1118.29	20.48	21.17	0.18	-0.16
"	1121.13	44.68	-71.76	0.18	-0.20
M3-2	-3892.9	168.86	0.00	0.00	0.00
"	-3854.3	52.91	285.58	-0.01	-0.23
"	-3815.7	-63.05	272.51	-0.02	-0.37
"	-3777.0	-179.00	-39.20	-0.03	-0.44
M3-3	-3655.7	145.13	-39.20	-0.03	-0.44
"	-3617.1	29.18	185.24	-0.03	-0.48
"	-3578.4	-86.78	111.04	-0.04	-0.47
"	-3539.8	-202.73	-261.81	-0.05	-0.43
M3-4	-2472.5	207.80	-261.81	-0.05	-0.43
"	-2433.9	91.85	124.10	-0.05	-0.42
"	-2395.3	-24.11	211.37	-0.06	-0.38
"	-2356.6	-140.06	0.00	-0.07	-0.29
M4-2	-1351.0	-176.46	-216.04	0.11	-0.14
"	-1319.4	-81.59	55.89	0.11	-0.24
"	-1287.8	13.28	127.91	0.12	-0.30
"	-1256.1	108.14	0.00	0.12	-0.27
M4-3	-36.05	-108.14	0.00	0.11	0.04
"	-4.43	-13.28	127.91	0.11	-0.10
"	27.20	81.59	55.89	0.11	-0.13
"	58.82	176.46	-216.04	0.11	-0.14
M5	-346.10	0.00	0.00	0.40	-0.20
"	-346.10	0.00	0.00	0.40	-0.19

Member	Fx lb	Vy lb	Mz lb-ft	Dx in	Dy in
"	-346.10	0.00	0.00	0.40	-0.19
"	-346.10	0.00	0.00	0.40	-0.18
M6	861.54	0.00	0.00	-0.15	-0.42
"	861.54	0.00	0.00	-0.15	-0.42
"	861.54	0.00	0.00	-0.15	-0.41
"	861.54	0.00	0.00	-0.15	-0.40
M7	-657.71	0.00	0.00	0.38	-0.20
"	-657.71	0.00	0.00	0.38	-0.18
"	-657.71	0.00	0.00	0.38	-0.17
"	-657.71	0.00	0.00	0.38	-0.15
M8	1430.47	0.00	0.00	-0.20	-0.35
"	1430.47	0.00	0.00	-0.20	-0.31
"	1430.47	0.00	0.00	-0.20	-0.27
"	1430.47	0.00	0.00	-0.19	-0.22
M9	-156.06	0.00	0.00	0.27	-0.12
"	-156.06	0.00	0.00	0.27	-0.07
"	-156.06	0.00	0.00	0.27	-0.02
"	-156.06	0.00	0.00	0.27	0.03
M10	235.36	0.00	0.00	-0.12	-0.25
"	235.36	0.00	0.00	-0.12	-0.21
"	235.36	0.00	0.00	-0.11	-0.17
"	235.36	0.00	0.00	-0.11	-0.13
M11	-1482.3	0.00	0.00	0.14	0.13
"	-1482.3	0.00	0.00	0.15	-0.01
"	-1482.3	0.00	0.00	0.15	0.06
"	-1482.3	0.00	0.00	0.16	-0.08
M12	-113.99	0.00	0.00	0.00	-0.19
"	-113.99	0.00	0.00	-0.00	-0.17
"	-113.99	0.00	0.00	-0.00	-0.14
"	-113.99	0.00	0.00	-0.00	-0.12

BENDING & COMP: TRUSS 3 - MEMBER 3-3

Design based on 1997 UBC 2321 Division V and ANSI/TPI 1-1995

Grading:


2x or 4x

Doug-fir larch: No. 2

Assumptions:

Solid sheathing on top chord of truss. Therefore,
continuous lateral support is provided along compression face
Maximum center-center spacing = 24"

Width, b	1.5 inches
Depth, d	5.5 inches
Length	7.73 feet
Max Axial Comp, C	3539 lbs
Max Reaction, R	202 lbs
Max Moment, M	261 ft-lbs
Max LL Deflection	0.21 inches
Max TL Deflection	0.43 inches
LL Defl Criteria = L/	240
TL Defl Criteria = L/	180
Duration factor, Cd	1.25
Repetitive Factor, Cr	1.15
Size Factor, Cf bending	1.3 1.5 for 2x4, 1.3 for 2x6
Size Factor, Cf comp	1.1 1.15 for 2x4, 1.1 for 2x6
Buckling Factor, CT =	1.21
fc =	429 psi
Fce=	2174 psi
Fc*=	1994 psi
F'c=	1436 psi
fb=	414 psi
F'b=Fb*=	1869 psi
Shear D/C ratio	0.31 < 1.0, Member OK
Interaction equation:	
(fc/F'c)^2 +	
fb/ (F'b(1-fc/Fce)) =	0.37 < 1.0, Member OK
Live Load defl ratio	0.54 < 1.0, Member OK
Total Load defl ratio	0.83 < 1.0, Member OK

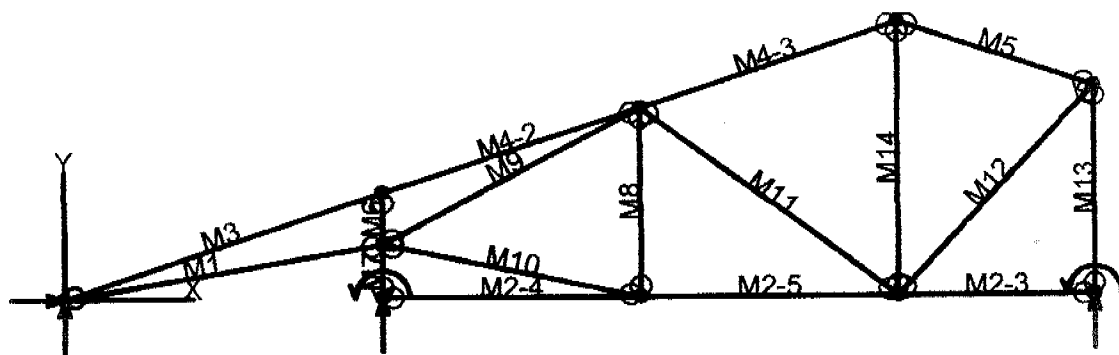

BENDING & COMP: TRUSS 4 - MEMBER 3

Design based on 1997 UBC 2321 Division V and ANSI/TPI 1-1995

Grading:


2x or 4x

Doug-fir larch: No. 2

Assumptions:

Solid sheathing on top chord of truss. Therefore,
 continuous lateral support is provided along compression face
 Maximum center-center spacing = 24"

Width, b	1.5 inches
Depth, d	5.5 inches
Length	11.07 feet
Max Axial Comp, C	113 lbs
Max Reaction, R	35 lbs
Max Moment, M	437 ft-lbs
Max LL Deflection	0.11 inches
Max TL Deflection	0.22 inches
LL Defl Criteria = L/	240
TL Defl Criteria = L/	180
Duration factor, Cd	1.25
Repetitive Factor, Cr	1.15
Size Factor, Cf bending	1.3 1.5 for 2x4, 1.3 for 2x6
Size Factor, Cf comp	1.1 1.15 for 2x4, 1.1 for 2x6
Buckling Factor, CT =	1.30
fc =	14 psi
Fce=	1141 psi
Fc*=	1994 psi
F'c=	961 psi
fb=	693 psi
F'b=Fb*=	1869 psi
Shear D/C ratio	0.05 < 1.0, Member OK
Interaction equation:	
(fc/F'c)^2 +	
fb/ (F'b(1-fc/Fce)) =	0.38 < 1.0, Member OK
Live Load defl ratio	0.20 < 1.0, Member OK
Total Load defl ratio	0.30 < 1.0, Member OK

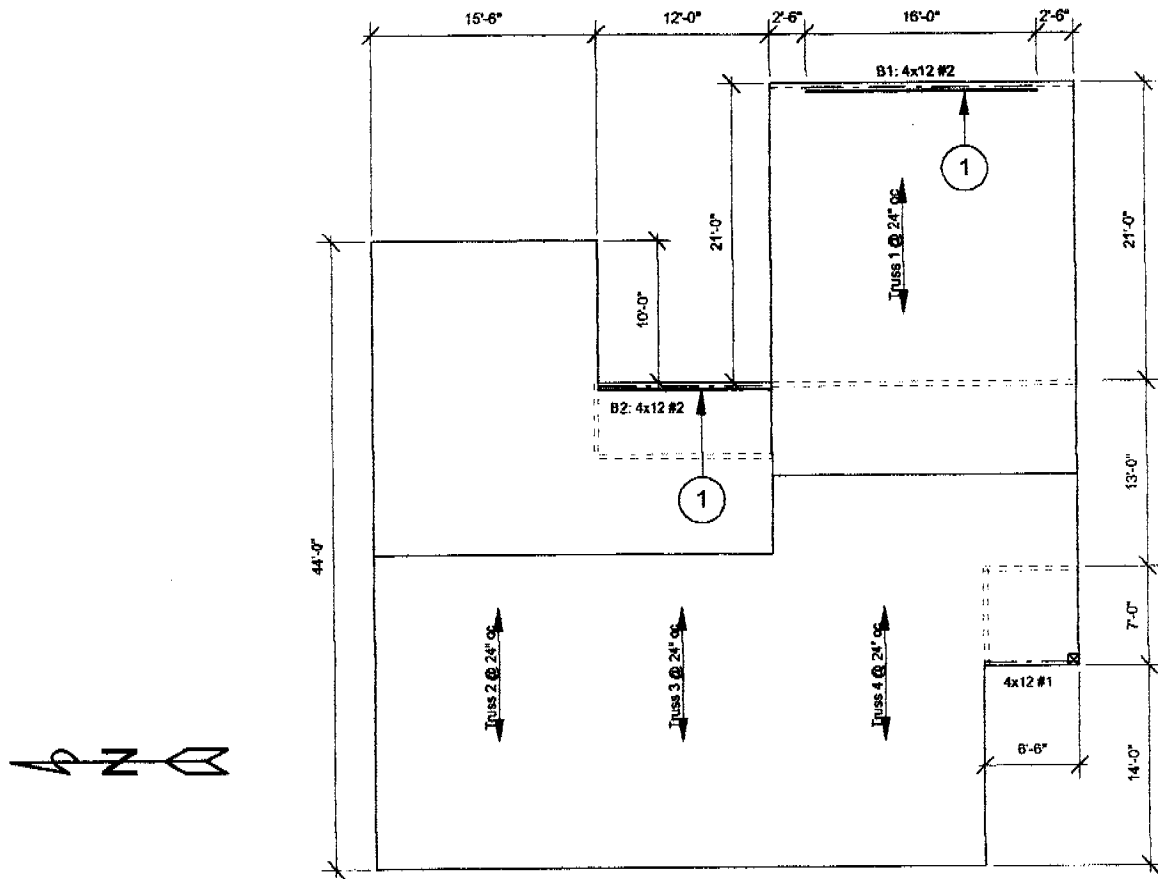


FRAMING NOTES:

1. Scab a 1 3/4" x 11 1/4" LVL to the existing 4x12 beam. See detail 2.


Notes:

- A. This is a reroof project. The new roofing material shall be a Light Weight Concrete Tile. The tile shall weigh less than or equal to 7.3 psf.
- B. All structural wood members that were observed appear to be in sound condition and without structural defect.


1 ROOF PLAN - CHU
Not to Scale 22

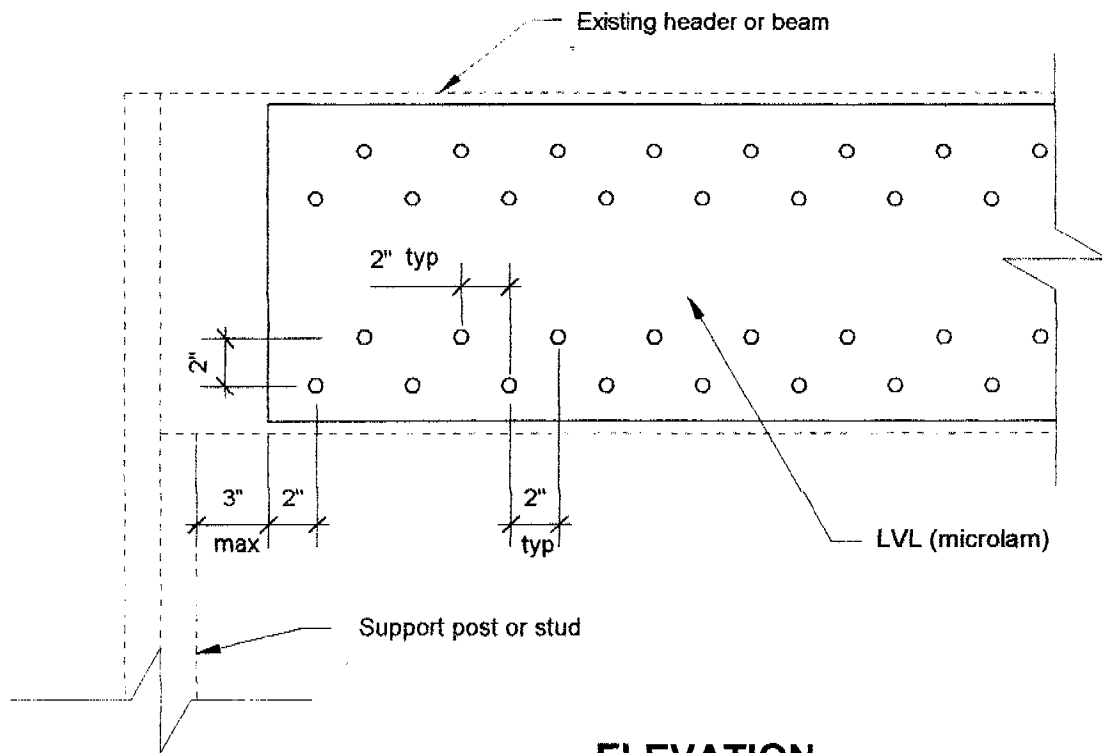

ELEVATION

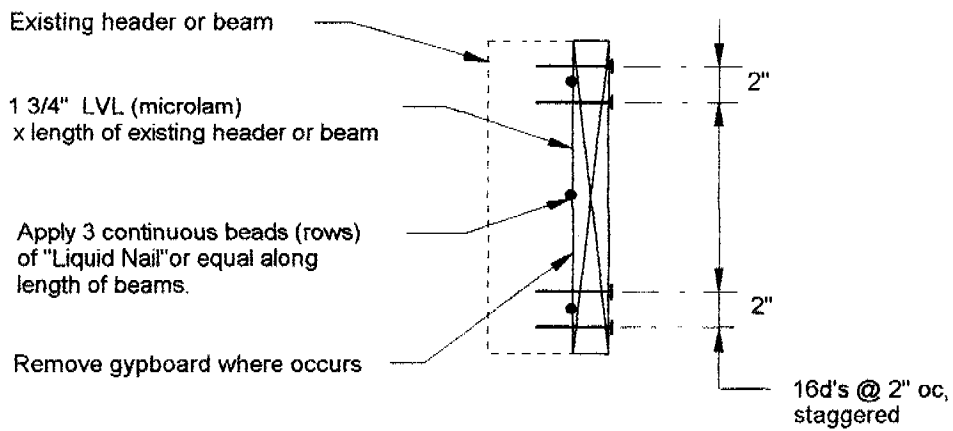

SECTION

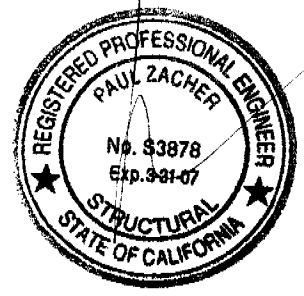

2

HEADER DETAIL

scale: 1 1/2" = 1'-0"