

CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 0112600

Insp Area: 3
Thos Bros: 318A1

Site Address: 5740 8TH AV SAC
Parcel No: 015-0142-011

Sub-Type: REP
Housing (Y/N): N

CONTRACTOR
CENTRAL PACIFIC ROOFING
PO BOX 2784
CITRUS HEIGHTS CA 95611

OWNER
HOLT SHERRIE
5740 8TH AVE
SACRAMENTO 95822

ARCHITECT

Nature of Work: TEAR OFF & REROOF 19 SQ'S W/ BAR LIGHT-WEIGHT TILE.

CONSTRUCTION LENDING AGENCY : I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C39 License Number 684576 Date 10-10-01 Contractor Signature [Signature]

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. _____ B & PC for this reason: OCT 01 2001
Date: _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 10-1-01 Applicant/Agent Signature [Signature]

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:
I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

[Signature] Carrier: STATE COMPENSATION INSURANCE F Policy Number 285-01 UNIT 0002166 Exp Date 01/01/2002

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 10-1-01 Applicant Signature [Signature]

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

Holt

Paul Zacher - Structural Engineer
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: (916) 961-3960
FAX: (916) 961-6552


November 13, 2001

Central Pacific Roofing
P.O. Box 2784
Citrus Heights, CA 95611-2784
TEL: (916) 726-1571; M:
FAX: (916) 726-1569

Attn.: Ben Gomez

re: Job 2001285: Holt located at 5740 8th Avenue, Sacramento, CA
subject: Attachment of new 2x6 purlin to existing 2x4 flat purlin

The new 2x6 purlin cannot be nailed to the existing 2x4 flat purlin per detail 2 of the report dated 9/12/2001. Therefore, nail the new 2x6 purlin to the existing 2x4 flat purlin with 16d's spaced at 12" on center in lieu of the 16d's @ 3" on center staggered per detail 2.

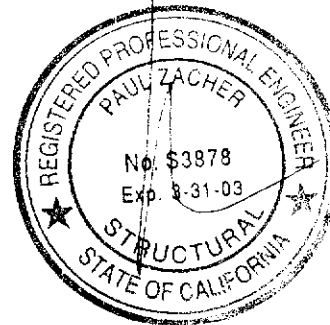

If you have any questions on the above, do not hesitate to call.

Sincerely,

A handwritten signature in black ink, appearing to read "Paul Zacher", written over a vertical line.

Paul Zacher, P.E., S.E.

PAUL ZACHER - STRUCTURAL ENGINEER

Holt



Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.

Living Area:

1. Provide additional 2x4 struts from the existing purlins to the bearing walls below. The maximum spacing between the new and existing struts shall not exceed 6'-0" on center. The unbraced length of the struts shall not exceed 8'-0" and the minimum slope of the struts shall not be less than 45 degrees from the horizontal. See detail 1.
2. Scab a 2x4 rafter to the existing 2x4 rafters with 16d's @ 12" on center where the span is greater than 7'-9". See detail 1.
3. Scab a 2x6 DF#2 x 32'-0" long purlin to the existing flat 2x4 purlin. See details 1 and 2.

Garage:

4. Scab a 1-3/4" x 9 1/4" x 14'-0" long LVL purlin to the existing 2x6 purlin which spans 14'-0". Attach it with 16d's @ 3" on center. Support the LVL to the bearing walls below with 2x4 struts. See details 1 and 2.

It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls that are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects that are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,

Paul Zacher, P.E., S.E.
file

LOADING


RAFTER

$Op = 10.7 \text{ pcf} \times 2' = 21.4 \text{ pcf}$

2x4 #2

$Lp = 16.0' \times 1.32 = 21.12'$

21.4/32




RAFTER

$Op = 10.7 \text{ pcf} \times 2' = 21.4 \text{ pcf}$

2x2 #2

$Lp = 16.0' \times 1.32 = 21.12'$

21.4/32




B1

$Op = 10.7 \text{ pcf} \times 2' = 21.4 \text{ pcf}$

4x4 #2

$Lp = 16.0' \times 1.32 = 21.12'$

21.4/32




B2

$Op = 10.7 \text{ pcf} \times 3' = 32.1 \text{ pcf}$

4x2 #2

$Lp = 16.0' \times 1.32 = 21.12'$

32/48




PURLIN

$Op = 10.7 \text{ pcf} \times 6' = 64.2 \text{ pcf}$

$Lp = 16.0' \times 1.32 = 21.12'$

64/96



DESIGN LOADING:

Roof Pitch 4 in 12
Pitch Adjustment Factor 1.05

LOCATION: ROOF

<u>MATERIAL</u>	<u>WEIGHT</u>	
Light Weight Tile	7.00	psf
Roofing felt	0.30	psf
In Fill 1x4 skip sht'g	2.19	psf
2x4 rafters @ 24" oc	<u>0.64</u>	psf
Load	10.1	psf
Roof Pitch Adjustment	<u>0.55</u>	psf
Total Load	10.7	psf

Paul Zacher - Structural Engineers
 4701 Lakeside Way
 Fair Oaks
 TEL: (916) 961-3960
 FAX: (916) 961-6552

Title :
 Dsgnr :
 Description :

Job #
 Date: 4:31PM, 13 SEP 01

Scope :

Rev. 510304
 User: KW-0602844, Ver 5.1.3, 22-Jun-1999, Win32
 (c) 1993-99 ENERCALC

Timber Beam & Joist

c:\enercalc\test.ecw\Calculations

Description RAFTERS AND BEAMS

Timber Member Information

Calculations are designed to 1997 NDS and 1997 UBC Requirements

Timber Section	rafter 2x4	rafter 2-2x4	B1 4x6	B2 4x12	purlin LVL:1.750x
Beam Width	in 1.500	3.000	3.500	3.500	1.750
Beam Depth	in 3.500	3.500	5.500	11.250	9.250
Le: Unbraced Length	ft 0.00	0.00	0.00	0.00	0.00
Timber Grade	Douglas Fir - Larch, Douglas Fir - Larch, Douglas Fir - Larch, Douglas Fir - Larch, Russ Joist - MacMil				
Fb - Basic Allow	psi 875.0	875.0	1,000.0	875.0	2,600.0
Fv - Basic Allow	psi 95.0	95.0	95.0	95.0	285.0
Elastic Modulus	ksi 1,600.0	1,600.0	1,700.0	1,600.0	1,900.0
Load Duration Factor	1.250	1.250	1.250	1.250	1.250
Member Type	Sawn	Sawn	Sawn	Sawn	Manuf/Pine
Repetitive Status	Repetitive	Repetitive	No	No	No

Center Span Data

Span	ft	7.75	9.75	13.00	8.00	14.00
Dead Load	#/ft	21.40	21.40	21.40	32.00	64.00
Live Load	#/ft	32.00	32.00	32.00	48.00	96.00

Results

Ratio = 0.8326 0.6589 0.4721 0.0865 0.5800

Mmax @ Center	in-k	4.81	7.61	13.54	7.68	47.04
@ X =	ft	3.87	4.87	6.50	4.00	7.00
fb : Actual	psi	1,570.9	1,243.2	767.1	104.0	1,884.9
Fb : Allowable	psi	1,886.7	1,886.7	1,625.0	1,203.1	3,250.0
		Bending OK	Bending OK	Bending OK	Bending OK	Bending OK
fv : Actual	psi	54.9	35.1	25.3	9.4	93.0
Fv : Allowable	psi	118.8	118.8	118.8	118.8	356.3
		Shear OK	Shear OK	Shear OK	Shear OK	Shear OK

Reactions

@ Left End	DL	lbs	82.92	104.32	139.10	128.00	448.00
	LL	lbs	124.00	156.00	208.00	192.00	672.00
	Max. DL+LL	lbs	206.92	260.32	347.10	320.00	1,120.00
@ Right End	DL	lbs	82.92	104.32	139.10	128.00	448.00
	LL	lbs	124.00	156.00	208.00	192.00	672.00
	Max. DL+LL	lbs	206.92	260.32	347.10	320.00	1,120.00

Deflections

Ratio OK Deflection OK Deflection OK Deflection OK Deflection OK

Center DL Defl	in	-0.203	-0.254	-0.167	-0.004	-0.252
L/Defl Ratio		459.1	461.2	935.8	21,629.9	666.0
Center LL Defl	in	-0.303	-0.379	-0.249	-0.007	-0.378
L/Defl Ratio		307.0	308.4	625.8	14,419.9	444.0
Center Total Defl	in	-0.505	-0.633	-0.416	-0.011	-0.631
Location	ft	3.875	4.875	6.500	4.000	7.000
L/Defl Ratio		184.0	184.8	375.0	8,652.0	266.4

Holt



Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

September 13, 2001

Central Pacific Roofing
P.O. Box 2784
Citrus Heights, CA 95611-2784
TEL: (916) 726-1571; M: (916) 825-5992
FAX: (916) 726-1569



Attn.: Mr. Ben Gomez,

re: Job 2001_285: HOLT

Subject: Structural Investigation Report of the Roof for the Residence located at 5740 8th Avenue, Sacramento, CA 95820.

As requested by Mr. Ben Gomez, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site September 13, 2001. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report are based on the 1997 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence.
Year Built: Estimated 1940's vintage.
Occupancy: Residential.
No. of Stories: One.
Dimensions: Approximately 1500 square feet with a first story plate height of 8 feet.

CONSTRUCTION:

Roof:
The roof covering will consist of a Light Weight Concrete Tile over in fill sheathing. The living area is conventionally framed with 2x4 rafters spaced at 24" on center with flat 2x4 purlins supported at no more than 6'-0" on center by 2x4 struts bearing on walls below. The garage area is framed with 2x4 rafters spaced at 24" on center and 2x4 cross ties spaced at 4'-0" on center.

CONCLUSIONS:

Roof:
The living and garage areas currently lack sufficient structural capacity for the applicable dead loads. See "Recommendations" for location and repair to bring the living and garage areas up to the required capacity.




This set of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the original set of plans and specifications without the approval of the City of Sacramento. See "Recommendations" for location and repair to bring the living and garage areas up to the required capacity.

The approval of this plan and specification is given subject to the approval of the City of Sacramento. The City of Sacramento, California.

Handwritten signature and date: 1/7/01

Vertical stamp: 10-1-01

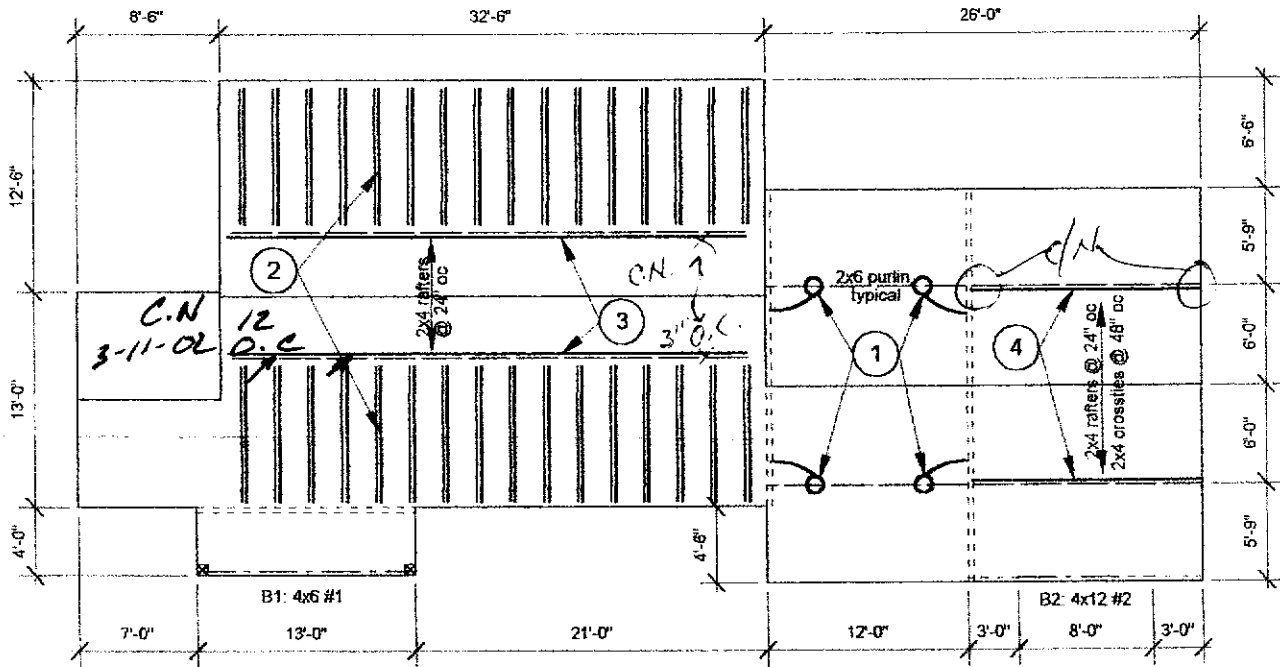

FRAMING NOTES:

1. Add 2x4 struts to bearing below (total 4).
2. Scab a 2x4 to existing 2x4 rafters where the span is greater than 7'-9" (total 32).
3. Scab a 2x6 DF#2 x 32'-0" long purlin to the existing flat 2x4 purlin. See detail 2.
4. Scab a 1-3/4" x 9-1/4" x 14'-0" long LVL purlin to the existing 2x6 purlin. See detail 2.

Notes:


- A. This is a reroof project. The new roofing material shall be a Light Weight Concrete Tile. The tile shall weigh less than or equal to 7.0 psf.
- B. All rafters are 2x4 DF#2 and hips and valleys are 2x6 DF#2 unless otherwise noted.
- C. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2320.1 "Roof and Ceiling Framing" unless otherwise shown.
- D. All structural wood members that were observed appear to be in sound condition and without structural defect.



ROOF PLAN - HOLT

Not to Scale

G

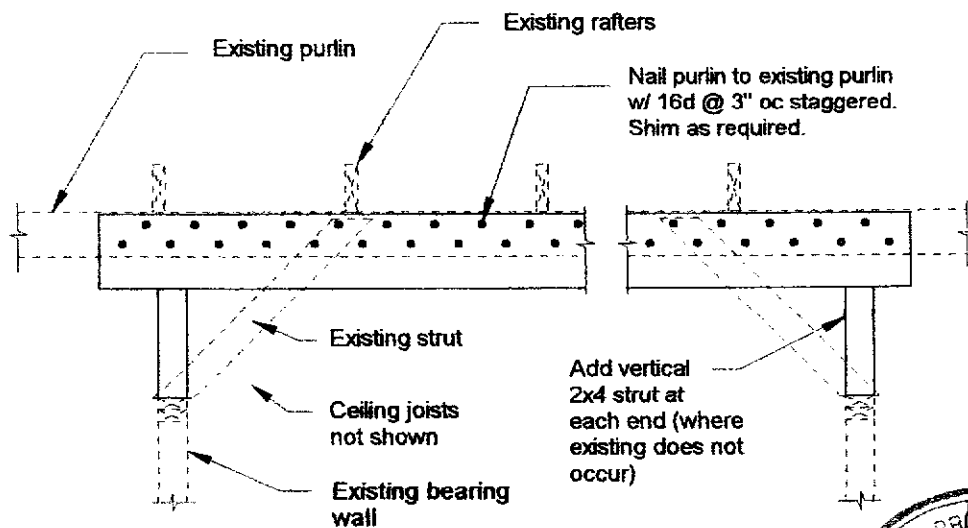

2

PURLIN DETAIL

scale: 1/2" = 1'-0"

