

**CITY OF SACRAMENTO**

**Permit No: 9811814**

**1231 I Street, Sacramento, CA 95814**

**Insp Area: 3**

**Site Address: 5750 SOUTH WATT AV SAC**

**Sub-Type: ACOM**

**Parcel No: 0620080062**

**Housing (Y/N):**

**CONTRACTOR**

JOHNSON PETROLEUM  
PO BOX 7169  
AUBURN CA

95604

**OWNER**

HUNT III WARREN N/ROSEMARIE A  
SACRAMENTO CA

95827

**ARCHITECT**

**Nature of Work: INSTALL ABOVE GROUND TANK**

**CONSTRUCTION LENDING AGENCY :** I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name \_\_\_\_\_ Lender's Address \_\_\_\_\_

**LICENSED CONTRACTORS DECLARATION:** I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class A License Number 6922393 Date 11-30-98 Contractor Signature Scott Johnson

**OWNER-BUILDER DECLARATION:** I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

\_\_\_\_ I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

\_\_\_\_ I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

\_\_\_\_ I am exempt under Sec. \_\_\_\_\_ B & PC for this reason: \_\_\_\_\_

Date \_\_\_\_\_ Owner Signature \_\_\_\_\_

**IN ISSUING THIS BUILDING PERMIT,** the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 11-30-98 Applicant/Agent Signature Scott Johnson

**WORKER'S COMPENSATION DECLARATION:** I hereby affirm under penalty of perjury one of the following declarations:

\_\_\_\_ I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier STATE FUND Policy Number 692-98 U 2899 Exp Date 10/01/1999

\_\_\_\_ (This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 11-30-98 Applicant Signature Scott Johnson

**WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.**

**THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.**

CITY OF SACRAMENTO  
APPLICATION FOR [REDACTED] BUILDING PERMIT

DEVELOPMENT SERVICES DIVISION  
PERMIT SERVICES SECTION

1231 I Street, Rm. 200  
Sacramento, CA 95814 (916) 264-7619 FAX 264-7046

PLAN CHECK # \_\_\_\_\_ Insp. Area \_\_\_\_\_

Applicant **MUST** complete ALL Unshaded areas this page only

ADDRESS 5750 South WATT Ave Suite \_\_\_\_\_

PARCEL # \_\_\_\_\_

<b>CONTACT</b> Name _____ Address _____ _____ Zip _____ Phone _____ FAX _____		<b>LICENSED CONTRACTOR</b> Lic No. # <u>692238</u> Name <u>Johnson Perrolan</u> Address <u>PO Box 7169</u> <u>Hayward CA</u> Zip <u>94600</u> Phone <u>510-878-6834</u> FAX _____	
<b>ARCHITECT/ENGINEER</b> Name _____ Address <u>2941 Sunrise Blvd</u> _____ Zip _____ Phone <u>916-244-4444</u> FAX _____		<b>OWNER</b> [REDACTED] Name <u>HUNT &amp; SONS</u> Address <u>5750 South WATT</u> _____ Zip _____ Phone <u>(916) 385-4868</u> FAX _____	

→ Will the permittee have any employees on the jobsite?  Yes  No

→ If yes, WORKER'S COMPENSATION POLICY # \_\_\_\_\_ EXPIRATION DATE: \_\_\_\_\_

NAME OF INSURANCE COMPANY: State Farm

NATURE OF WORK IN DETAIL: Excavate above ground diesel tank  
[REDACTED] - [REDACTED] - [REDACTED] wall

DBA: Hunt & Sons VALUATION: 10000<sup>00</sup>

FLOOD STATUS:			S.C.A.T.							
JOB DESCRIPTION		BLDG	SHEL	APT	TI( )	REM( )	SW	FIRE	ADD	OTH
INSP. DISCIPLINES			BLDG	MECH	PLUMB	ELEC	SITE		FIRE	
# Stories	1st flr Area	Total Area	Use Zone	Occp Group	Const type	Fire Req. Y/N		Fed Code	Vio. File	
						Spr	Alarm			
<u>B</u>	<u>L</u>	<u>P</u>	<u>M</u>	<u>E</u>	<u>F</u>	<u>S</u>		<u>D</u>	<u>R</u>	
<u>492 13 11/20/88</u>		<u>None JMT</u>		<u>no [unclear]</u>	<u>03</u>					

COMMENTS: Excav - provide location of panel - show how conduit & wires will be taken to tank. Provide electrical rating of pump and rating of circuit to be used.

REGIONAL SANITATION FEES?  Yes  No HEALTH DEPARTMENT?  Yes  No

BLDG PERM. REV 05/98)  WATER FLOW TEST FOR NEW BLDGS OR ADDITIONS  Yes  No



P.O. BOX 807, SAN FRANCISCO, CA 94101-0807

**CERTIFICATE OF WORKERS' COMPENSATION INSURANCE**

10-01-88

POLICY NUMBER: 892-88 UNIT 0002889  
 CERTIFICATE EXPIRES: 10-01-89

CITY OF STOCKTON, BUILDING DIVISION  
 ATTN: LAURA  
 425 EL DORADO  
 STOCKTON CA 95202

JOB: FILES

This is to certify that we have issued a valid Workers' Compensation insurance policy in a form approved by the California Insurance Commissioner to the employer named below for the policy period indicated.

This policy is not subject to cancellation by the Fund except upon 30 days' advance written notice to the employer.

We will also give you 30 days' advance notice should this policy be cancelled prior to its normal expiration.

This certificate of insurance is not an insurance policy and does not amend, extend or alter the coverage afforded by the policies listed herein. Notwithstanding any requirement, term, or condition of any contract or other document with respect to which this certificate of insurance may be issued or may pertain, the insurance afforded by the policies described herein is subject to all the terms, exclusions and conditions of such policies.

*Kenneth C. Bollier*  
 PRESIDENT

EMPLOYER'S LIABILITY LIMIT INCLUDING DEFENSE COSTS: \$1,000,000.00 PER OCCURRENCE.

ENDORSEMENT #2065 ENTITLED CERTIFICATE HOLDERS' NOTICE EFFECTIVE 10/01/88 IS ATTACHED TO AND FORMS A PART OF THIS POLICY

EMPLOYER

LEGAL NAME

JOHNSON PETROLEUM CONSTRUCTION,  
 INC.  
 P.O. BOX 7169  
 STOCKTON CA 95204

JOHNSON PETROLEUM CONSTRUCTION, INC.

PRINTED: 09-18-88 P0410

Anchorage Calcs

Design Parameters

Tank size = 10,000 gallons = 1337 Cu. Ft. (TS)  
Length = 352 in = 29.33 FT (L)  
Width = 112 in = 9.33 FT (W)  
Height = 112 in = 9.33 FT (H)

ISSUED

NOV 30 1998

CITY OF SACRAMENTO  
DEVELOPMENT SERVICES DIV

Concrete = 2000 psi @ 28 days (f'c)

Tank Weight (Dry) = 23,960 lb = 27.0 K (DW)

Calculations

Total WT = 27.0 + 89.6 = 116.6 K

Seismic Load = V = ZICpWp =  $\frac{.30(1.25)(2.75)}{1.0} (98.25) = 16.89 K$

OTM =  $16.89 \left( \frac{112}{2(12)} + \frac{10.25}{12} \right) = 93.3 K$

Max Shear in Bolts

$$V_B = \frac{16.89}{2(6)} = 1.41 \text{ Kips}$$

Max Tension Short Direction


$$T_B = \left( \frac{OTM}{W} - \frac{TW}{2} \right) / N = \left[ \frac{93.3}{9.33} - \frac{98.25}{2} \right] / 2 = \underline{\underline{-19.6 K}} \text{ No Tension}$$

Bolt Selection

3-5/8" φ Wedge Anchors w/ 3" Embedment and 4.0" Edge Distance OK

OR

6-3/4" φ Wedge Anchors w/ 3 3/8" Embedment 4.5" Edge Distance

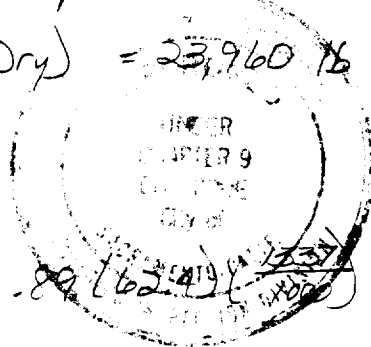

I, the undersigned, being a duly qualified Engineer in the State of California, do hereby certify that the above is a true and correct copy of the original as shown to me. I am not responsible for any errors or omissions in this document or for any consequences arising therefrom. The approval of this plan and specification SHALL NOT be taken to constitute approval of the violation of any City Ordinance or State Law.

*[Handwritten signature]*

# TruBolt Wedge Anchors

**Table 1.4.2 - TruBolt Shear Design Values in Stone Aggregate Concrete (Pounds)**

Anchor Diam D (in.)	Min. Embed. E (in.)	Edge Dist. m (in.)	Spacing Required S (in.)	Concrete Compressive Strength (psi)			
				2000	3000	4000	5000
1/4	1 1/8	1.500	4.000	240	265	290	310
3/8	1 1/2	2.250	5.250	615	675	735	795
		3.750	5.250	730	745	760	795
1/2	2 1/4	3.000	7.875	1085	1130	1175	1215
		5.000	7.875	1610	1770	1940	—
5/8	2 3/4	3.750	9.625	1580	1740	1900	2055
		6.000	9.625	2600	3235	3950	—
3/4	3 3/8	4.500	13.125	2095	2270	2440	2605
		7.500	13.125	3090	3705	4345	4935
7/8	4	8.000	14.000	—	4880	4915	4955
		—	—	—	6620	7495	8375
1	4 1/2	8.000	15.750	—	9135	9650	10170
		6	15.750	—	—	—	—
1 1/4	5 1/2	12.000	19.250	—	8485	9810	11135
		7 1/4	19.250	—	12210	13280	14350

- Notes
- The tabulated values in Tables 1.4.1 and 1.4.2 were obtained by applying a safety factor of 4 to 1 to the average ultimate test loads. A higher safety factor may be required for applications with cyclic, fatigue, or shock loads.
  - The average ultimate values are obtained from best fit straight lines drawn through means values of test data provided by an independent test laboratory.
  - The tabulated shear and tensile values are for anchors installed in concrete having the designated compressive strength at the time of installation.

**Table 1.4.3 - TruBolt Design Values in Lightweight Concrete (Pounds)**

Anchor Diam D (in.)	Min. Embed. E (in.)	Edge Dist. m (in.)	Spacing S (in.)	f'c = 2000 psi		f'c = 3000 psi		f'c = 4000 psi	
				Tension	Shear	Tension	Shear	Tension	Shear
1/4	1 1/8	2.000	4.000	285	325	330	390	380	440
3/8	1 1/2	2.625	5.250	500	810	610	980	710	980
		4.000	7.875	720	1600	880	1750	1040	1750
1/2	2 1/4	5.000	9.625	990	2630	1230	2750	1480	2750
		6.750	13.125	1310	2940	1620	3560	1950	3940



This set of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the same without written permission from the Building Inspection Division.

The applicant, contractor and specification shall not be held liable or approve the addition of any City Ordinance or State Law.

# MEMORANDUM

Sacramento Fire Department

To: BUILDING DEPARTMENT

Date: 12-22-98

From: Gordon Duncan,  
Fire Marshal

**Subject: FIRE SYSTEM INSPECTION**

A final inspection of the newly installed fire system at:

5750 S. WATT

has been conducted by Inspector H. Codge

on 12-17-98.

98-11814-C  
Permit Number

                      
Square Footage

AB Gen TK  
Type Inspection

The system is acceptable by this department.

R. Woodman  
By: Ross L. Woodman,  
Fire Prevention Officer II

98-328  
F. D. Reference Number




SINCE 1946

SUPPLIER OF PETROLEUM PRODUCTS & EQUIPMENT.

October 20, 1998

City of Sacramento  
Fire Department  
1231 I Street  
Sacramento, CA 95814

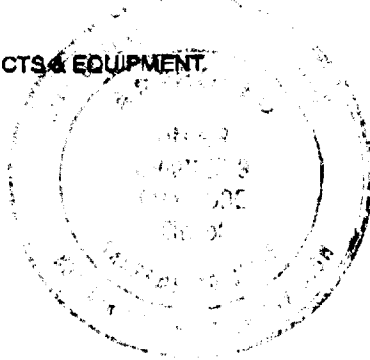

The undersigned hereby certifies that the above information is true and correct to the best of his knowledge and belief and that the same is in compliance with all applicable laws and regulations and that the same is in compliance with all applicable laws and regulations and that the same is in compliance with all applicable laws and regulations.

The approval of this plan and specification SHALL NOT be held to permit or approval the violation of any City Ordinance or State Law.

ISSUED

NOV 3 1998

CITY OF SACRAMENTO  
DEVELOPMENT SERVICES DIV.

**Re: Request for Variance for Installation of Aboveground Diesel Fuel Tank**

To Whom it May Concern:

We are writing today to request the variance needed to install the 10,000 gallon aboveground skid tank at our office and warehouse located at 5750 South Watt Avenue. This tank will be installed within the newly extended containment area we have at this facility where we have our bulk lube oil tanks.

Our above mentioned facility is a H3 Occupancy Warehouse designed with elevated doors to contain any spillage that may occur. It is also equipped with a foam injection fire sprinkler system.

We plan to store Red Dyed Diesel Fuel in this tank and we will use this product in our repackaging operation. The Red Dyed Diesel Fuel is diesel fuel that is dyed so it can be sold exempt of Federal Diesel Fuel Tax. It is for use in off highway equipment. The tank will not be used for refueling of trucks.

Please grant us this variance so that we may complete the installation of this tank. Give me a call if you have any questions or require any additional information to make your approval.

Sincerely,

*Warren Hunt*  
Warren Hunt  
Vice President

MUST COMPLY WITH UFL APP B F 55,  
LH2 7902.2

APPROVAL: *RCP*

POST OFFICE BOX 277670 • SACRAMENTO, CA 95827-7670  
SACRAMENTO (916) 383-4868 FAX (916) 383-1005 PLACERVILLE (916) 622-1551



Since 1977

**FAX COVER SHEET**

DATE: January 25, 1993

TO: **GEORGE LEON**

COMPANY: Town & Country

FAX NUMBER: 916-392-2005

FROM: **TOM HEARON**

Ace Tank & Equipment Co.  
 Dublin Boulevard  
 103  
 CA 94568

Toll Free	800-282-0028
Fax	510-803-2010
Local	510-803-2000
Direct	510-803-2005

Total pages sent: 4

If you do not receive all pages transmitted, please call as soon as possible.

SUBJECT: **SE Rycoff & Co.**

Hi George,

I've enclosed the basic tank submittal drawing which details the opening and tank dimensions. The tank support skids are constructed from 5" x 7", 1/4" thick sq. tubing. The skid / saddle support assembly is permanently welded to the tank. The complete tank and support assembly meets seismic zone 4 requirements.

The primary tank is completely enclosed by a pressure testable and monitorable secondary tank. The secondary tank has (2) 2" fpt openings at both ends for visual or electronic monitoring devices. The complete tank assembly is UL 142 listed and labeled.

When we talked on Friday you brought up the subject of 110% containment. This typically applies to open top dike tanks, or tanks that are not totally enclosed by the secondary tank. The extra 10% of containment is to insure that if the tank was completely filled and sprung a leak the secondary tank would hold it and any rain water that may have accumulated. Our tank, because of the tight wrap design does not require this. If there was a leak anywhere in the primary tank, the secondary tank

Portland, Oregon

Seattle, Washington

Dublin, California

5125 NE Portland Highway, 97218  
 (503) 284-5599  
 Fax: (503) 284-5129

10000 1st Avenue, S.W.  
 Seattle, WA 98148  
 (206) 461-1177

11875 Dublin Blvd, Suite A-103 94568  
 (510) 803-2000  
 Fax: (510) 803-2010




would contain it, and because of the secondary shell totally enclosing the first shell, we don't have to worry about rain water or any other debris.

In addition to the safety benefits of the tightwrap, the system that was quoted has a positive shut-off valve in the low fill assembly that would stop the delivery at 95% capacity of the tank. The dispenser and low fill assembly are mounted in and above the skid containment basin. This skid containment basin will prevent ground contamination during dispenser maintenance such as filter or nozzle changing.

SEE ATTACHED

Please call if you have any further questions.



Best regards,



Tom Hearon

**10,000 Gallon Tank**  
 Part No. AC10000U2K1

**ABOVEGROUND  
 DOUBLEWALL, UL LISTED**

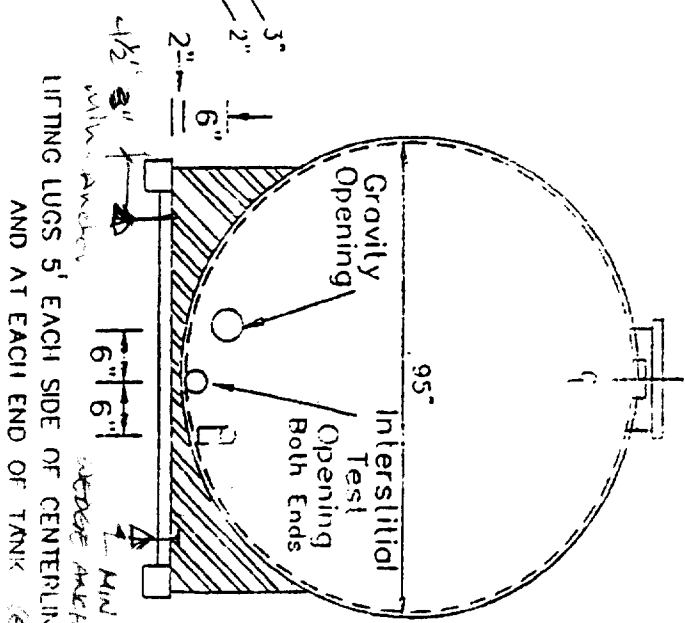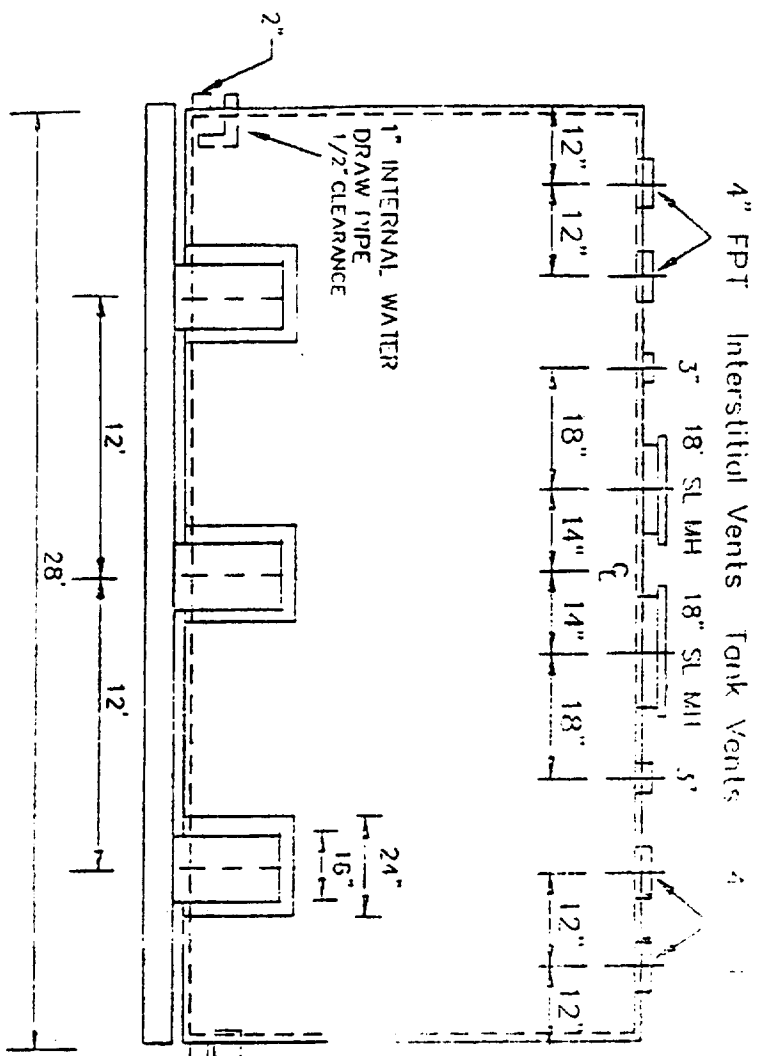

**NOTICE**  
 THIS PRINT AND THE INFORMATION CONTAINED HEREIN IS PROPRIETARY TO ACE TANK & EQUIPMENT CO. AND SHALL NOT BE REPRODUCED OR DISCLOSED IN WHOLE OR IN PART, NOR USED FOR ANY DESIGN OR MANUFACTURING PURPOSES, UNLESS AUTHORIZED IN WRITING BY ACE TANK & EQUIPMENT CO.

- Overall Height: 109"
- Weight: 15,475 lbs.
- Inner Tank Gauge: 2
- Openings are female NPT.
- Before coating, tank shall be tested and proved tight under a test pressure between 5 and 7 psi.
- Exterior coating is red iron oxide primer.
- Tanks shall bear the UL label for Aboveground Doublewall tanks.

*Drawing is not to scale. Weight & measurements are approximate.*

<b>ACE TANK &amp; EQUIPMENT CO.</b>		
SEATTLE • PORTLAND • HAYWARD		
FOR:		
JOB:		
<b>NOT TO SCALE</b>		
INVOICE #	○	<b>REQUIRED</b>
DATE	SALESPERSON	

CUSTOMER APPROVAL SIGNATURE

**Sample Specification - UL Double Wall Aboveground Horizontal Tank**

Provide a horizontal aboveground steel storage tank with the outer tank completely surrounding the primary tank. Both primary and secondary tanks are factory pressure tested at minimum 5 psi for tightness. Entire tank system is UL listed and meets seismic zone 4 requirements. Both the primary tank and the secondary tank are provided with normal and emergency vents as required by UL. An integral steel foundation is optional. Openings for filling, product removal, monitoring, drains, access and tank gauging are sized as appropriate for each tank. Tank has red prime exterior coating with optional sandblast and enamel paint.

Seattle (206) 281-5000 • Portland (503) 284-5505 • Bay Area (510) 881-0837  
 (800) 426-2880 (800) 452-7437 (800) 282-0028



Since 1937

October 19, 1992

Page 1 of 6

John Durham  
S.E. Rychkoff & Co.

Phone: (213) 486-9195  
Fax: (213) 486-~~9799~~  
9779

REF: SACRAMENTO TERMINAL - DIESEL ABOVEGROUND REFUELING SYSTEM

Dear John:

I appreciate the opportunity to quote on your diesel refueling project in Sacramento. Please note that a majority of the equipment is premounted on the tank prior to shipping. On this system there is no wiring or conduit that is included, your installation contractor must supply and install all electrical.

At the end of the quote I have listed a page of optional accessories that should be considered for your new fueling site. Your installation contractor may or may not be supplying some of these items.

We are pleased to quote the following:

**ABOVEGROUND ACEWRAP FUEL STORAGE TANK**

**DIESEL:**

- 1 AC10000U2KX, Ace Tank Manufactured 10,000 gallon, aboveground UL 142 labeled tight-wrap tank designed for storage of Class I & Class II petroleum liquids. Overall dimensions of 95"D x 28'L x 109"H weighing 15,475 lbs, less equipment. Tank has integral saddle/skid assembly that meets seismic zone 4 requirements. Interior to be bare steel with exterior to be red oxide primer. Tank includes:

- \* 3' skid extension w/4" containment rim, dispenser bracket and piping.
- \* End or side mounted ladder.

Portland, Oregon

6225 NE Portland Highway, 97218  
(503) 284-5505  
Fax (503) 284-5529

Seattle, Washington


1143 Elliott Avenue West, 98119  
P.O. Box 9039, 98109  
(206) 281-5900  
Fax (206) 281-5900

Dublin, California

11875 Dublin Blvd, Suite A-103, 94568  
(510) 803-2000  
Fax (510) 803-2010

AceWrap 10000 Gallon Aboveground Diesel Fueling System

AB C D E A B F G H I J K L A

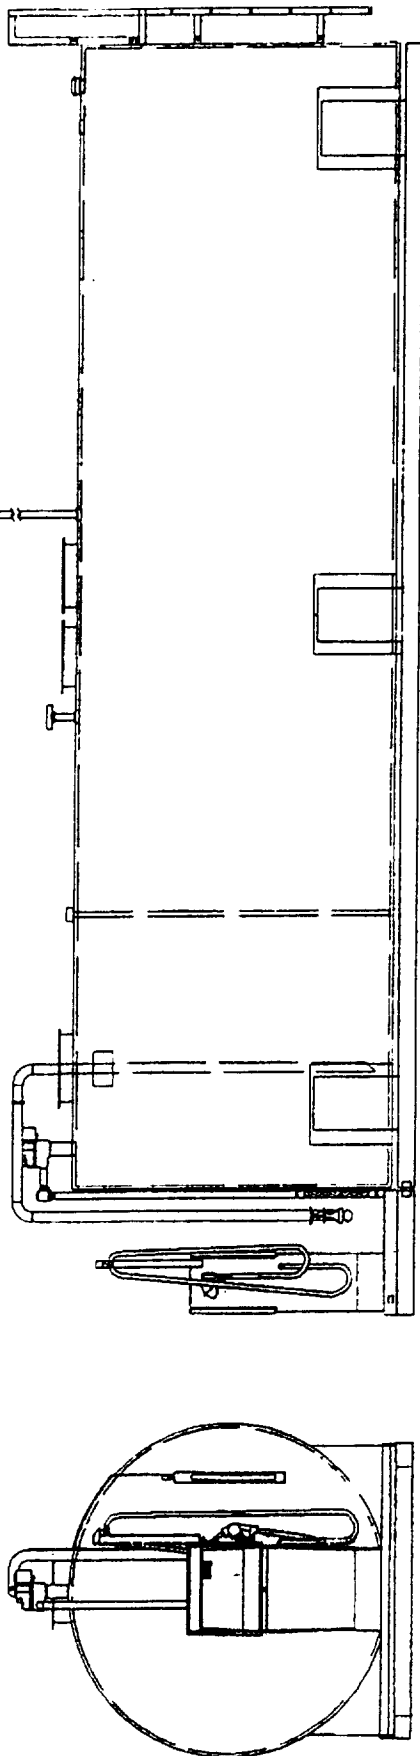

TANK: AC10000L2KX Ace Wrap Double Wall  
UL-Listed Petroleum Storage Tank

- A Bennett Dispenser
- B Red Jacket Submersible Pump
- C 3' Low Fill Assembly
- D Petrometer Tank Level Gauge
- E 4' Skid Extension
- F CBSLO Overfill Limiter Valve
- G Gauge Pressure Ball

- H Annular Space Normal Vent
- I Annular & Emergency Venting
- J Primary Tank Normal Vent
- K Spare
- L Sounding Port
- A Ladder



**ACE TANK &  
EQUIPMENT CO.**

PORTLAND - SEATTLE - PORTLAND

FOR: SE Rycroft

DATE: 1-4-93 SLSM: TH

DRAWING: 10KU2KG


NOTICE: This print and the information contained herein is proprietary to Ace Tank & Equipment Co. This drawing is for general descriptive purposes only. It is not a submittal drawing and its accuracy is not guaranteed.

# CONSTRUCTION KEY NOTES

1. ALL CONSTRUCTION IS EXISTING AND TO REMAIN UNLESS NOTED OTHERWISE.
2. CONTRACTOR SHALL SAWCUT AND REMOVE A.C. PAVING AND CONCRETE AS REQUIRED BY NEW WORK.
3. CONTRACTOR SHALL CONSTRUCT NEW 7" THICK CONCRETE TANK SLAB, WITH #4 REBAR AT 12" O.C., EACH WAY, AT MID-SLAB AT EACH TANK SUPPORT. CONTRACTOR SHALL PATCH AND/OR REPAIR EXISTING A.C. PAVING AS REQUIRED BY NEW WORK.
4. CONTRACTOR SHALL INSTALL NEW 10,000 GALLON, DOUBLE WALL, STEEL, ABOVE GROUND TANK AS MANUFACTURED BY ACE TANK. TANK SHALL BE ANCHORED TO CONCRETE AT SIX PLACES AS SPECIFIED BY TANK MANUFACTURER. CONTRACTOR SHALL INSTALL NEW METER, FILL CONNECTION FOR LOADING OF BARRELS OF DIESEL OIL FOR DISTRIBUTION IN ADDITION TO OTHER OILS NOW DISTRIBUTED.
5. CONTRACTOR SHALL INSTALL TANK TURBINE WITH NEW PIPING, METER AND BARREL FILLER.
6. CONTRACTOR SHALL CONSTRUCT 6"x6" A.C. PAVING BERM, FOR SPILL CONTAINMENT, AT PERIMETER OF NEW TANK.

NO.	REVISION	DATE	BY	APP.

REVISIONS



**TAIT & ASSOCIATES, INC.**  
 Orange, CA • San Diego, CA • Concord, CA • Phoenix, AZ • Tucson, AZ

These drawings, designs, sketches, ideas and arrangements are the sole and exclusive property of TAIT & Associates, Inc. and shall not be reproduced, copied, lent or disposed of directly or indirectly nor used for any purpose other than that for which they were specifically furnished without the written consent of TAIT & Associates, Inc. and must be returned to TAIT & Associates, Inc. on completion of work, if requested. Copyright © TAIT & Associates, Inc.

2880 Sunrise Boulevard  
 Suite 206  
 Rancho Cordova, CA 95742  
 (916) 635-2444  
 (916) 635-2606 Fax

N 00° 04' 11" W 222.53'

**TANK INSTALLATION**  
**HUNT & SONS, INC.**  
**5750 WATT AVENUE &**  
**OSAGE AVENUE**  
**SACRAMENTO, CALIF.**

- Show Detail of how Tanks will be Anchored (Provide SIDS, DEPT)

**NOTES:**


- MUST comply with UFC 7902.2
- ~~As per [unclear] [unclear]~~
- All electrical permits must be obtained from the SACRAMENTO city building Dept.

*Richard*

1 1 9 8

N 89° 56' 45" W 381.91'

N 89° 56' 45" W 348.73'

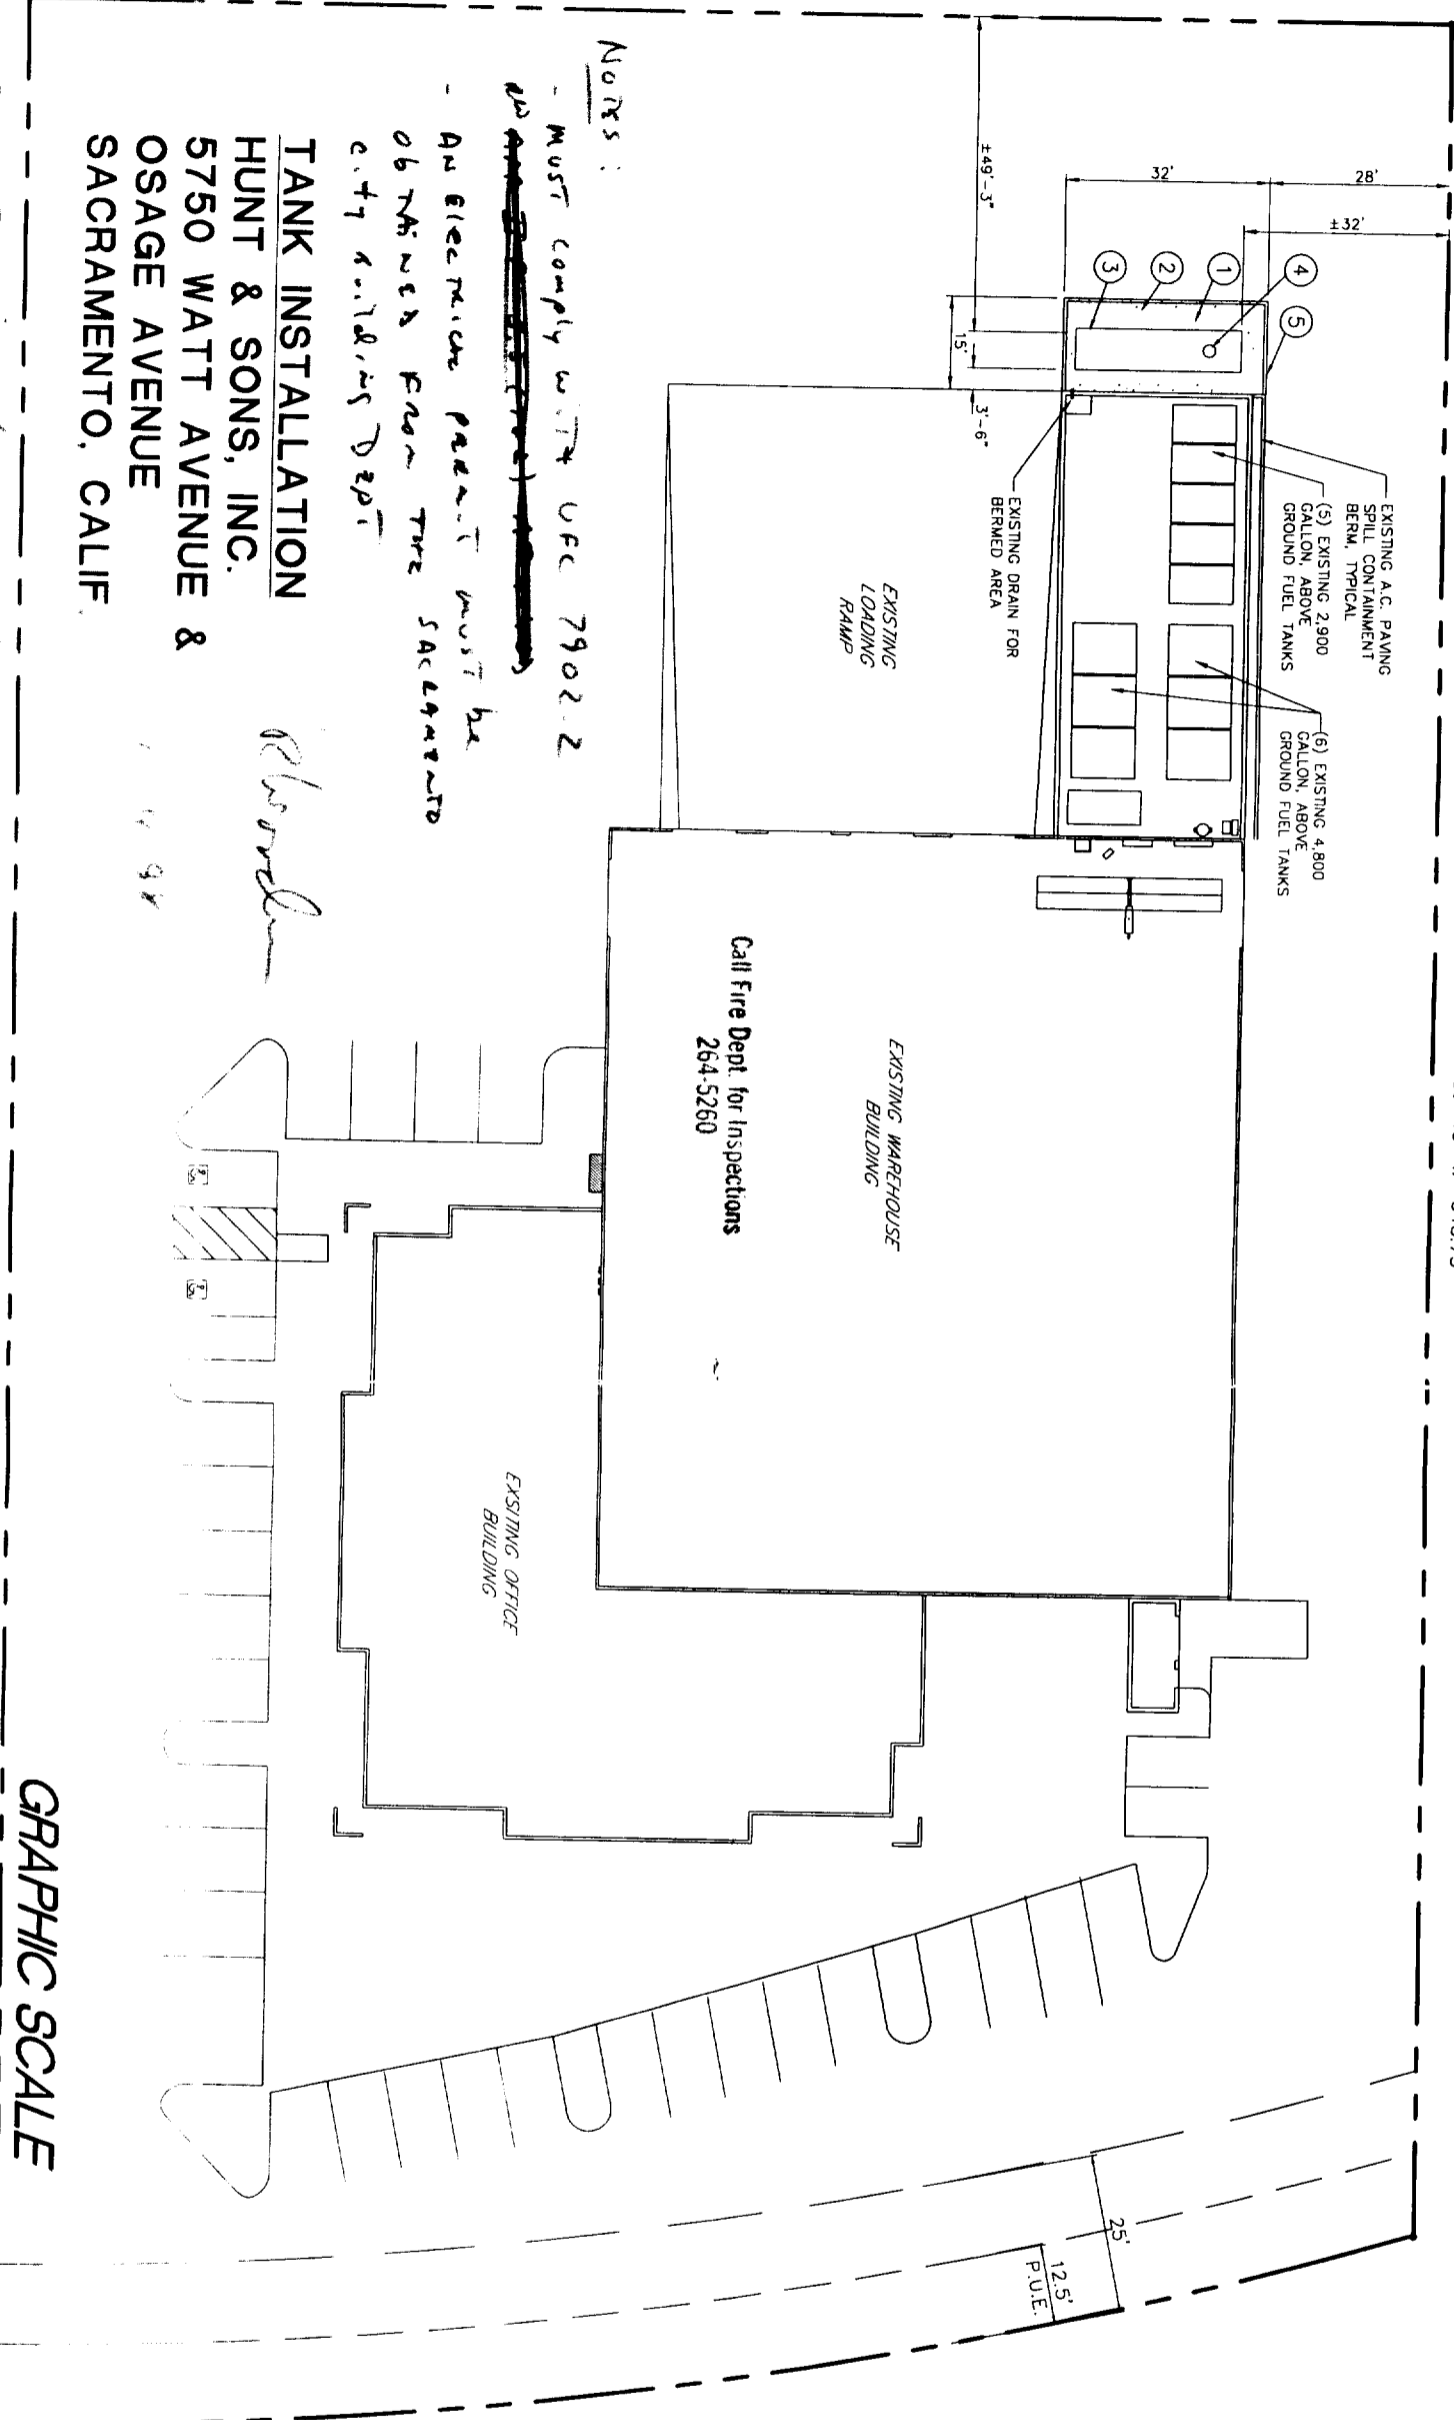

**GRAPHIC SCALE**

