

CITY OF SACRAMENTO

Permit No: 9802355

1231 I Street, Sacramento, CA 95814

Insp Area: 3

Site Address: 6600 ASHER LN SAC

Sub-Type: COM

Parcel No: 0640026085

Housing (Y/N): N

CONTRACTOR

ULTIMATE SECURITY
1401 W EL CAMINO AV
SAC CA 95815
Phone: 388-3800

OWNER

STEVE FANN, RANDY ROBERTS
6600 ASHER LN
SAC CA 95828
Phone: 383-7525

ARCHITECT

Phone:

Nature of Work: FIRE ALARM AND FIRE SPRINKLER MONITORING

CONSTRUCTION LENDING AGENCY: I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name Lender's Address

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C-10 License Number 729944 Date 3/25/98 Contractor Signature [Signature]

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his or her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he or she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. B & PC for this reason:

Date Owner Signature

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

Date 3-25-98 Applicant/Agent Signature [Signature]

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

X I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier Auster Insurance Policy Number WCOI-866-01583

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 3-25-98 Applicant Signature [Signature]

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

CITY OF SACRAMENTO
 APPLICATION FOR BUILDING PERMIT
 DEPARTMENT OF PLANNING AND DEVELOPMENT
 BUILDING INSPECTION DIVISION
 1231 I Street, Room 200
 Sacramento, CA 95814
 (916) 264-7619 FAX 264-7046

ADDRESS 6600 Asher Lane Sacramento Ca 95828 P.C. # _____
 PARCEL # _____ SUITE # _____
 AREA # _____

CONTACT
 NAME Randy Roberts
 ADDRESS _____
 ZIP _____
 PHONE _____ FAX: () _____

LICENSED CONTRACTOR Lic # 729944
 NAME Ultimate Home Security
 ADDRESS 1401 El Camino Ave 101B
Sacramento Ca ZIP 95815
 PHONE (916) 338-3800 FAX (916) 649-3899

ARCH./ENG.
 NAME _____
 ADDRESS _____
 ZIP _____
 PHONE _____

OWNER
 NAME _____
 ADDRESS _____
 ZIP _____
 PHONE () - FAX () -

WILL THE PERMITEE HAVE ANY EMPLOYEE'S ON THE JOBSITE? YES NO

NATURE OF WORK IN DETAIL: Install and monitor fire alarm
panel for water flow at water flow switch or post indicator
switch. Install outside fire bell.

D.B.A. _____ VALUATION 995⁰⁰
BELOW THIS LINE FOR BLDG. DEPT. USE ONLY

FLOOD STATUS _____ S.C.A.T. _____

JOB DESCR. BLDG SHEL APT TI() REM() SW FIRE ADD OTH
 INSP. DISCIPLINES BLDG MECH PLUMB ELEC SITE FIRE

# OF STORIES	AREA 1ST FL.	TOTAL AREA	OCCUP. GROUP	CONST. TYPE	FIRE SPRINK.	FIRE ALARM	FED. CODE	VIO. FILE
					Y	Y		
B	L	P	M	E	F	S	D	R
					13 EHC			
					3-25			

COMMENTS: _____

Worker's Comp Policy #
Company

Exp. Date

NOTI FIRE 911A / 911AC

Fire Control / Communicator

GENERAL

The 911A and 911AC are three-zone Digital Alarm Communicator Transmitter (DACT). Models are available for limited stand-alone applications or in slave applications for off-premises monitoring of an existing Fire Alarm Control Panel (FACP).



S624


MEA

12-92-E



California
State Fire
Marshal

7165-0075:152

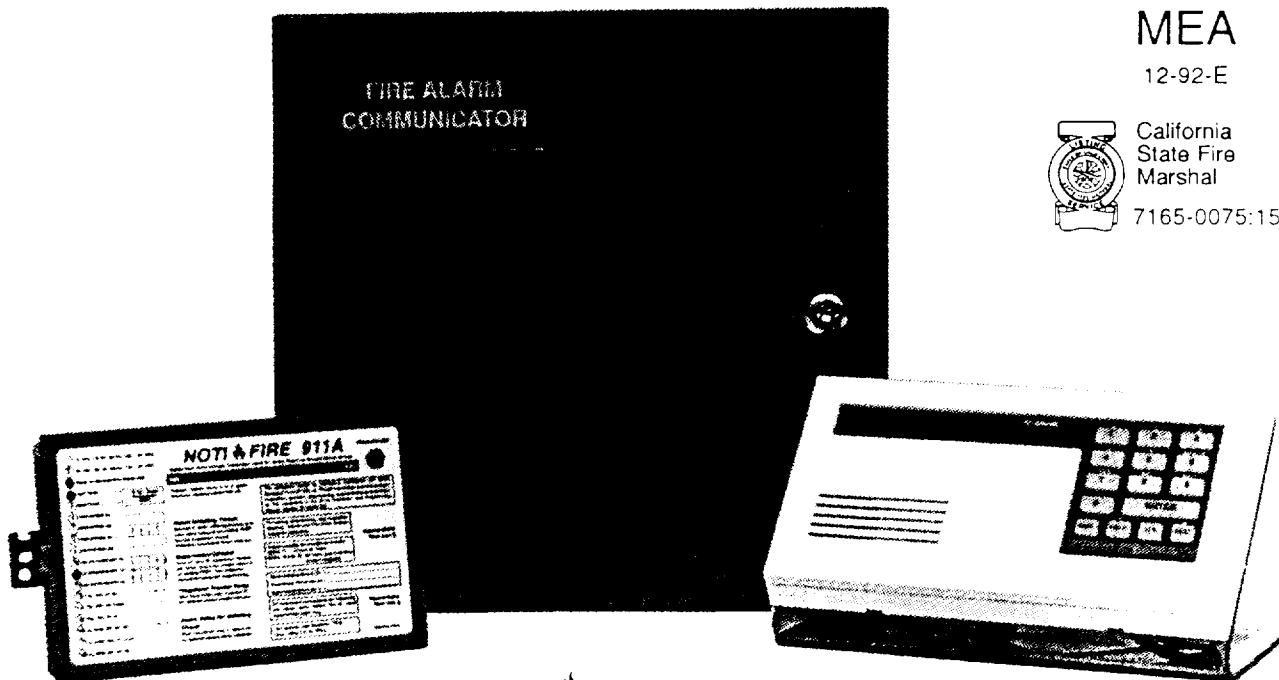

NOTI  FIRE 911A

NOTI  FIRE 911AC

NOTI  FIRE DS050
(Not UL-Listed)

FEATURES

- Three-Zone Digital Alarm Communicator Transmitter.
- UL listed for NFPA 71 and NFPA 72C applications as a control unit or control unit subassembly for digital fire signaling systems.
- Can be used as a stand-alone communicator for sprinkler systems or as a slave communicator for existing fire systems.
- UL listed as power-limited.
- Optional Telephone Trouble Relay for connection to an external annunciation device.
- Optional Alarm Relay for annunciation of Zone 1 Alarm Initiating Circuit.
- Dual telephone lines for Central Station reporting.
- Primary and alternate telephone numbers.
- Built-in telephone trouble LED and buzzer.
- Compact size and easy to install.
- Communicates using BFSK or pulsed single-round fast format (accepts 2,300 Hz acknowledgment tone).
- Automatic test reports every 24 hours.

ISSUED

MAR 25 1998

CITY OF SACRAMENTO
DEVELOPMENT SERVICES DIV



12 Clintonville Road
Northford, CT 06472
Phone: (203) 484-7161
FAX: (203) 484-7118

DF-51177
Page 1 of 2
July 7, 1993



California Department of Forestry & Fire Protection
Office of the State Fire Marshal
PreFire Engineering
LISTING SERVICE

**Listing Expires
June 30, 1998**



LISTING No.

7165-0075:152

Page 1 of 2

CATEGORY:

Control Unit (Non-High Rise)

LISTEE:

Fire Lite, 12 Clintonville Road, Northford CT 06472-1653
Contact: Larry Flood (203) 484-7161

DESIGN:

Model NOTI-FIRE 911A and Model 911AC kit. Stand-alone or slave applications. Inherently power-limited; automatic or manual; sprinkler supervisory and waterflow alarm service. Refer to listee's data sheet for detailed product description and operational considerations. Model 911AC kit includes:

911A	module
D2002	mounting plate
A9115	transformer
PS1270, D1219	standby battery
4103R	enclosure

OPTIONS:

Refer to listee's data sheet for required/optional accessories. When required, accessories shall be CSFM listed. Accessories included in this listing:

PS1270	battery
D1219	battery
D136	relay (K5) (K6)
D161, D162	phone cord
D1220	transformer
D4103R, D4103, D8109	enclosure
D8004	transformer enclosure

ISSUED

MAR 25 1998

CITY OF SACRAMENTO
DEVELOPMENT SERVICES DIV

INSTALLATION:

In accordance with the listee's printed installation instructions and applicable codes and ordinances.

MARKING:

Listee's name, model number, electrical rating and UL label.

This listing is based upon technical data submitted by the applicant. CSFM staff has reviewed the test results and/or other data but does not make an independent verification of any claims. This listing is not an endorsement or recommendation of the item listed. This listing should not be used to verify correct operational requirements or installation criteria. Refer to listee's data sheet, installation instructions and/or other suitable information sources.

ISSUED: JULY 1, 1997

Effective issue date to expiration date

AUTHORIZED BY:

Deputy **BEN Q. HO**
Program Coordinator



**american
security
equipment
company**

Corporate Office & Warehouse
228 E. Star of India Lane
Carson, California 90746
Phones: (213) 538-4670
(800) 421-1096
Telex: 69-8241
FAX: (213) 538-9932


N. J. Office & Warehouse
P.O. Box 808
30 Chapin Road Bldg. F
Pine Brook, N.J. 07058
Phone: (201) 575-4433
FAX: (201) 575-5504

California State Fire Marshal Listing Number 7135-587:2

EXB Series

Fire Alarm Bells

4 Wire Version with Varistor Suppression

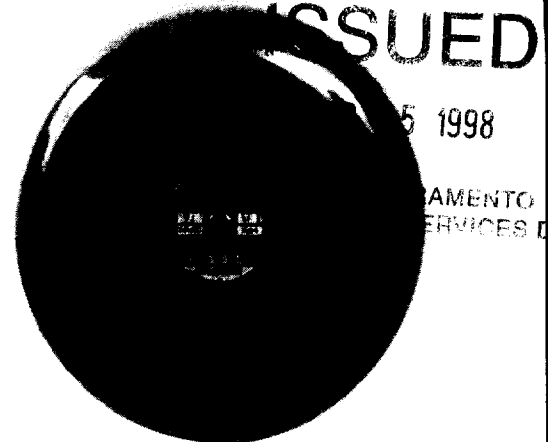

The EXB series bells are conventional type two coil assembled vibratory bells that comply with the new UL Standard 464 for 4 wire installation.



A special feature of the EXB series bells is the VARISTOR SUPPRESSION ELEMENT assembled between the coils to reduce RFI and back EMF noise problems. The reduction of the RFI and back EMF noise problems are essential in todays highly integrated control panels.

The two coil vibrator produces a low current power consumption with high sound output.

All DC bells are polarized for use in supervised fire alarm systems and are provided with 4 lead wires.

The base is cast aluminum and completely encloses the bell mechanism.

The EXB bell can be mounted on either a 4" standard electrical box or weatherproof back box, BBX-1 or BBX-4, for outdoor use.

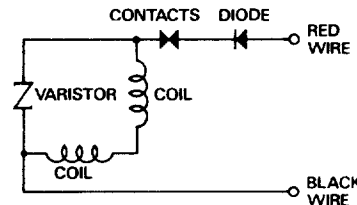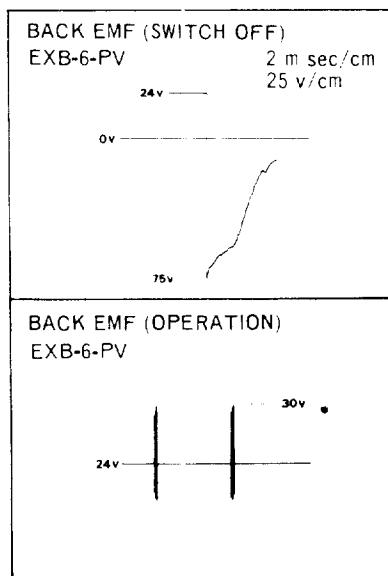

■ SUPPRESSION CIRCUIT EXB-6-PV

RFI (3 Meter Method)

Frequency (MHz)	Background Noise (dB)	MSB-6B-PV
		Field Intensity (dB)
50	12	21
70	17	17
100	19	23
150	23	23
200	25	35

The field noise intensity denotes that of electric noise.
dB/at 3M dB:1mV/m-0dB



California Department of Forestry & Fire Protection
Office of the State Fire Marshal
PreFire Engineering
LISTING SERVICE

**Listing Expires
June 30, 1998**



LISTING No: 7135-0587:002 Page 1 of 1

CATEGORY: Audible Signal Device

LISTEE: American Security Equipment, 228 E. Star of India Ln, Carson CA 90746
Contact: Toby Tabata (213) 538-4670

DESIGN: Model EXB-6, EXB-8 and EXB-10 series. Refer to listee's data sheet for detailed product description and operational considerations.

INSTALLATION: In accordance with listee's printed installation instructions and applicable codes and ordinances.

MARKING: Listee's name, model number, electrical rating and UL label.

APPROVAL: Listed as audible devices for use with separately listed compatible control units.

ISSUED
MAR 25 1998
CITY OF SACRAMENTO
DEVELOPMENT SERVICES DIV.

This listing is based upon technical data submitted by the applicant. CSFM staff has reviewed the test results and/or other data but does not make an independent verification of any claims. This listing is not an endorsement or recommendation of the item listed. This listing should not be used to verify correct operational requirements or installation criteria. Refer to listee's data sheet, installation instructions and/or other suitable information sources.

ISSUED: JULY 1, 1997
Effective issue date to expiration date

AUTHORIZED BY:

Deputy **BEN Q. HO**
Program Coordinator

MEMORANDUM

Sacramento Fire Department

To: BUILDING DEPARTMENT

Date: 4-20-98

From: Gordon Duncan,
Fire Marshal

Subject: FIRE SYSTEM INSPECTION

A final inspection of the newly installed fire system at:

6600 ASTER LANE


has been conducted by Inspector H. Cooke

on 4-17-98.

Permit Number 98-02355-C

The system is acceptable by this Department.

FIRE ALARM
Type Inspection


By: Ross L. Woodman,
Fire Prevention Officer II

98-45
F. D. Reference Number

ULTIMATE SECURITY
P.O. BOX 60100
SACRAMENTO, CA 95860
(916) 338-3800


C-10: 729944

Asher Lane



This set of plans and specifications must be kept on file at all times and it is unlawful to make any changes or alterations from the same without the permission from the Building Inspection Division.

The approval of this plan and specification shall not be held to permit or approve the violation of any City Ordinance or State Law.

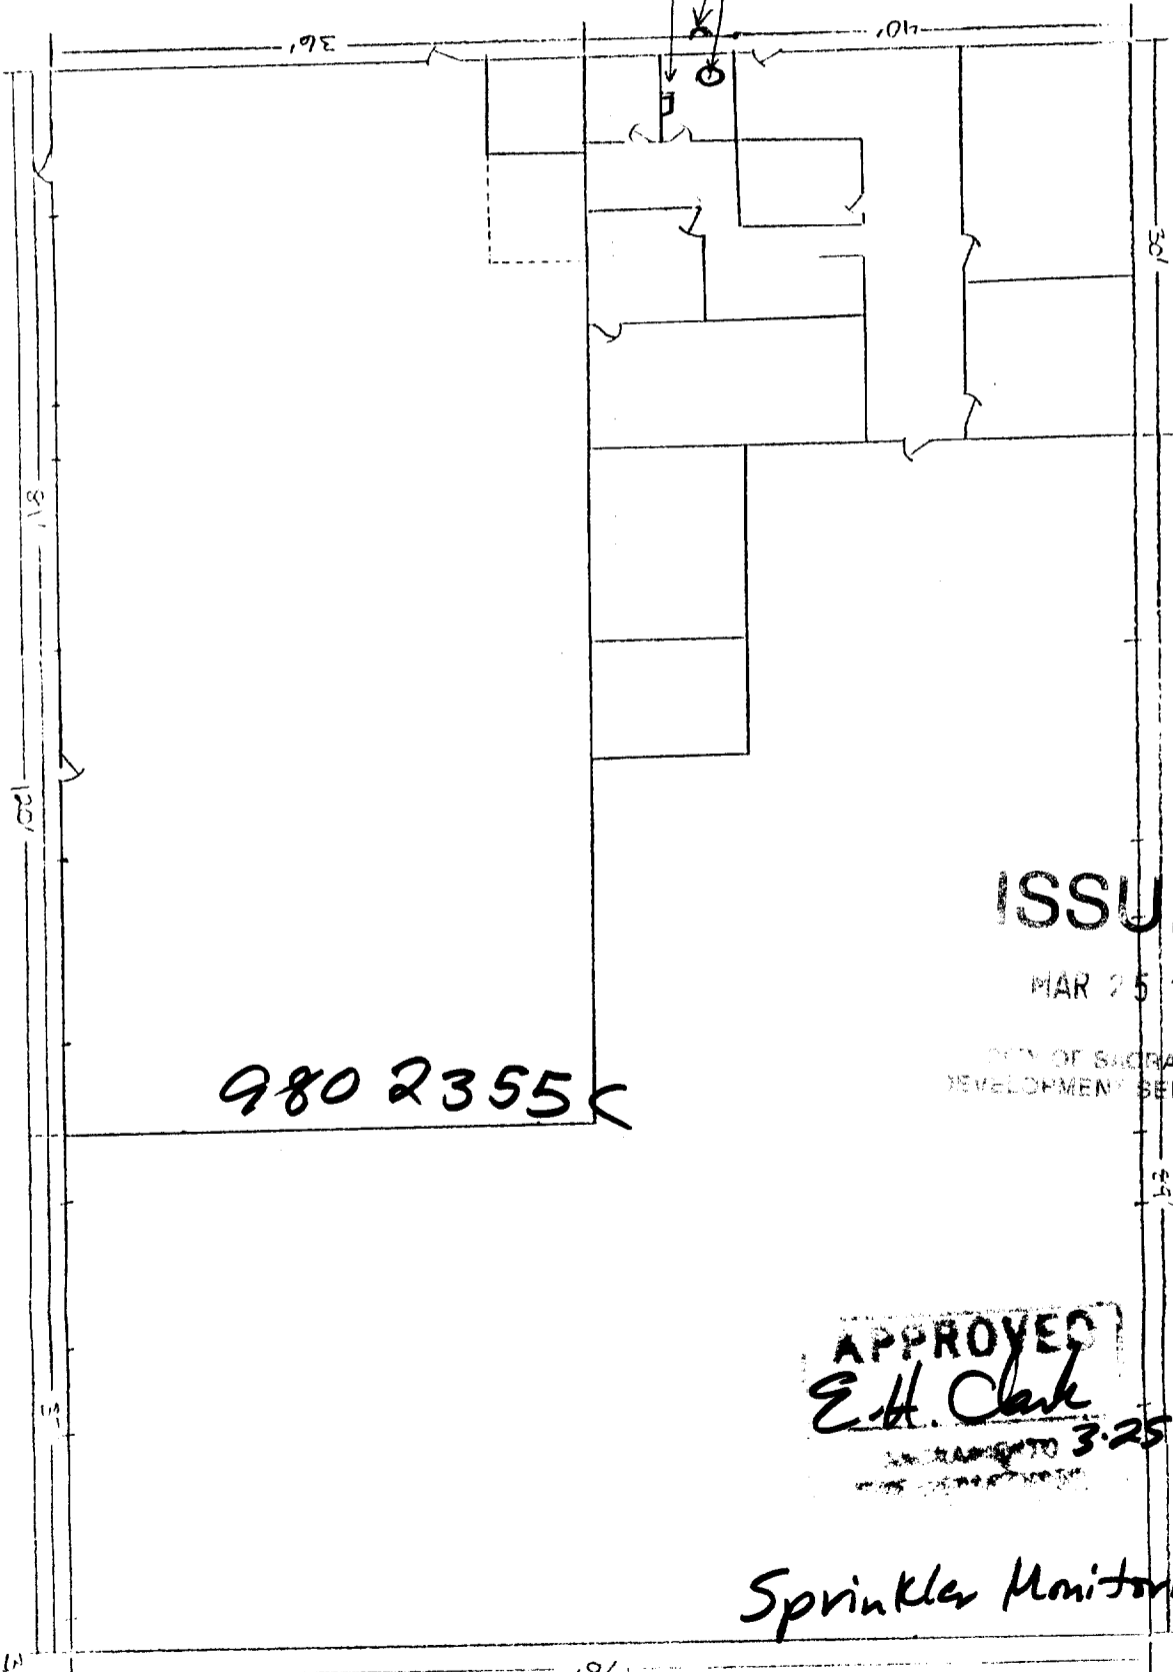

ISSUED

MAR 25 1998

CITY OF SACRAMENTO
DEVELOPMENT SERVICES DIV

980 2355 C

APPROVED
E.H. Clark
SACRAMENTO 3-25-98

Sprinkler Monitoring Only

Flowline Contractors, Inc
6600 Asher Lane
SACRAMENTO, Ca 95828
(916) 383-7525