



APPROVED
BY THE CITY COUNCIL

OCT 5 1999

OFFICE OF THE
CITY CLERK

1.10

DEPARTMENT OF
UTILITIES

ENGINEERING SERVICES

CITY OF SACRAMENTO
CALIFORNIA

1395 - 35TH AVENUE
SACRAMENTO, CA
95822-2911

PH 916-264-1400
FAX 916-264-1497

September 17, 1999

City Council
Sacramento, California

Honorable Members in Session:

SUBJECT: SACRAMENTO RIVER WATER TREATMENT PLANT PUMP STATION MODIFICATIONS AND CLEARWELL ROOF REPAIR (PN:ZG36): EXECUTE SUPPLEMENTAL AGREEMENT NO. 1 TO THE CONSULTANT SERVICES AGREEMENT (98-051) WITH MONTGOMERY WATSON FOR AN AMOUNT NOT TO EXCEED \$60,200.

LOCATION AND COUNCIL DISTRICT:

The project is located at the Sacramento River Water Treatment Plant (SRWTP) on Bercut Drive, District 1 (see enclosed map).

RECOMMENDATION:

Staff recommends that the City Council approve the attached resolution authorizing the City Manager and City Clerk to approve Supplemental Agreement No. 1 to Consultant and Professional Services Agreement No. 98-051 with Montgomery Watson for construction support services for an amount not to exceed \$60,200.

CONTACT PERSON:

Candace McGahan, Senior Engineer, 264-1416
Gary Reents, Engineering Services Manager, 264-1433

FOR COUNCIL MEETING OF: October 5, 1999

SUMMARY

A Consultant Services Agreement with Montgomery Watson to provide pre-design and design services was approved by City Council on May 12, 1998. A Supplemental Agreement has been negotiated for additional construction support services for an amount not to exceed \$60,200.

COMMITTEE/COMMISSION ACTION

None.

BACKGROUND INFORMATION

The Sacramento River Water Treatment Plant (SRWTP) Pump Station Vault and Clearwell Roof Repair project involves remedying settlement and deterioration problems identified in previous studies. Performing the rehabilitation work is required to ensure an uninterrupted water supply from the SRWTP.

The original contract for this project included engineering services for pre-design, design, plans, specifications and cost estimates to construct a new south vault at the pump station, replace the piping inside the vault, and repair the concrete roof on the 5 million gallon reservoir. The project is now in construction. Additional engineering services are needed for submittal review, construction issues, geotechnical support, and response to requests for information. Supplemental Agreement No. 1 will provide for these additional engineering services during construction.

FINANCIAL CONSIDERATIONS

Supplemental Agreement No. 1 is for an amount not to exceed \$60,200 and will be funded from the Water Fund Capital Improvement Program (413-500-ZG36), which has an unobligated balance of \$641,182 as of September 16, 1999.

ENVIRONMENTAL CONSIDERATIONS

The Planning Services, Environmental Section, has reviewed the project and has determined that this project is categorically exempt pursuant to State Class 2 and Section 15302 of the California Environmental Quality Act.

POLICY CONSIDERATIONS

The action requested herein is consistent with Sacramento City Code, Title 59.

City Council
September 16, 1999
Sacramento River Water Treatment Plant Modifications (PN: ZG36)

ESBD CONSIDERATIONS


The original contract was approved by City Council prior to the emerging and small business enterprise program. The participation of minority owned businesses certified with the City represented 6.3% of the overall contract amount. The women owned business participation in this contract was 1.5%.

Respectfully submitted,




Gary A. Reents
Engineering Services Manager

RECOMMENDATION APPROVED:




ROBERT P. THOMAS
City Manager

APPROVED:



For JAMES G. SEQUEIRA
Director of Utilities

Handwritten text, possibly a signature or initials, appearing as "A. J. A. F." or similar.

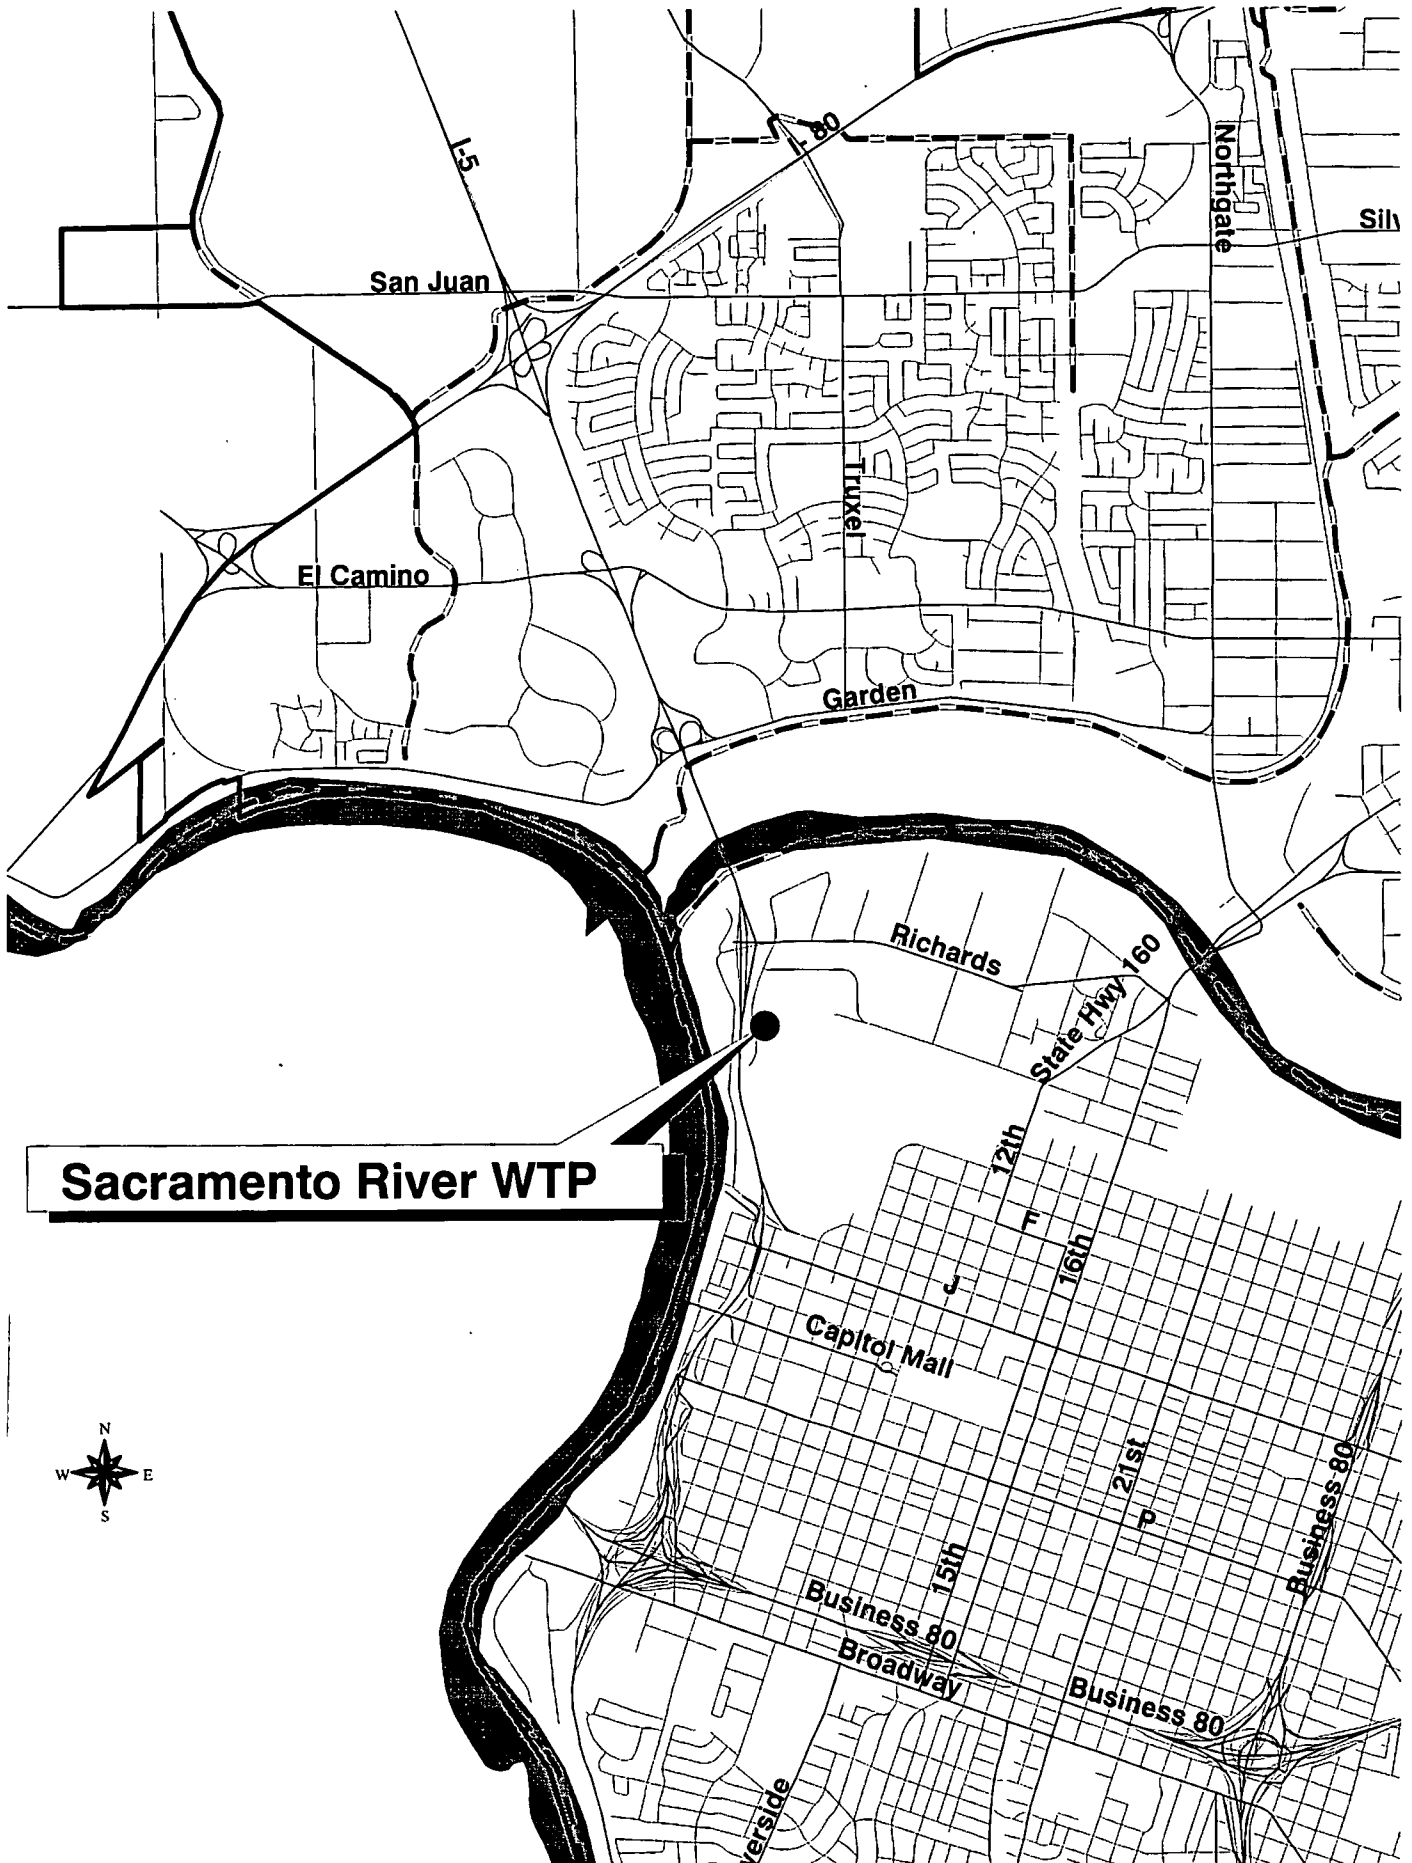

Sacramento River WTP

**Sacramento River Water Treatment Plant
Pump Station Modifications and Clearwell Roof Repair
PN: ZG36**

RESOLUTION NO. 99-561

ADOPTED BY THE SACRAMENTO CITY COUNCIL

ON DATE OF _____

APPROVED
BY THE CITY COUNCIL

OCT 5 1999

OFFICE OF THE
CITY CLERK

RESOLUTION AUTHORIZING THE CITY MANAGER AND CITY CLERK TO APPROVE SUPPLEMENTAL AGREEMENT NO. 1 TO CONSULTANT SERVICES AGREEMENT NO. 98-051 WITH MONTGOMERY WATSON FOR ADDITIONAL ENGINEERING SERVICES FOR THE SACRAMENTO RIVER WATER TREATMENT PLANT PUMP STATION MODIFICATIONS AND CLEARWELL ROOF REPAIR (PN:ZG36) FOR AN AMOUNT NOT TO EXCEED \$60,200.

BE IT RESOLVED BY THE CITY OF SACRAMENTO THAT:

The City Manager and City Clerk are hereby authorized to sign and approve Supplemental Agreement No. 1 to Consultant Services No. 98-051 with Montgomery Watson for an amount not to exceed \$60,200 for engineering services for the Sacramento River Water Treatment Plant Pump Station Modifications and Clearwell Roof Repair Project.

MAYOR

ATTEST:

CITY CLERK

FOR CITY CLERK USE ONLY

RESOLUTION NO. _____

DATE ADOPTED: _____

5