

CITY OF SACRAMENTO
1231 I Street, Sacramento, CA 95814

Permit No: 0100840
Insp Area: 2

Site Address: 7013 POCKET RD SAC
Parcel No: 031-0300-047

Sub-Type: RES
Housing (Y/N): N

CONTRACTOR
CENTRAL PACIFIC
P.O. BOX 2784
CH 95611

OWNER
SPITTLER DOUGLAS D & MICHAEL
7013 POCKET RD
SACRAMENTO CA 95831

ARCHITECT

**Nature of Work: REROOF T/O EXISTING TILE AND REROOF WITH NEW LIGHT WEIGHT
TILE 32 SQ**

CONSTRUCTION LENDING AGENCY: I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097 Civ. C.)

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C39 License Number 758661 Date 1-19-2001 Contractor Signature [Signature]

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code): any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00).

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law)

I am exempt under Sec. _____ B & PC for this reason: AIL

Date _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 1-19-2001 Applicant/Agent Signature [Signature]

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:


Carrier STATE COMP INS FUND Policy Number PENDING Exp Date 01/01/2002

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 1-19-2001 Applicant Signature [Signature]

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.


THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

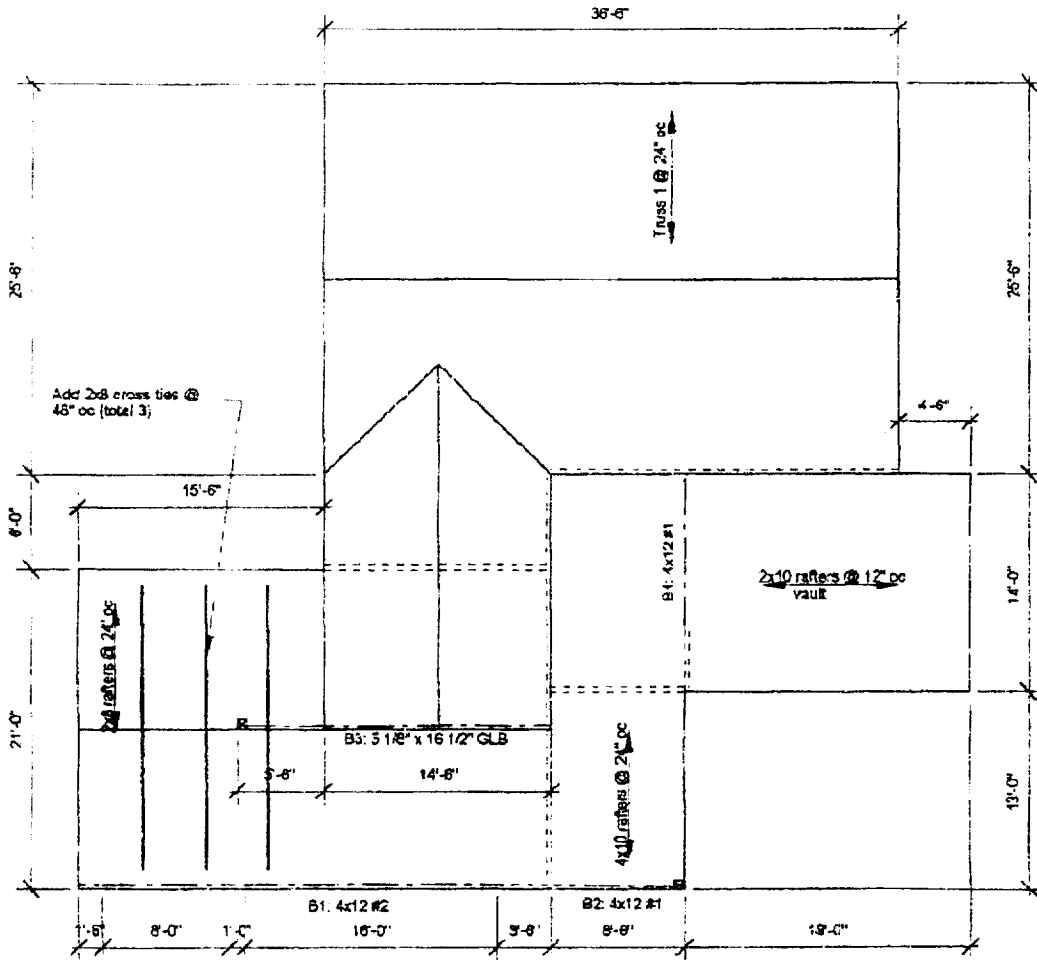

ISSUED

JAN 19 2001

Sacramento Building Division



This set of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the same without written permission from the Building Inspection Division.

The approval of this plan and specification SHALL NOT be held to permit or approve the violation of any City Ordinance or State Law.



ISSUED

JAN 19 2001

Sacramento Building Division

Notes:

1. This is a reroof project. The new roofing material shall be a Standard Weight Concrete Tile. The tile shall weigh less than or equal to 10.0 psf.
2. All rafters are 2x8 DF#2 and hips and valleys are 2x10 DF#2 unless otherwise noted.
3. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2320.12 "Roof and Ceiling Framing" unless otherwise shown.
4. All structural wood members that were observed appear to be in sound condition and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the same without written permission from the Building Inspection Division.



ROOF PLAN - SPAN 1

Not to Scale



This set of plans and specifications must be kept on the job at all times and it is unlawful to make any changes or alterations from the same without written permission from the Building Inspection Division.

The approval of this plan and specification SHALL NOT be held to permit or approve the violation of any City Ordinance or State Law.

Spittler




Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

January 17, 2001

Central Pacific Roofing
P.O. Box 2784
Citrus Heights, CA 95611-2784
TEL: (916) 726-1571
FAX: (916) 726-2260

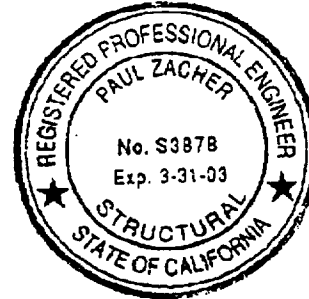

Attn.: Mr. Ben Gomez,

re: Job 2001_008: SPITTLER

Subject: Structural Investigation Report of the Roof for the Residence located at 7013 Pocket Road, Sacramento, CA 95831.

As requested by Mr. Ben Gomez, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site January 16, 2001. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report are based on the 1997 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence.
Year Built: Estimated 1970's vintage.
Occupancy: Residential.
No. of Stories: Two.
Dimensions: Approximately 2500 square feet with a first story plate height of 8 feet.

CONSTRUCTION:


Roof:
The roof covering will consist of a Standard Weight Concrete Tile over 1/2" solid sheathing. The living area is framed with pre-engineered wood trusses spaced at 24" on center except for the vaulted ceiling areas. The vaulted ceiling is constructed of 2x10 rafters spaced at 12" on center supported mid-span by a 4x beam. The garage area is framed with 2x8 rafters spaced at 24" on center.

CONCLUSIONS:

Roof:
The living area has sufficient structural capacity for the applied live and dead loads. The garage lacks sufficient structural capacity for the applied live and dead loads.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100

Spittler



Paul Zacher - Structural Engineers
 4701 Lakeside Way
 Fair Oaks, CA 95628

TEL: 916.961.3960
 FAX: 916.961.6552

RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.

Garage.

1. Add 2x8 cross ties as required so that the maximum spacing does not exceed 4'-0" on center. Nail the cross ties to the existing rafters with 6 -16d's at each connection. See detail 1.

It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls that are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure.

It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects that are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,

Paul Zacher, P.E., S.E.
 file

0100840 R

7013 Pocket Rd
area 2


Spittler

Paul Zacher - Structural Engineers
4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.6552

January 17, 2001

Central Pacific Roofing
P O Box 2784
Citrus Heights, CA 95611-2784
TEL: (916) 726-1571
FAX: (916) 726-2260

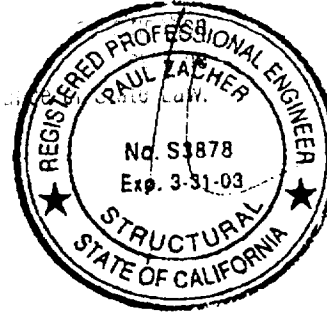

REVIEWED BY:
[Signature]
1/23/01

Attn: Mr Ben Gomez,

re Job 2001 008 SPITTLER

Subject: Structural Investigation Report of the Roof for the Residence located at 7013 Pocket Road, Sacramento, CA 95831.

As requested by Mr. Ben Gomez, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site January 16, 2001. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report are based on the 1997 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence
Year Built: Estimated 1970's vintage.
Occupancy: Residential
No. of Stories: Two
Dimensions: Approximately 2500 square feet with a first story plate height of 8 feet.

CONSTRUCTION:

Roof:
The roof covering will consist of a Standard Weight Concrete Tile over 1/2" solid sheathing. The living area is framed with pre-engineered wood trusses spaced at 24" on center except for the vaulted ceiling areas. The vaulted ceiling is constructed of 2x10 rafters spaced at 12" on center supported mid-span by a 4x beam. The garage area is framed with 2x8 rafters spaced at 24" on center.

CONCLUSIONS:

Roof:
The living area has sufficient structural capacity for the applied live and dead loads. The garage lacks sufficient structural capacity for the applied live and dead loads.

Sacramento Building Division

JAN 24 2001

ISSUED

1/1

Spittler

ISSUED

Paul Zacher - Structural Engineers
 4701 Lakeside Way
 Fair Oaks, CA 95628

JAN 24 2001
 Sacramento Building Division

TEL: 916.961.3980
 FAX: 916.961.6552

RECOMMENDATIONS

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work

Garage:

1. Add 2x8 cross ties as required so that the maximum spacing does not exceed 4'-0" on center. Nail the cross ties to the existing rafters with 6-16d's at each connection. See detail 1.

It shall be noted that small hairline cracking may occur at exterior stucco and interior gypboard finished walls that are load bearing or distributing roof strut loads. These cracks are a natural occurrence as the existing structure re-distributes the new roof weight. They are cosmetic in nature and are not an indication of a structural hazard or failure


It shall be noted that some deflection of the rafters may be evident after installation of the tile. The existing roof framing has deflected but this may not be readily evident due to the uneven nature of the existing roofing material. Concrete tile is a very consistent and uniform product and when installed in an even plane, even small deflections can become apparent. This is only a cosmetic issue and not a structural concern.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects that are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call

Sincerely,



Paul Zacher, P.E., S.E.
 file

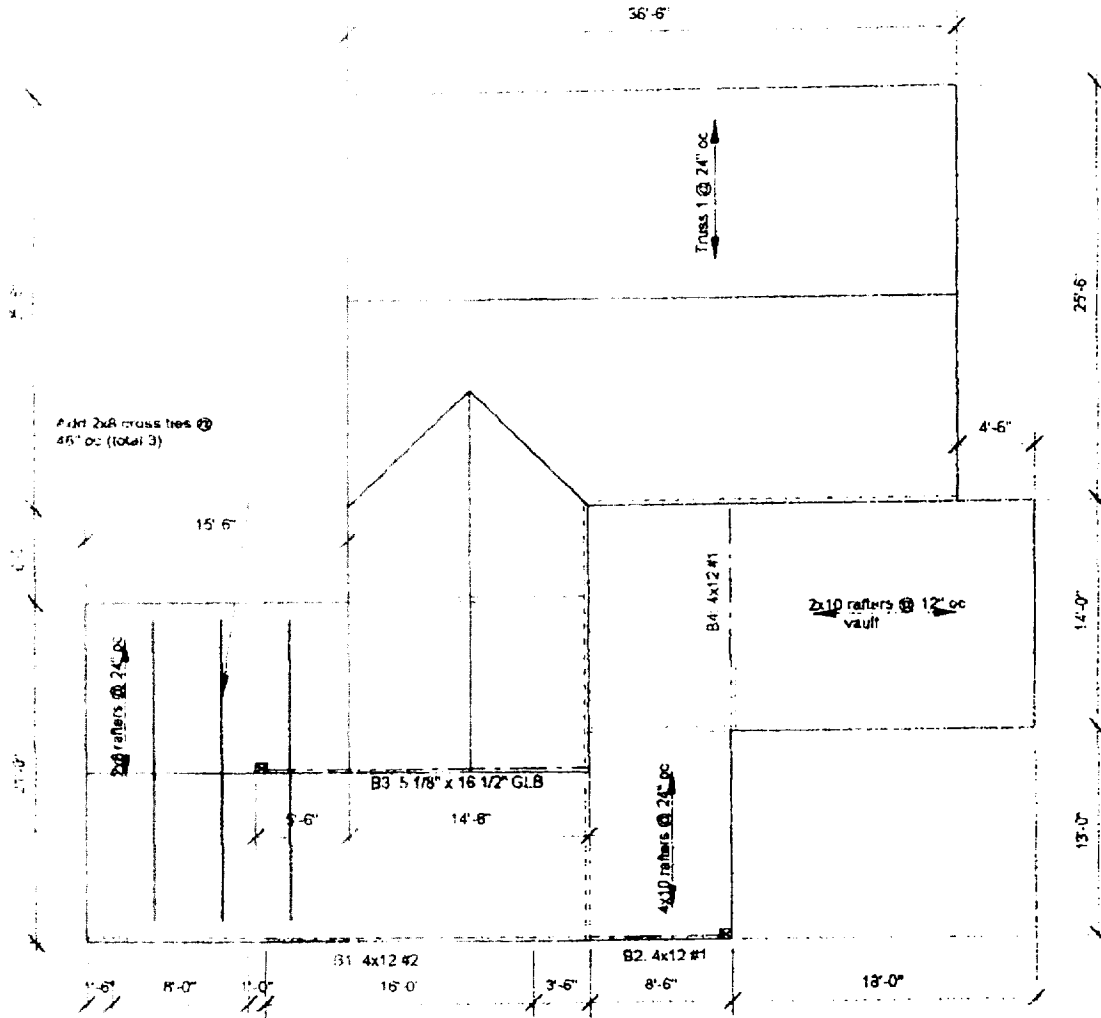

ISSUED

JAN 24 2001

Sacramento Building Division

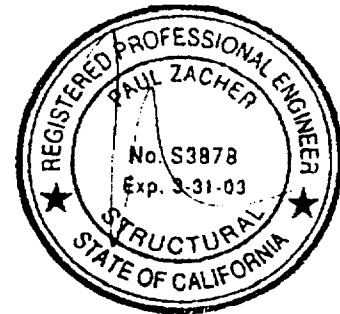

Notes:

1. This is a reroof project. The new roofing material shall be a Standard Weight Concrete Tile. The tile shall weigh less than or equal to 10.0 psf.
2. All rafters are 2x8 DF#2 and hips and valleys are 2x10 DF#2 unless otherwise noted.
3. All existing rafter, hips, valleys, rafter ties, and purlins are braced per UBC Section 2320.12 "Roof and Ceiling Framing" unless otherwise shown.
4. All structural wood members that were observed appear to be in sound condition and without structural defect



ROOF PLAN - SPITTLER

Not to Scale