

CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 9808440

Insp Area: 2

Site Address: 6865 WATERVIEW WY SAC

Parcel No: 0300630050

Sub-Type: RES

Housing (Y/N): N

CONTRACTOR

ZIMMERMAN ROOFING
3560 RAMONA AV
SACRAMENTO, CA

95826

OWNER

NELSON DONALD G
6865 WATERVIEW WY
SACRAMENTO CA

95831

ARCHITECT

Nature of Work: REMOVE OLD ROOF & REROOF W/PIONEER TILE 4/12 PITCH SFR 38SQS

CONSTRUCTION LENDING AGENCY : I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name _____ Lender's Address _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class C39 License Number 557559 Date 8-31-98 Contractor Signature Billy Coy

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars (\$500.00);

I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

I am exempt under Sec. _____ B & PC for this reason: _____

Date _____ Owner Signature _____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and hereby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 8-31-98 Applicant/Agent Signature Billy Coy

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier State Fund Policy Number 713 97 002021

(This section need not be completed if the permit is for \$100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 8-31-98 Applicant Signature Billy Coy

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS (\$100,000) IN ADDITION TO THE COST OF COMPENSATION. DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.



DEPARTMENT OF
PLANNING AND DEVELOPMENT

CITY OF SACRAMENTO
CALIFORNIA

1231 I STREET
ROOM 200
SACRAMENTO, CA
95814-2998

Permit Services
916-264-7619
FAX 916-264-7046

Don Nelson at
6865 Waterview
Sacto. Ca 95831

TILE ROOF WORKSHEET

This worksheet must be filled out whenever any type of tile roof is applied for.

If the answer to question #5 is yes, a written engineering report from a registered engineer must be provided with each application.

1. BRAND AND MODEL OF TILE Pioneer Everest Shale
2. TILE WEIGHT PER SQUARE 730
3. WEIGHT OF ROOF SYSTEM PER SQUARE 180
4. TOTAL WEIGHT OF ROOF SYSTEM 910
5. DOES TOTAL WEIGHT OF ROOF SYSTEM EXCEED 750# PER SQUARE? YES NO
6. ROOF SLOPE 4/12

PLEASE PROVIDE A SEPARATE WORKSHEET FOR EACH APPLICATION INVOLVING A TILE ROOF.

see attached engin report

Paul Zacher-Structural Engineers

4701 Lakeside Way
Fair Oaks, CA 95628

TEL: 916.961.3960
FAX: 916.961.3960
e-mail: pzacher@softcom.net

August 21, 1998

Zimmerman Roofing
3560 Ramona Avenue
Sacramento, CA 95826
TEL: 916.454.3667
FAX: 916.455.3784
TEL (Jeff): 916.392.1971
FAX (Jeff): 916.392.6853
FAX (Framer) : 916.383.5308

Attn.: Mr. Jeff Tucker,

re: Job 98189: NELSON

Subject: Structural Investigation Report of the Roof for the Residence located at 6865
Waterview Way, Sacramento, CA 95831.

As requested by Mr. Jeff Tucker, this is a report to determine what needs should be addressed to correct any structural deficiencies of the roof. Paul Zacher visited the site August 21, 1998. The investigation was made to determine the existing condition of the structure. All information, data and analysis contained within this report is based on the 1994 Uniform Building Code.

The following is based on visual observations with no subsurface investigation being made.

DESCRIPTION:

Type of Facility: Residence.
Year Built: Estimated 1980's vintage.
Occupancy: Residential.
No. of Stories: One.
Dimensions: Approximately 2000 square feet with a first story plate height of 8 feet.

CONSTRUCTION:

Roof:

The roof covering will consist of Pioneer Everwest Light Weight Concrete Tile over 1/2" solid sheathing. The living area is conventionally framed with 2x6 rafters spaced at 24" on center with 2x6 purlins supported at no more than 8'-0" on center by 2x4 struts bearing on walls below. The garage area is framed with 2x6 rafters spaced at 24" on center and 2x6 cross ties spaced at 4'-0" on center.

CONCLUSIONS:

Roof:

The living area lacks sufficient structural capacity for the applied live and dead loads. The garage has sufficient structural capacity for the applied live and dead loads.

RECOMMENDATIONS:

If any of the following recommendations do not correspond to actual field conditions, the engineer of record shall be notified for further investigation and evaluation before continuing work.


Living Area:

1. Scab a 2x8 DF#2 x 8'-0" long purlin to the existing 2x6 purlin which spans 8'-0". Attach it with 16d's @ 3" on center. Support the 2x8 to the bearing walls below with 2x4 struts. See details 1 and 2.
2. Provide additional 2x4 struts from the existing purlins to the bearing walls below. The maximum spacing between the new and existing struts shall not exceed 6'-0" on center. The unbraced length of the struts shall not exceed 8'-0" and the minimum slope of the struts shall not be less than 45 degrees from the horizontal.
3. Add 2x6 collar ties at 4'-0" on center to tie the existing rafters together. Nail the crosstie to the existing rafter with 4 -16d commons at each connection. Place the collar tie as close to the existing ceiling joists as possible.

The inspection consisted of visual observation only, made solely to determine the structural capacity of the existing roof. Analysis does not determine any effects on the overall structure under lateral forces or effects on the foundation unless specifically noted in the calculations and in this document. No warranties, expressed or implied, are made or intended in conjunction with this report. The inspection was made only to the portions that were accessible. The specific items noted were those that were observable and there may be defects which are not observable, or are hidden by architectural and structural materials.

If you have any questions on the above, do not hesitate to call.

Sincerely,



Paul Zacher, P.E., S.E.
file



DESIGN LOADING:

Roof Pitch 4 in 12
Pitch Adjustment Factor 1.05

LOCATION: ROOF

<u>MATERIAL</u>	<u>WEIGHT</u>	
Pioneer Everwest Light Wt	7.00	psf
Roofing felt	0.30	psf
1x4 skip sht'g	1.09	psf
1/2" OSB/ plywood	1.50	psf
2x6 rafters @ 24" oc	1.00	psf
	Load	10.9 psf
Roof Pitch Adjustment	0.59	psf
Total Load	11.5	psf

BEAM DESIGN FOR UNIFORM LOAD: 2x6

(Values for DF Larch #2)

Width, b	1.5 inches
Depth, d	5.5 inches
Length of beam	12 feet
Dead load roof	11.5 psf
Live load roof	16 psf
Contributory width of roof load	2 feet
Dead load floor	0 psf
Live load floor	0 psf
Contributory width of floor load	0 feet
Dead load wall	0 plf
Live load defl ratio	240
Total load defl ratio	180
Total dead load	23 plf
Total live load	32 plf

Base design values:

Shear, F_v	95 psi
Bending, F_b	875 psi
Comp. perp. to grain, F_c	625 psi
Mod of Elasticity, E	1600000 psi
Load duration factor, C_d	1.25
Size Factor, C_f	1.30
Repetitive factor, C_r	1.15

Dead load reaction	138 lbs
Live load reaction	192 lbs
Total load reaction	330 lbs

Allowable shear, F_v'	119 psi
Actual shear, f_v	55 psi
Allowable bending, F_b'	1635 psi
Actual bending, f_b	1571 psi
Allowable live load defl	0.60 inches
Actual live load defl	0.45 inches
Allowable total load defl	0.80 inches
Actual total load defl	0.77 inches

Bearing length req'd 0.35 inches

Horizontal Shear OK

Bending OK

Live Load Deflection OK

Total Load Deflection OK

BEAM DESIGN FOR UNIFORM LOAD: 2x8 purlin

(Values for DF Larch #2)

Width, b	1.5 inches
Depth, d	7.25 inches
Length of beam	8 feet
Dead load roof	11.5 psf
Live load roof	16 psf
Contributory width of roof load	6.5 feet
Dead load floor	0 psf
Live load floor	0 psf
Contributory width of floor load	0 feet
Dead load wall	0 plf
Live load defl ratio	240
Total load defl ratio	180
Total dead load	74.75 plf
Total live load	104 plf

Base design values:

Shear, Fv	95 psi
Bending, Fb	875 psi
Comp. perp. to grain, Fc	625 psi
Mod of Elasticity, E	1600000 psi
Load duration factor, Cd	1.25
Size Factor, Cf	1.20
Repetitive factor, Cr	1.00

Dead load reaction	299 lbs
Live load reaction	416 lbs
Total load reaction	715 lbs

Allowable shear, Fv'	119 psi
Actual shear, fv	84 psi
Allowable bending, Fb'	1313 psi
Actual bending, fb	1306 psi
Allowable live load defl	0.40 inches
Actual live load defl	0.13 inches
Allowable total load defl	0.53 inches
Actual total load defl	0.22 inches

Bearing length req'd 0.76 inches

Horizontal Shear OK

Bending OK

Live Load Deflection OK

Total Load Deflection OK

BEAM DESIGN FOR UNIFORM LOAD: Porch

(Values for DF Larch #1)

Width, b	3.5 inches
Depth, d	11.25 inches
Length of beam	10.5 feet
Dead load roof	14.5 psf
Live load roof	16 psf
Contributory width of roof load	7.25 feet
Dead load floor	0 psf
Live load floor	0 psf
Contributory width of floor load	0 feet
Dead load wall	0 plf
Live load defl ratio	360
Total load defl ratio	240
Total dead load	105.125 plf
Total live load	116 plf

Base design values:

Shear, Fv	95 psi
Bending, Fb	875 psi
Comp. perp. to grain, Fc	625 psi
Mod of Elasticity, E	1600000 psi
Load duration factor, Cd	1.25
Size Factor, Cf	1.10

Dead load reaction	552 lbs
Live load reaction	609 lbs
Total load reaction	1161 lbs

Allowable shear, Fv'	119 psi
Actual shear, fv	36 psi
Allowable bending, Fb'	1203 psi
Actual bending, fb	495 psi
Allowable live load defl	0.35 inches
Actual live load defl	0.05 inches
Allowable total load defl	0.53 inches
Actual total load defl	0.09 inches

Bearing length req'd	0.53 inches
----------------------	-------------

Horizontal Shear OK


Bending OK

Live Load Deflection OK

Total Load Deflection OK


ADD 2x6 COLLAR
TIES @ 48" OC
(APPROX 10)


SCAB 2x8 x 8"
EXISTING 2x6
PURLIN (2)

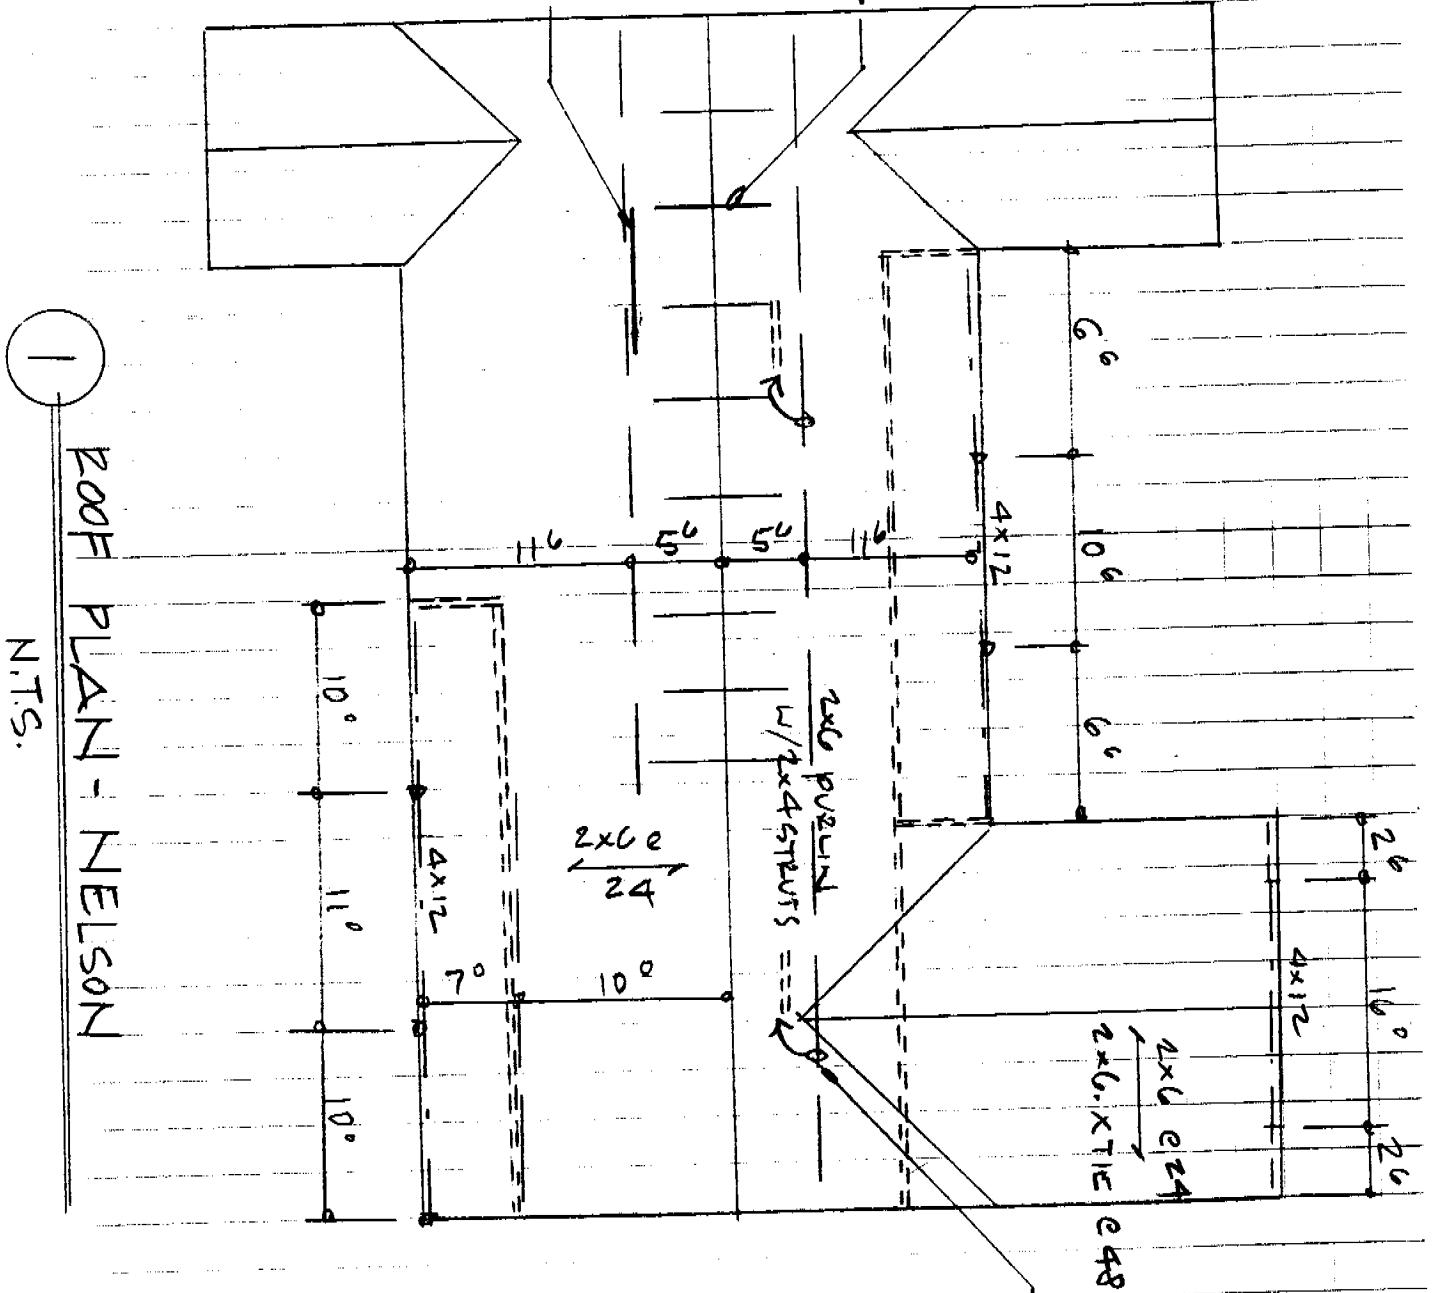

1
ROOF PLAN - NELSON
N.T.S.

ADD 2x4 STUB,
(TOTAL 2)

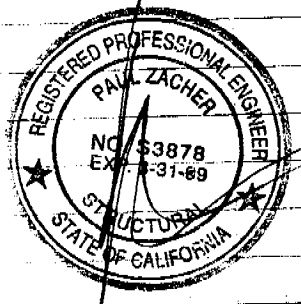

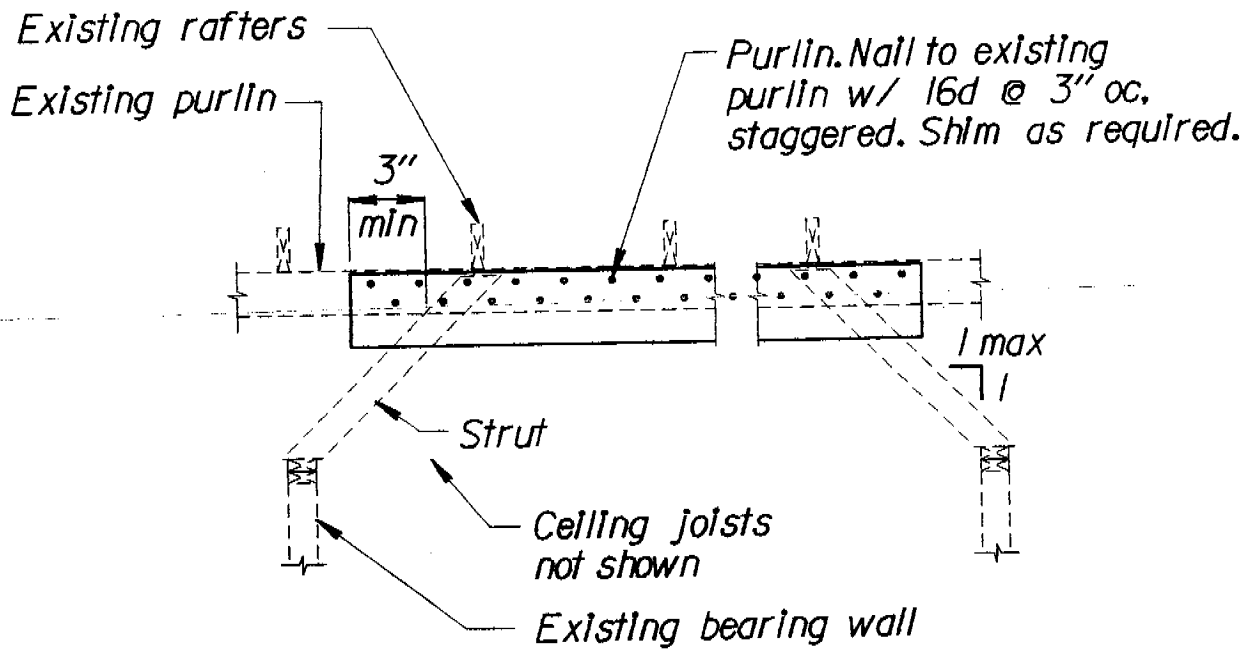

2

PURLIN DETAIL

1-1-0